

**ENTERGY INDEPENDENCE PLANT
EAST AND WEST RECYCLE PONDS**

**DEMONSTRATION OF COMPLIANCE WITH
EPA CCR RULE SITING CRITERIA
§257.64, UNSTABLE AREAS**

**PREPARED IN COMPLIANCE WITH THE
EPA FINAL RULE FOR THE DISPOSAL OF
COAL COMBUSTION RESIDUALS
TITLE 40 CODE OF FEDERAL REGULATIONS PART 257**



OCTOBER 17, 2018

ENTERGY INDEPENDENCE PLANT
EAST AND WEST RECYCLE PONDS

DEMONSTRATION OF COMPLIANCE WITH
EPA CCR RULE SITING CRITERIA
§257.64, UNSTABLE AREAS

Prepared for

Entergy Arkansas, Inc.
PO Box 551
Little Rock, AR 72203

Prepared by

FTN Associates, Ltd.
3 Innwood Circle, Suite 220
Little Rock, AR 72211

FTN No. R07920-1861-001

October 17, 2018

PROFESSIONAL ENGINEER'S CERTIFICATION

With this certification, I certify that I, as a Professional Engineer in the State of Arkansas, am a qualified professional engineer as defined in §257.53 of Title 40 Code of Federal Regulations (40 CFR) Part 257, that this report has been prepared under my direction in accordance with generally accepted good engineering practices, that the findings are accurate to the best of my knowledge, and that the CCR unit that is subject to this certification meets the location restriction requirements under §257.64 of 40 CFR Part 257.



Dana L. Derrington, Arkansas PE #16372

10/17/2018
Date

TABLE OF CONTENTS

PROFESSIONAL ENGINEER’S CERTIFICATION	i
1.0 INTRODUCTION	1
2.0 SITE DESCRIPTION	1
3.0 UNSTABLE AREA EVALUATION.....	2
3.1 Review of Onsite or Local Soil Conditions	2
3.2 Review of Onsite or Local Geologic or Geomorphologic Features	3
3.3 Review of Onsite or Local Human-Made Features or Events (Both Surface and Subsurface)	3
4.0 CONCLUSIONS.....	3
5.0 REFERENCES	3

LIST OF APPENDICES

APPENDIX A:	Figures
APPENDIX B:	Well Construction Diagrams, Soil Boring Logs, and Geotechnical Data

1.0 INTRODUCTION

Entergy Arkansas, Inc. (Entergy), operates the Independence plant located approximately 2 miles southeast of Newark, Arkansas. The plant utilizes two recycle ponds, hereafter referred to as the East and West Recycle Ponds, for, among other things, the management of bottom ash transport water. Pursuant to §257.64 of Title 40 Code of Federal Regulations (40 CFR) Part 257, existing coal combustion residual (CCR) surface impoundments must not be located in an unstable area. An unstable area is defined by §257.53 as a location that is susceptible to natural or human-induced events or forces capable of impairing the integrity, including structural components of some or all of the CCR unit that are responsible for preventing releases from such unit. Unstable areas can include poor foundation conditions, areas susceptible to mass movements, and karst terrains. This report presents the findings of an evaluation of the East and West Recycle Ponds in support of the location restriction requirements of §257.64.

2.0 SITE DESCRIPTION

The East and West Recycle Ponds are shown on Figure 1 (all figures are located in Appendix A). The East Recycle Pond has an approximate surface area of 6.2 acres and the West Recycle Pond has an approximate surface area of 6.8 acres¹. Based on surveys completed during June 2018, the East Recycle Pond has a maximum depth of 20 ft below ground surface (ft bgs) and the West Recycle Pond has a maximum depth of 18 ft bgs (FTN Associates, Ltd. [FTN] 2018). The typical water level elevation in the recycle ponds is approximately 235 ft North American Vertical Datum of 1988 (NAVD88) based on field observations during June 2018. At the time of this evaluation, the West Recycle Pond was being drained for maintenance. Drained water from the West Recycle Pond was being pumped into and stored in the East Recycle Pond. Topography surrounding the East and West Recycle Ponds is generally

¹ Pond surface areas were estimated based on the water levels (East Recycle Pond) and water level line (West Recycle Pond) during field activities in June 2018.

flat-lying, with ground surface elevations ranging from approximately 234 to 239 ft NAVD88, as shown on Figures 1 and 2.

3.0 UNSTABLE AREA EVALUATION

Pursuant to §257.64(b), the owner or operator must consider all of the following factors, at a minimum, when determining whether an area is unstable:

1. Onsite or local soil conditions that may result in significant differential settling;
2. Onsite or local geologic or geomorphologic features; and
3. Onsite or local human-made features or events (both surface and subsurface).

FTN performed a review of site-specific boring logs, geotechnical data, and publicly available documents published by the US Geological Survey (USGS). Findings from this review are discussed below within the context of the factors listed in §257.64(b).

3.1 Review of Onsite or Local Soil Conditions

A subsurface investigation was performed in the vicinity of the East and West Recycle Ponds. Soil boring and associated geotechnical data from the investigation (Appendix B) show that onsite soils are comprised of low- to high-plasticity clays and low-plasticity silts to an approximate depth of 30 ft bgs followed by sands and gravels that extend to an approximate depth of 80 ft bgs. These soils are bounded below by Paleozoic rocks and associated residuum (Albin, Hines, and Stephens 1967). A review of the subsurface data included in Appendix B show that no organic soils, which are prone to settlement due to their high compressibility, were encountered in any of the borings. There were also no apparent lateral changes in the underlying lithology that would indicate a notable change in the compressibility of foundation soils, as can be seen from the soil boring logs. These factors, coupled with the relatively uniform loading from the ponds on foundation soils, indicate that significant differential settling is unlikely.

3.2 Review of Onsite or Local Geologic or Geomorphologic Features

The East and West Recycle Ponds are underlain by Quaternary alluvial and terrace deposits as shown by the geological map included as Figure 3. A review of the area topography (Figures 1 and 2) and the geological map shows no evidence of karst features or areas susceptible to mass movement (i.e., landslides) in the vicinity of the East and West Recycle Ponds.

3.3 Review of Onsite or Local Human-Made Features or Events (Both Surface and Subsurface)

Presently, there are no visible onsite or local human-made features or events that would cause the area in the immediate vicinity of the ponds to be unstable. The underlying sands and gravels described in Section 3.2 are part of the Mississippi River Valley alluvial aquifer, which is used extensively in the vicinity of the plant for agricultural purposes. However, a review of an ongoing study conducted by USGS (Schrader 2015) indicates that recharge to the aquifer is sufficient to balance seasonal withdrawals. As such, land subsidence due to groundwater removal is considered unlikely.

4.0 CONCLUSIONS

Based on a review of the available documentation in this report, neither the East Recycle Pond nor the West Recycle Pond is located in an unstable area and therefore both the East and West Recycle Ponds at the Entergy Independence plant meet the location restriction requirements of §257.64.



5.0 REFERENCES

Albin, D.R., M.S. Hines, and J.W. Stephens. 1967. *Water Resources of Jackson and Independence Counties, Arkansas* [USGS Water-Supply Paper 1839-G]. Prepared in cooperation with the Arkansas Geological Commission. Washington, DC: United States Government Printing Office. 39 pp.

- FTN [FTN Associates, Ltd.]. 2018. *Entergy Independence Plant, East and West Recycle Ponds, Demonstration of Compliance With EPA CCR Rule Siting Criteria, §257.60, Placement Above the Uppermost Aquifer*. Little Rock, AR: FTN Associates, Ltd.
- Schrader, T.P. 2015. *Water Levels and Water Quality in the Mississippi River Valley Alluvial Aquifer in Eastern Arkansas, 2012* [USGS Scientific Investigations Report 2015–5059]. Prepared in cooperation with the Arkansas Natural Resources Commission and the Arkansas Geological Survey. Reston, VA: US Geological Survey.
<http://dx.doi.org/10.3133/sir20155059> .
- Stoeser, D.B., G.N. Green, L.C. Morath, W.D. Heran, A.B. Wilson, D.W. Moore, and B.S. Van Gosen. 2005. “The State of Arkansas.” In *Preliminary Integrated Geologic Map Databases for the United States Central States: Montana, Wyoming, Colorado, New Mexico, Kansas, Oklahoma, Texas, Missouri, Arkansas, and Louisiana* [USGS Open-File Report 2005-1351]. Denver, CO: US Geological Survey. Available online at <http://pubs.usgs.gov/of/2005/1351/>.
- USGS [US Geological Survey]. 1962 (rev 1981). “USGS 1:24000-Scale Quadrangle for Newark, AR 1962.” US Geological Survey. Available online at <https://www.sciencebase.gov/catalog/item/5a8a29e6e4b00f54eb3c797b>.

APPENDIX A

Figures

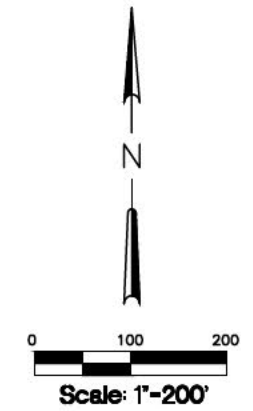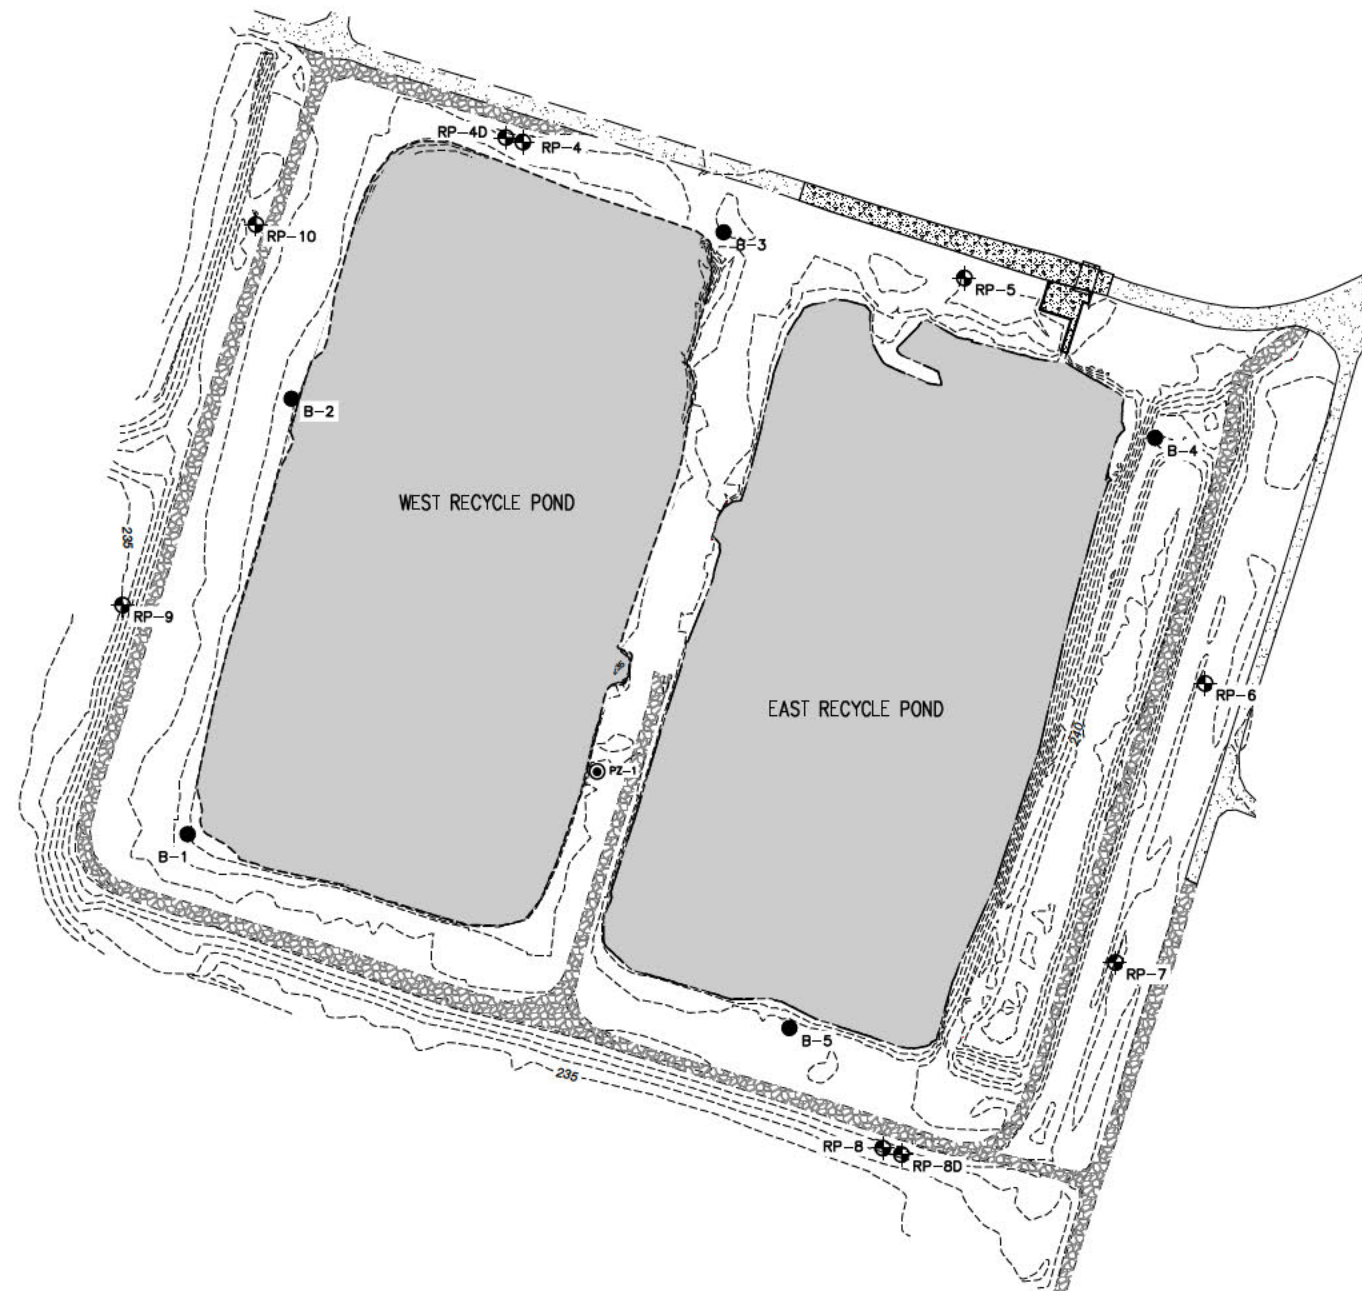

LEGEND	
---240---	5-FT INDEX CONTOUR (HARMON SURVEYING, INC.)
-----	1-FT INTERMEDIATE CONTOUR (HARMON SURVEYING, INC.)
	PAVED ROAD
	GRAVEL ROAD
	CONCRETE PAD
	SOIL BORING
	PIEZOMETER
	MONITORING WELL
	EDGE OF WATER, JUNE 2018
	TYPICAL EDGE OF WATER

- NOTES:
1. TOPOGRAPHIC INFORMATION OUTSIDE OF POND AREA IS FROM SURVEY PERFORMED BY HARMON SURVEYING, INC., JUNE 2018.
 2. WEST POND BOTTOM TOPOGRAPHIC DATA IS FROM SURVEY PERFORMED BY B&F ENGINEERING, INC., JULY AND AUGUST 2018.
 3. DRAWING IS BASED ON ARKANSAS STATE PLANE SYSTEM, NAD83, U.S. FEET.
 4. WEST RECYCLE POND WAS BEING DRAINED FOR MAINTENANCE DURING JUNE 2018.

Figure 1. Site map, Entergy Independence recycle ponds.

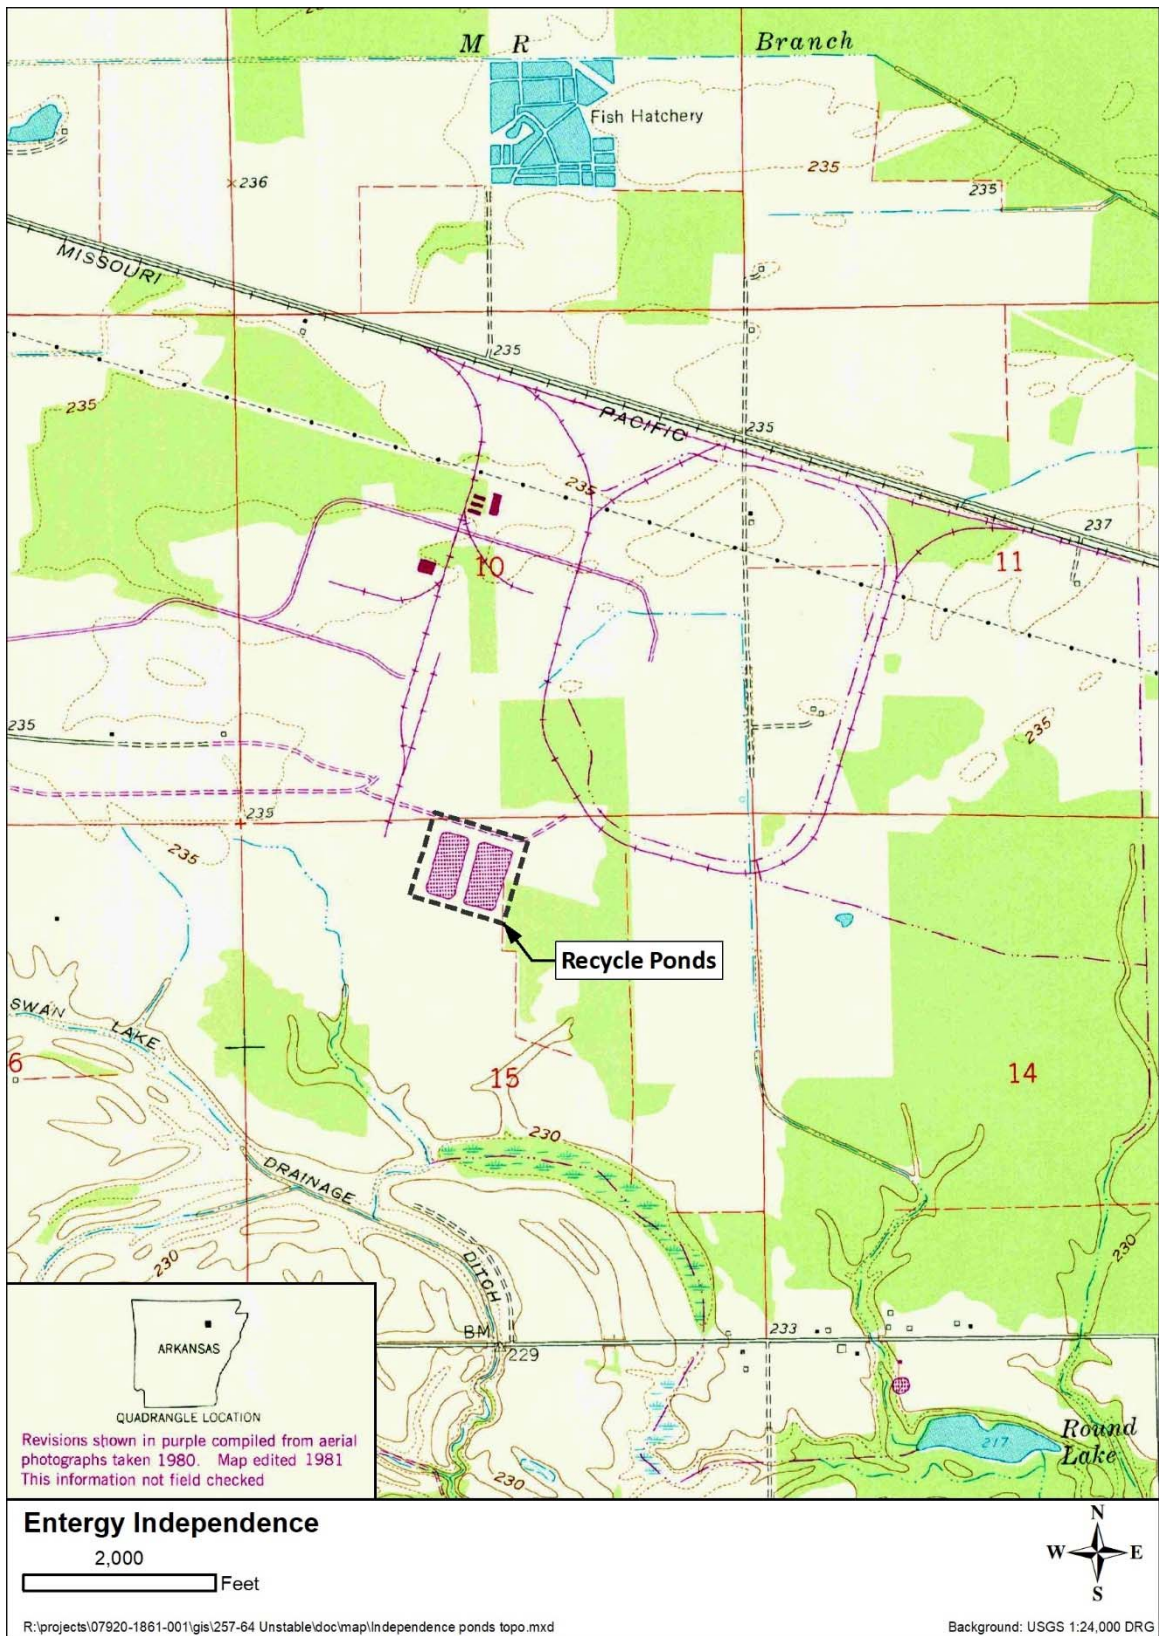


Figure 2. Topography of recycle ponds and surrounding area based on USGS topographic quadrangle Newark, AR (1981).

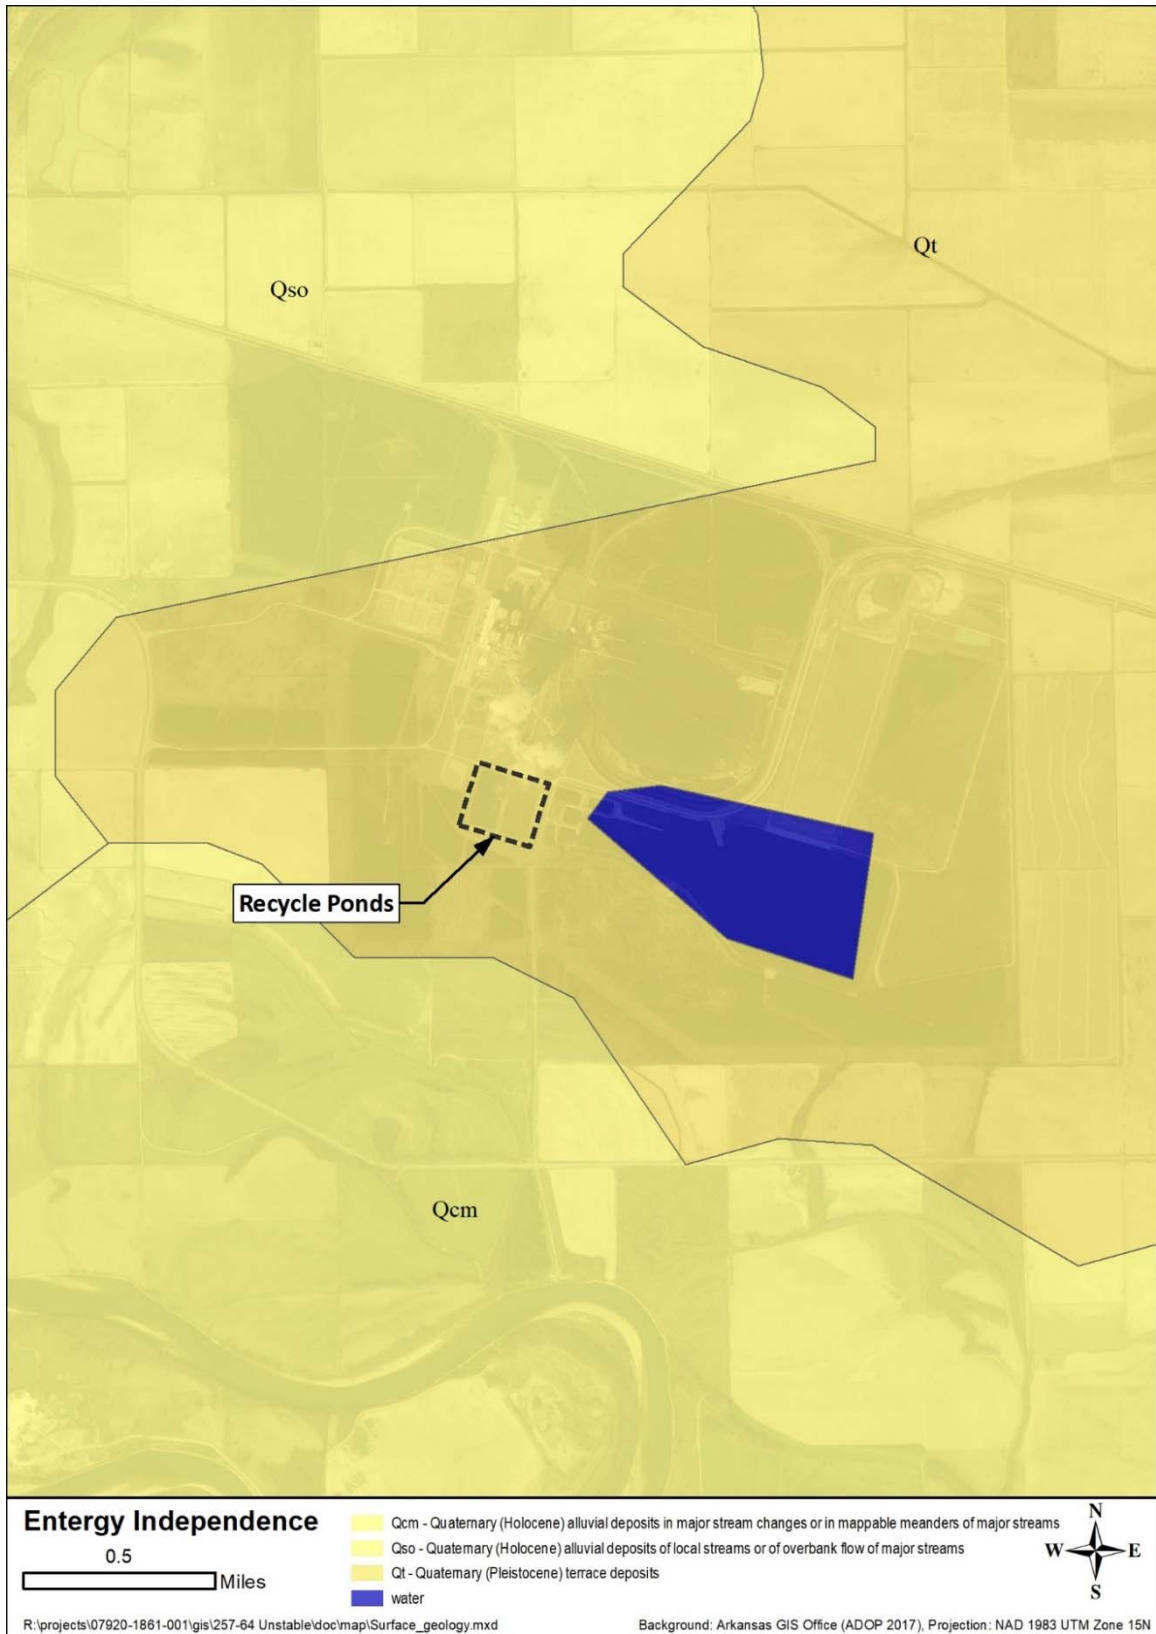


Figure 3. Surface geology of the recycle ponds and surrounding area based on Stoesser et al. 2005.

APPENDIX B

Well Construction Diagrams, Soil Boring Logs, and Geotechnical Data

Well Construction Diagrams and Soil Boring Logs



FTN Project #
R07920-1844-001

LOGGED BY:
AJP

PROJECT:
Monitoring Well Installations

LOCATION:
Entergy Independence Plant

DRILLING CONTRACTOR:
Walker-Hill Environmental, Inc.

DRILLING EQUIPMENT:
Geoprobe 8150LS

DRILLING METHOD:
Sonic with 4x6 in dia, core and case

SAMPLING METHOD:
Continuous with 10 ft, 4 in dia. core barrel

BORING ID:
RP-4

WELL ID:
RP-4

NORTHING:
488173.8

EASTING:
1487765.3

GROUND SURFACE ELEV.:
237.4 ft


TOC ELEVATION:
240.54 ft

TOTAL WELL DEPTH:
46.4 ft below TOC







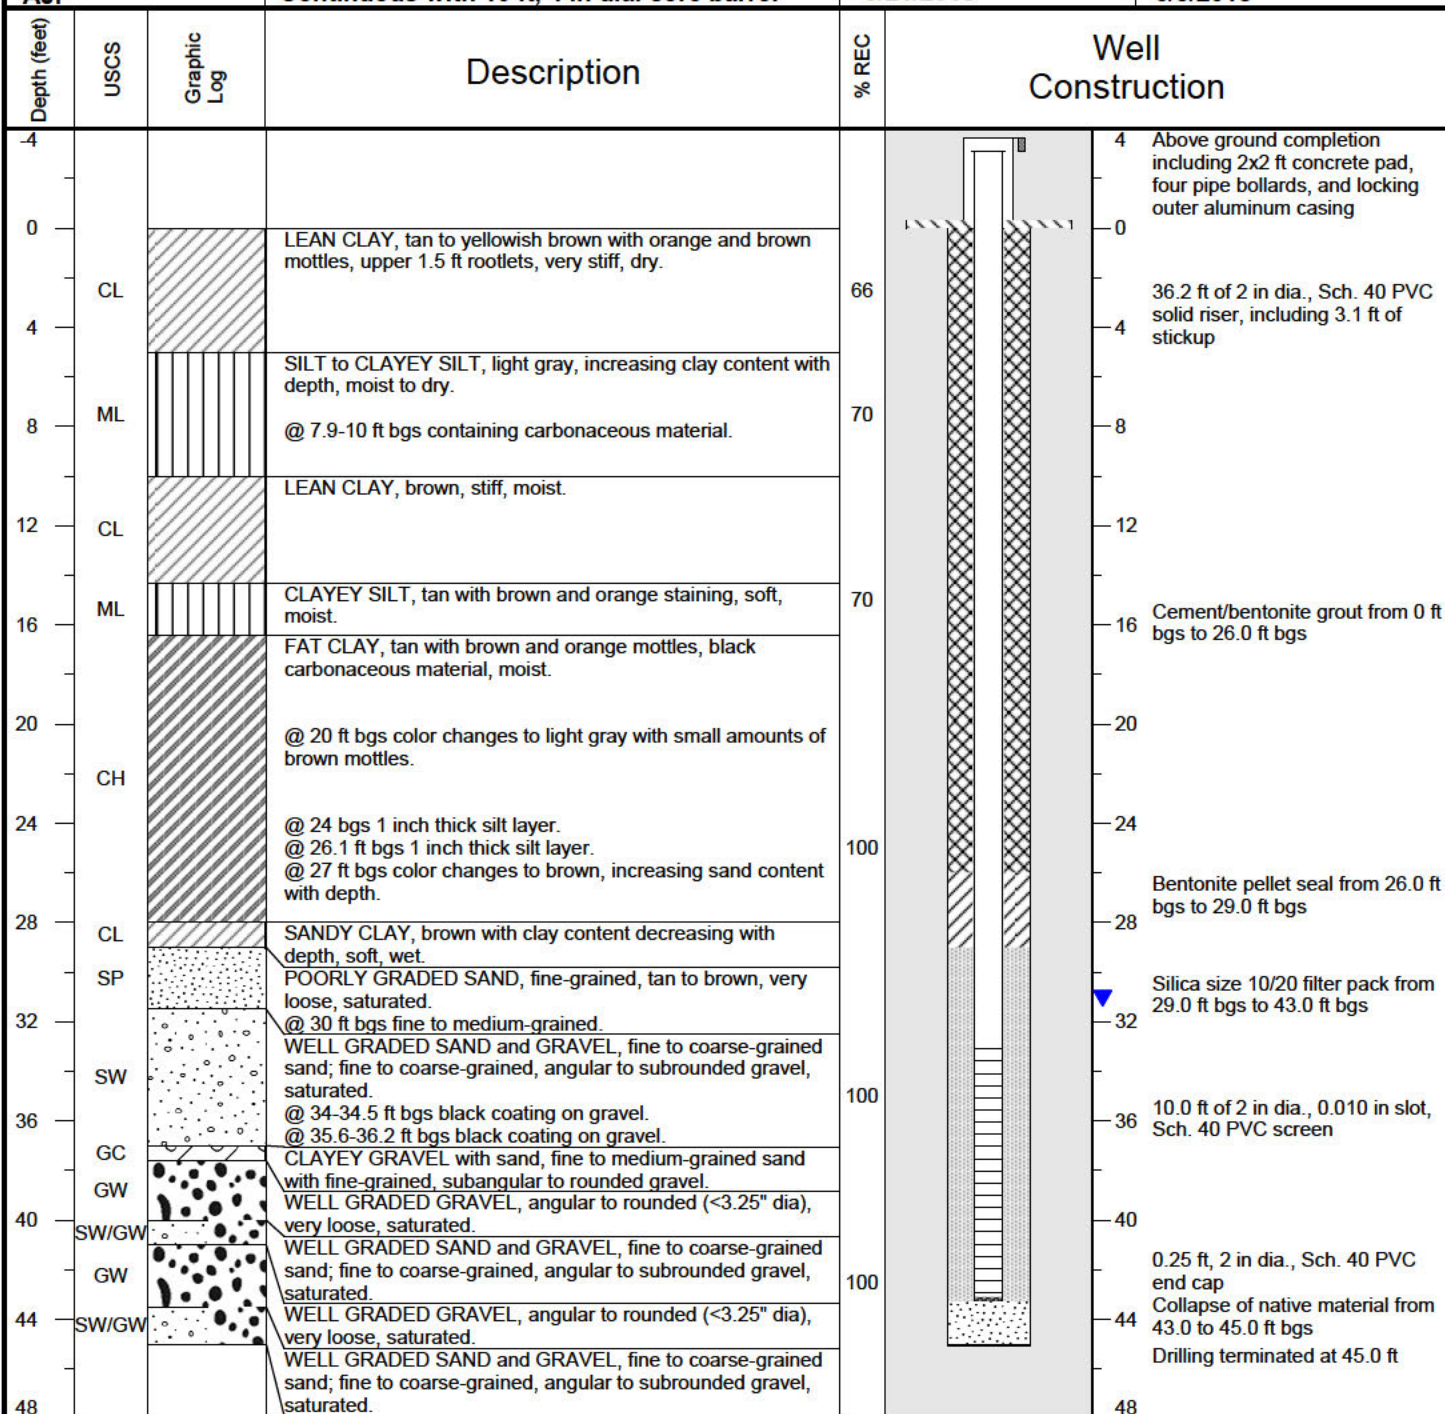

DEPTH TO WATER: 7/23/2018
34.19 ft below TOC

DATE STARTED:
5/21/2018























DATE COMPLETED:
6/3/2018




NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

			PROJECT: Monitoring Well Installations	BORING ID: RP-4D	
			LOCATION: Entergy Independence Plant	WELL ID: RP-4D	
			DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 488178.6	EASTING: 1487747.8
			DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.7 ft	TOC ELEVATION: 240.94 ft
			DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 80.7 ft below TOC	DEPTH TO WATER: 7/23/2018 34.59 ft below TOC
LOGGED BY: AJP			SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/31/2018	DATE COMPLETED: 6/3/2018
Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-5					5
0	FILL		LIMESTONE GRAVEL FILL		
	CL		LEAN CLAY, tan to yellowish brown with orange and brown mottles, upper 1.5 ft rootlets, very stiff, dry.	40	
5					5
	ML		SILT to CLAYEY SILT, light gray with brown to tan upper 1 inch, increasing clay content with depth, moist to dry. @ 7.9-10 ft bgs containing carbonaceous material.	20	70.4 ft of 2 in dia., Sch. 40 PVC solid riser, including 3.2 ft of stickup
10					10
	CL		LEAN CLAY, brown to tan, increasing silt content with depth, stiff, moist.		
15					15
	ML		SILT, tan with brown and orange staining, soft, moist.	100	Cement/bentonite grout from 0 ft bgs to 25.0 ft bgs
	CL		LEAN CLAY, brown with brown and orange mottles, decreasing silt content with depth, medium stiff, moist.		
20					20
	CH		FAT CLAY, tan with brown and orange mottles, black carbonaceous material, moist.		
25					25
			@ 25.9-26 ft bgs light gray silt. @ 26 ft bgs color change to brown with increasing sand content with depth. @ 28 ft bgs FAT SANDY CLAY, brown with fine-grained	100	Bentonite pellet seal from 25.0 ft bgs to 28.0 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

			PROJECT: Monitoring Well Installations	BORING ID: RP-4D	
			LOCATION: Entergy Independence Plant	WELL ID: RP-4D	
			DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 488178.6	EASTING: 1487747.8
			DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.7 ft	TOC ELEVATION: 240.94 ft
			DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 80.7 ft below TOC	DEPTH TO WATER: 7/23/2018 34.59 ft below TOC
LOGGED BY: AJP			SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/31/2018	DATE COMPLETED: 6/3/2018
Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
30	SP		sand, sand content increases with depth, medium stiff, moist.	60	
			POORLY GRADED SAND, fine-grained, tan to brown, very loose, saturated. @ 30 ft bgs fine to medium-grained.		
35	SW/GW		WELL GRADED SAND and GRAVEL, fine to coarse-grained sand, fine to coarse-grained, angular to subrounded gravel, saturated. @ 35-35.6 ft bgs black coating on gravels.	100	
					
40	GC		CLAYEY GRAVEL with sand, fine to medium-grained sand with fine-grained subangular to rounded gravel. WELL GRADED GRAVEL, angular to rounded (<3.25" dia), very loose, saturated.	50	
			@ 40 ft bgs with coarse-grained, angular to subrounded sand. @ 42 ft bgs coarse-grained subangular to subrounded sand.		
45	GW			63	
					
50	SW/GW		WELL GRADED SAND and GRAVEL, angular to subrounded, orange, very loose, saturated. WELL GRADED GRAVEL, subangular to rounded (<3" dia), light brown to orangish brown, very loose, saturated.	50	
					
55	SW/GW		WELL GRADED SAND and GRAVEL, angular to subrounded sand, subangular to subrounded gravel (<2" dia), very loose, saturated.	100	
			POORLY GRADED GRAVEL, subangular to subrounded (<1" dia), very loose, saturated.		
	GP				
	CH				
	SW/GW		FAT SANDY CLAY, tan to brownish tan with fine to		

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

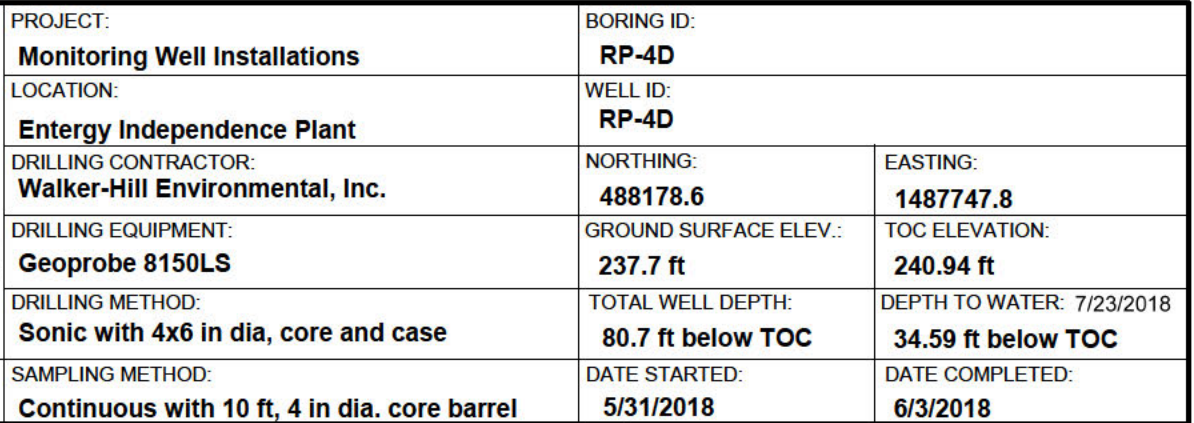


NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).



FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: RP-5	
LOCATION: Entergy Independence Plant	WELL ID: RP-5	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 488032.2	EASTING: 1488225.5
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 238.9 ft	TOC ELEVATION: 241.97 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 46.4 ft below TOC	DEPTH TO WATER: 7/23/2018 35.68 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/24/2018	DATE COMPLETED: 6/3/2018

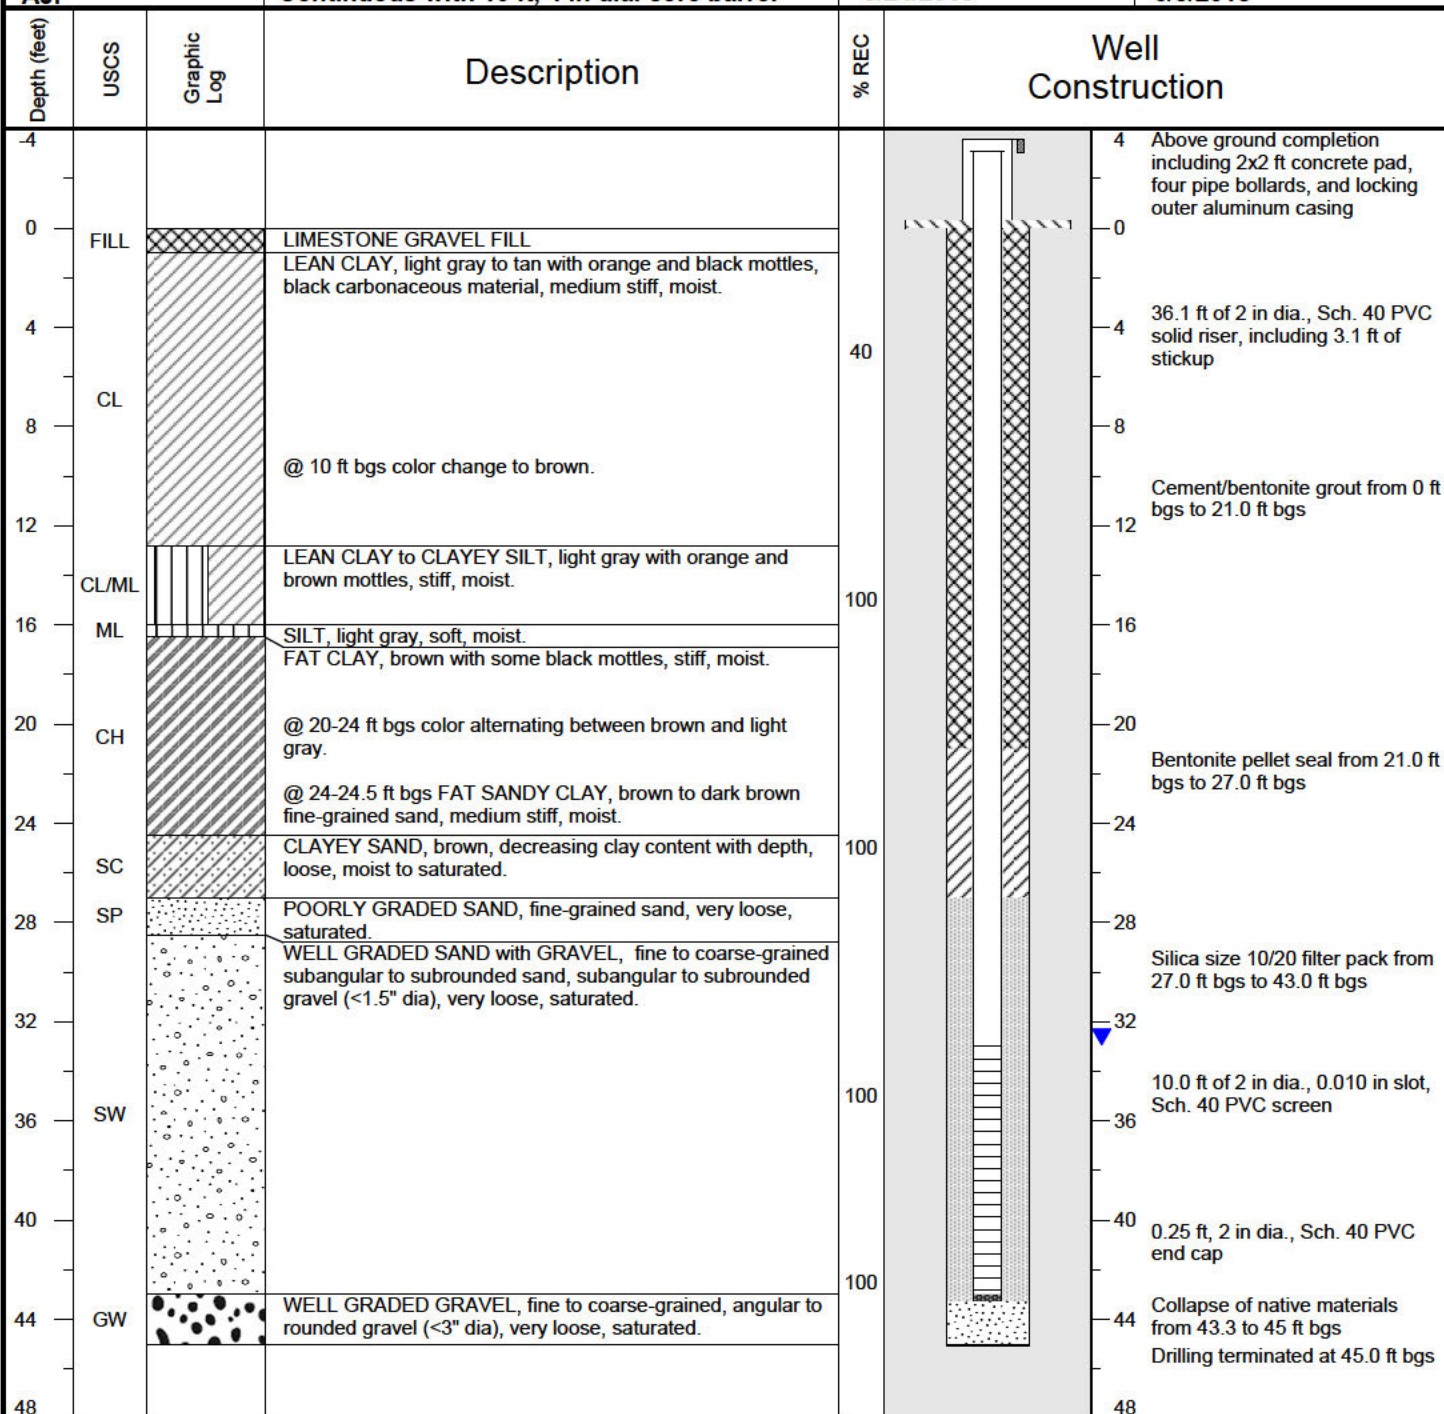

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).



FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: RP-6	
LOCATION: Entergy Independence Plant	WELL ID: RP-6	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487610.0	EASTING: 1488476.2
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 238.0 ft	TOC ELEVATION: 241.27 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 49.5 ft below TOC	DEPTH TO WATER: 7/23/2018 34.90 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/23/2018	DATE COMPLETED: 6/2/2018

Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-4					4 Above ground completion including 2x2 ft concrete pad, four pipe bollards, and locking outer aluminum casing
0	CL		TOP SOIL		
	CL		LEAN CLAY, silty, light brown to tan, very stiff, moist to dry.	100	
	ML		SILT, tan, medium stiff, moist to dry.		
4	CH		FAT CLAY, orange and brown mottles with black carbonaceous material, stiff, moist.		4 39.2 ft of 2 in dia., Sch. 40 PVC solid riser, including 3.3 ft of stickup
			LEAN CLAY, silty, yellowish orange to gray with brown and orange mottles, stiff, moist to dry.	100	
8	CL		@ 7.5 ft bgs color change to brown with black carbonaceous deposits.		
	CH		FAT CLAY, brown, stiff, moist.		
12			SILT, tan, soft, moist.		
16	ML			30	16 Cement/bentonite grout from 0 ft bgs to 29.0 ft bgs
20					
24	CH		FAT CLAY, tan with brown and orange mottles, stiff, moist. @ 24-25 ft bgs thin white silt lenses.	100	
	CL		LEAN CLAY, tan with silt content increasing with depth, soft, moist.		
28			@ 27-27.1 silt, tan with orange staining, soft.	100	
	CH		FAT CLAY, light gray to tan, very soft, wet.		
32			@ 30 ft bgs color change to dark gray.		32 Bentonite pellet seal from 29.0 ft bgs to 33.0 ft bgs
	SW		WELL GRADED SAND with GRAVEL, fine to coarse-grained sand; fine to coarse-grained, subangular to subrounded gravel, very loose, saturated.	100	
36	SP		@ 34.6-24.8 ft bgs clayey, light gray.		
			POORLY GRADED SAND, fine to medium-grained, very loose, saturated.	100	36 Silica size 10/20 filter pack from 33.0 ft bgs to 50.0 ft bgs
40	SW		WELL GRADED SAND with GRAVEL, angular to subrounded gravel (<1" dia), very loose, saturated.		
	SC		CLAYEY SAND, with black well rounded gravel, soft, wet.	100	40 10.0 ft of 2 in dia., 0.010 in slot, Sch. 40 PVC screen
	SW		WELL GRADED SAND with GRAVEL, angular to subrounded gravel (<1" dia), very loose, saturated.		
44	GC		CLAYEY SAND, with black well rounded gravel, soft, wet.	100	
	GW		WELL GRADED SAND with GRAVEL, angular to subrounded gravel (<1" dia), very loose, saturated.		
	SW		CLAYEY GRAVEL with sand, fine to coarse-grained, subangular to round sand; fine-grained, subangular to rounded gravel, dark gray.	100	44 0.25 ft, 2 in dia., Sch. 40 PVC end cap
48	GW		WELL GRADED GRAVEL with sand, fine-grained, subangular to rounded gravel, very loose, saturated.		
			WELL GRADED SAND, fine to coarse-grained, saturated.	100	48 Collapse of native material from 46.2 to 50 ft bgs
			WELL GRADED GRAVEL, fine to coarse-grained gravel with some small cobbles, very loose, saturated.		
52					52 Drilling terminated at 50 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).



FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: RP-7	
LOCATION: Entergy Independence Plant	WELL ID: RP-7	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487319.3	EASTING: 1488382.9
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.6 ft	TOC ELEVATION: 241.04 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 52.9 ft below TOC	DEPTH TO WATER: 7/23/2018 34.60 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/24/2018	DATE COMPLETED: 6/3/2018

Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-4					4 Above ground completion including 2x2 ft concrete pad, four pipe bollards, and locking outer aluminum casing
0	CL		LEAN CLAY, brown to tan, medium stiff to stiff, moist. @ .5-.7 ft bgs subrounded to rounded gravel.	100	0
4	ML CL		SILT with clayey fine-grained sand, light gray, rootlets, medium stiff, moist.		4 42.6 ft of 2 in dia., Sch. 40 PVC solid riser, including 3.4 ft of stickup
8	CH		LEAN CLAY, olive gray to light gray with heavy oxidation and carbonaceous material along silty fractures, stiff to medium stiff.	100	8
12	CL		FAT CLAY, tan to yellowish orange with some orange mottles, stiff, moist.		12
16	ML		LEAN CLAY, tan with orange and brown mottles along with black carbonaceous material, medium stiff, moist.	100	16 Cement/bentonite grout from 0 ft bgs to 25.0 ft bgs
20	CH		FAT CLAY, tan stiff, moist.	100	20
24			@ 21.8-22 ft bgs with silt lenses and brown and orange mottles.	100	24
28	ML		CLAYEY SILT to SILT, light gray to tan alternating layers of clayey silt and silt, very soft, wet.	100	28 Bentonite pellet seal from 25.0 ft bgs to 31.0 ft bgs
32	CL CH		LEAN CLAY, olive gray, medium stiff, moist. FAT CLAY, dark gray, very soft, wet.		32 Silica size 10/20 filter pack from 31.0 ft bgs to 50.0 ft bgs
36	SW		WELL GRADED SAND with GRAVEL, fine to coarse-grained, subangular to subrounded sand; fine to coarse-grained, angular to subrounded gravel, saturated.	100	36
40	CL SC		LEAN CLAY with sand, grayish brown with sand content increases with depth, soft to very soft, saturated. @ 37.9-38 ft bgs with black gravel.		40 10.0 ft of 2 in dia., 0.010 in slot, Sch. 40 PVC screen
44	GW		CLAYEY SAND with gravel, fine to coarse-grained gravel, decreasing clay with depth, loose to medium dense sand, saturated.		44
48	SW		WELL GRADED GRAVEL, fine to coarse-grained, subangular to subrounded (<2.5" dia), very loose, saturated.	70	48 0.25 ft, 2 in dia., Sch. 40 PVC end cap Collapse of native materials from 43.3 to 45 ft bgs
52					52 Drilling terminated at 50.0 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).





















FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: RP-8	
LOCATION: Entergy Independence Plant	WELL ID: RP-8	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487126.0	EASTING: 1488140.5
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.4 ft	TOC ELEVATION: 240.43 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 45.0 ft below TOC	DEPTH TO WATER: 7/23/2018 33.95 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/20/2018	DATE COMPLETED: 6/3/2018







Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-4					4 Above ground completion including 2x2 ft concrete pad, four pipe bollards, and locking outer aluminum casing
0			FAT CLAY, brown, medium stiff, moist.		0
4	CH			70	4 34.8 ft of 2 in dia., Sch. 40 PVC solid riser, including 3.0 ft of stickup
8					8
12			LEAN CLAY, silty, brown with some light grey, yellow, and orange mottles, soft to medium stiff, moist.	70	12 Cement/bentonite grout from 0 ft bgs to 17.0 ft bgs
16	CL				16
20			FAT CLAY, brown with some dark brown staining, stiff, moist.		20 Bentonite pellet seal from 17.0 ft bgs to 20 ft bgs
24	CH				24
28	ML		CLAYEY SILT, dark gray.	80	24 Collapse of native material from 20 to 26 ft bgs
32	SC		CLAYEY SAND, fine to medium-grained, soft to loose, moist.		32
36	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<1" dia), loose.		28 Silica size 10/20 filter pack from 26.0 ft bgs to 42.0 ft bgs
40	SP		POORLY GRADED SAND, fine-grained, yellowish orange, loose, saturated.		32
44	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<1" dia), loose.	100	36 10.0 ft of 2 in dia., 0.010 in slot, Sch. 40 PVC screen
	SW		POORLY GRADED SAND, fine-grained, yellowish orange, loose, saturated.		40
	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<3" dia), loose.		44
	SW/GW		WELL GRADED SAND and GRAVEL, yellowish orange, subangular to subrounded gravel (<1" dia), saturated.	0	0.2 ft, 2 in dia., Sch. 40 PVC end cap
					Drilling terminated at 42 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

			PROJECT:	BORING ID:	
			Monitoring Well Installations	RP-8D	
			LOCATION:	WELL ID:	
			Entergy Independence Plant	RP-8D	
			DRILLING CONTRACTOR:	NORTHING:	EASTING:
			Walker-Hill Environmental, Inc.	487119.5	1488159.9
			DRILLING EQUIPMENT:	GROUND SURFACE ELEV.:	TOC ELEVATION:
			Geoprobe 8150LS	237.4 ft	240.41 ft
			DRILLING METHOD:	TOTAL WELL DEPTH:	DEPTH TO WATER: 7/23/2018
			Sonic with 4x6 in dia, core and case	78.2 ft below TOC	33.90 ft below TOC
LOGGED BY:			SAMPLING METHOD:	DATE STARTED:	DATE COMPLETED:
DLD			Continuous with 10 ft, 4 in dia. core barrel	5/19/2018	6/3/2018
Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-5					5
0			FAT CLAY, brown, medium stiff, moist.		0
5	CH			40	5
10					10
15	CL		LEAN CLAY, silty, brown with some light grey, yellow, and orange mottles, soft to medium stiff, moist.	60	15
20			FAT CLAY, brown with some dark brown staining, stiff, moist.		20
25	CH			80	25
	SC		CLAYEY SAND, fine to medium-grained, soft to loose, moist.		
NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).					

			PROJECT: Monitoring Well Installations	BORING ID: RP-8D		
			LOCATION: Entergy Independence Plant	WELL ID: RP-8D		
			DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487119.5	EASTING: 1488159.9	
			DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.4 ft	TOC ELEVATION: 240.41 ft	
			DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 78.2 ft below TOC	DEPTH TO WATER: 7/23/2018 33.90 ft below TOC	
LOGGED BY: DLD			SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/19/2018	DATE COMPLETED: 6/3/2018	
Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction	
30	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<1" dia), loose.	80		
	SP		POORLY GRADED SAND, fine-grained, yellowish orange, loose, saturated. @ 30-30.6 ft, clayey.			
35	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<1" dia), loose.			
	SP		POORLY GRADED SAND, fine-grained, yellowish orange, loose, saturated. @ 30-30.6 ft, clayey.			
	SW		WELL GRADED SAND, fine to coarse-grained, yellowish orange, with fine-grained, subangular to subrounded gravel (<3" dia), loose.	60		
40	SW/GW		WELL GRADED SAND and GRAVEL, subangular to subrounded gravel (<1" dia), yellowish orange, saturated.			
45	GW		WELL GRADED GRAVEL with sand, medium to coarse-grained, subangular to subrounded gravel (<3" dia), yellowish orange; coarse-grained sand, loose, saturated.			
50	SW/GW		WELL GRADED SAND and GRAVEL, subangular to subrounded gravel (<1" dia), yellowish orange, saturated.			
	GW		WELL GRADED GRAVEL with sand, medium to coarse-grained, subangular to subrounded gravel (<3.5" dia), yellowish orange; coarse-grained sand, loose, saturated.	100		
55			POORLY GRADED SAND with GRAVEL, medium-grained, medium dense, yellowish orange. Gravel is subangular to subrounded, increasing gravel content with depth. Saturated.			

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

			PROJECT: Monitoring Well Installations	BORING ID: RP-8D	
			LOCATION: Entergy Independence Plant	WELL ID: RP-8D	
			DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487119.5	EASTING: 1488159.9
			DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.4 ft	TOC ELEVATION: 240.41 ft
			DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 78.2 ft below TOC	DEPTH TO WATER: 7/23/2018 33.90 ft below TOC
LOGGED BY: DLD			SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/19/2018	DATE COMPLETED: 6/3/2018
Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
60	SP		@ 60-62 ft bgs with gravel.	100	 <p>Silica size 10/20 filter pack from 61.5 ft bgs to 75.0 ft bgs</p> <p>10.0 ft of 2 in dia., 0.010 in slot, Sch. 40 PVC screen</p> <p>0.2 ft, 2 in dia., Sch. 40 PVC end cap</p> <p>Drilling terminated due to refusal at 75 ft bgs</p>
65					
70	GW		WELL GRADED GRAVEL with SAND, gravel (<3.5" dia), yellowish orange, saturated.		
70	SW		WELL GRADED SAND and GRAVEL, fine to coarse-grained; fine-grained, subangular to angular gravel (<1" dia), yellowish orange, saturated.		
75	GW		WELL GRADED GRAVEL with SAND, angular to rounded, yellowish orange; coarse-grained sand, saturated.	100	
75			@ 74.5-75 ft bgs greenish-gray silt, no odor.		
80					
85					
90					

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).



FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: RP-9	
LOCATION: Entergy Independence Plant	WELL ID: RP-9	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487691.6	EASTING: 1487348.7
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 235 ft	TOC ELEVATION: 238.14 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 53.5 ft below TOC	DEPTH TO WATER: 7/23/2018 31.55 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/21/2018	DATE COMPLETED: 6/3/2018

Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
-4					4 Above ground completion including 2x2 ft concrete pad, four pipe bollards, and locking outer aluminum casing
0	CL		TOP SOIL		
	CL		LEAN CLAY, brown, stiff, moist to dry.	72	
4	ML		SILT, light gray with small amounts of orangish yellow staining, medium stiff, dry.		4 43.2 ft of 2 in dia., Sch. 40 PVC solid riser, including 3.1 ft of stickup
	CL		LEAN CLAY, light gray with some orange staining, rootlets, very stiff, dry.	80	
8	CH		@ 5 ft bgs color change to dark brown, soft, moist, increasing clay content with depth.		
	CH		FAT CLAY, dark brown with round black carbonaceous deposits, stiff, moist.		
12	CL		LEAN CLAY, dark brown with black round carbonaceous deposits, increasing silt content with depth, medium stiff, moist.		12 Cement/bentonite grout from 0 ft bgs to 25.5 ft bgs
16	ML		SILT, brownish gray with some oxide staining, very soft, moist.	50	
	CH		FAT CLAY, brown to tan with brown and orange mottles, stiff, moist.		
20			LEAN CLAY to CLAYEY SILT, brown with light gray silt lenses within, very soft, moist.		
24	CL/ML			70	
	CH		FAT CLAY, light gray with orange and dark brown mottles, some silt, medium stiff to stiff, moist.		24 Bentonite pellet seal from 25.5 ft bgs to 29.0 ft bgs
28	SM		SILTY SAND, brown to tan, fine to medium-grained, very loose, saturated.		28
	SW/GW		WELL GRADED SAND with GRAVEL, fine to coarse-grained, fine to medium rounded gravel (<1" dia), saturated.		
32					
	SP		POORLY GRADED SAND, tan to brownish orange, fine to medium-grained sand, very loose, saturated.	100	
36	SC		CLAYEY SAND, light to dark gray, very soft, saturated. @ 37.5-38.5 ft, contains dark subrounded gravel.		36 Silica size 10/20 filter pack from 29.0 ft bgs to 50.0 ft bgs
	SW		WELL GRADED SAND with gravel, fine to coarse-grained, fine to medium rounded gravel (<1" dia), saturated.		
40			WELL GRADED GRAVEL, with coarse-grained sand, fine to coarse-grained rounded to subround gravel (<2" dia), yellowish orange, very loose, saturated.		40 10.0 ft of 2 in dia., 0.010 in slot, Sch. 40 PVC screen
44	GW			80	
48					48 0.25 ft, 2 in dia., Sch. 40 PVC end cap
52					52 Drilling terminated at 50.0 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).



FTN Project #
R07920-1844-001

PROJECT:
Monitoring Well Installations

LOCATION:
Entergy Independence Plant

DRILLING CONTRACTOR:
Walker-Hill Environmental, Inc.

DRILLING EQUIPMENT:
Geoprobe 8150LS

DRILLING METHOD:
Sonic with 4x6 in dia, core and case

SAMPLING METHOD:
Continuous with 10 ft, 4 in dia. core barrel

BORING ID:
RP-10

WELL ID:
RP-10

NORTHING:
488087.8

EASTING:
1487487.4

GROUND SURFACE ELEV.:
239.6 ft

TOC ELEVATION:
242.99 ft


TOTAL WELL DEPTH:
46.9 ft below TOC

DEPTH TO WATER: 7/23/2018
36.55 ft below TOC






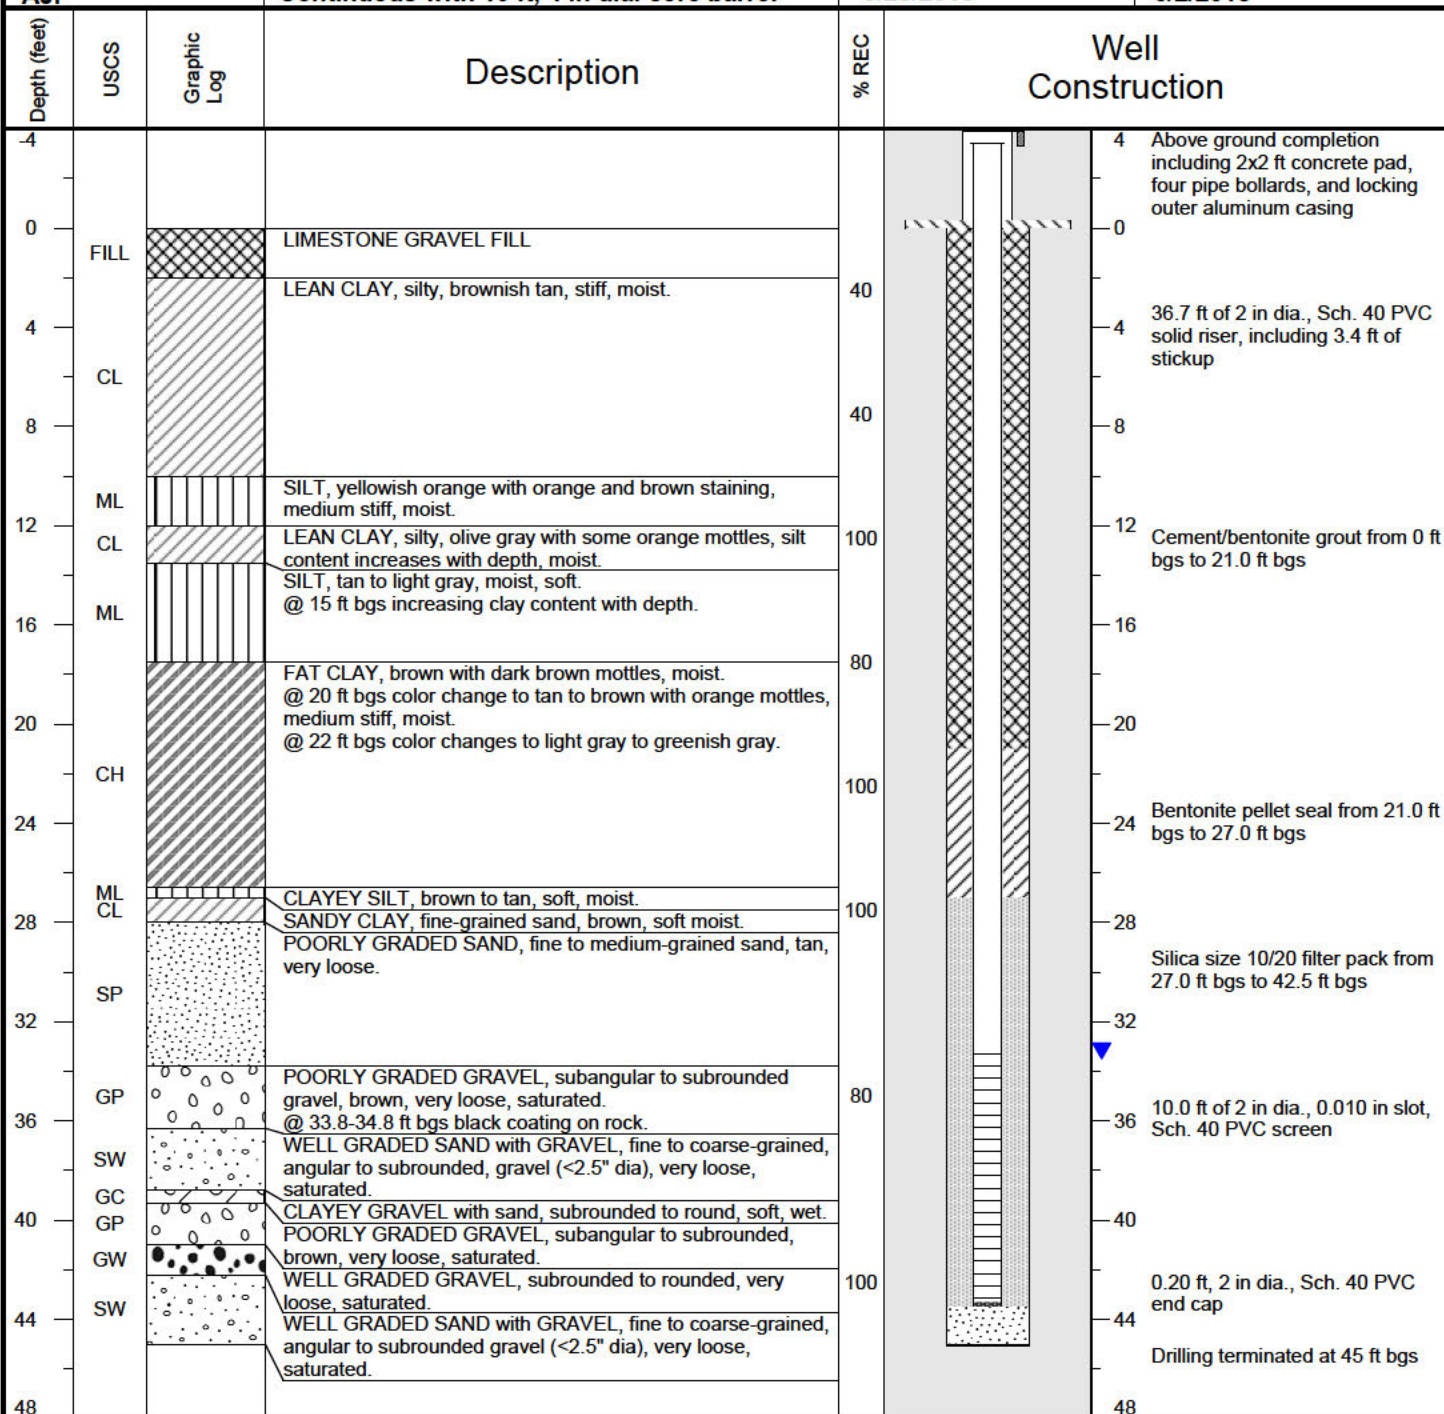


DATE STARTED:
5/23/2018

DATE COMPLETED:
6/2/2018

LOGGED BY:
AJP



NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

 FTN Project # R07920-1844-001				PROJECT: Monitoring Well Installations		BORING ID: B-1	
				LOCATION: Entergy Independence Plant		WELL ID: B-1	
				DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.		NORTHING: 487451.1	EASTING: 1487413.6
				DRILLING EQUIPMENT: Geoprobe 8150LS		GROUND SURFACE ELEV.: 237.3 ft	
				DRILLING METHOD: Sonic with 4x6 in dia, core and case		TOTAL DEPTH: 30.0 ft bgs	DEPTH TO WATER: N/A
LOGGED BY: DLD				SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel		DATE STARTED: 5/18/2018	DATE COMPLETED: 5/18/2018
Depth (feet)	% REC	USCS	Graphic Log	Description			
0		FILL		FILL			
100		CL		LEAN CLAY, dark brown, stiff, moist to dry.			
100				@ 5-10 ft bgs with fine-grain sand and silt.			
5							
60		ML		CLAYEY SILT, trace fine-grained sand, light brown to greyish brown, moist			
10							
100							
		CL		LEAN CLAY, silty, light gray with brown and orange mottles, black carbonaceous deposits, medium stiff, moist.			
		ML		SILT, light gray to yellowish orange, very soft, moist.			
15							
100							
		CH		FAT CLAY, light gray and yellowish orange with black carbonaceous deposits, stiff, moist.			
20		CL		LEAN CLAY, very silty, light gray with yellow and orange mottles, soft, moist.			
100				@ 26 ft bgs color changes to medium gray.			
25							
100				Drilling terminated at 30 ft bgs.			
30							
NOTES: Northings and eastings recorded using a Garmin eTrex30 and converted to AR State Plane NAD83 North. Borehole backfilled with bentonite grout to ground surface.							

FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: B-2	
LOCATION: Entergy Independence Plant	WELL ID: B-2	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487904.5	EASTING: 1487521.7
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 237.3 ft	
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL DEPTH: 10.0 ft bgs	DEPTH TO WATER: N/A
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/18/2018	DATE COMPLETED: 5/18/2018

Depth (feet)	% REC	USCS	Graphic Log	Description
0		CL		TOP SOIL, brown, roots, moist to dry.
		CL		LEAN CLAY, silty, brown with some dry sand like intervals that might be ash, stiff, moist.
20		CL		
5				
		CH		FAT CLAY, brown with yellowish orange mottles, some black carbonaceous deposits, medium stiff to stiff, moist.
100				
100				
10				Drilling terminated at 10 ft bgs.

NOTES:

Northings and eastings recorded using a Garmin eTrex30 and converted to AR State Plane NAD83 North.
Borehole backfilled with bentonite grout to ground surface.

FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: B-3	
LOCATION: Entergy Independence Plant	WELL ID: B-3	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 488077.9	EASTING: 1487971.8
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 239.0 ft	
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL DEPTH: 12.0 ft bgs	DEPTH TO WATER: N/A
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/22/2018	DATE COMPLETED: 5/22/2018

Depth (feet)	% REC	USCS	Graphic Log	Description
0				FILL, CCR material
100		FILL		
5		FILL		FILL, gravel
50				LEAN CLAY, brown and orange with large round black carbonaceous deposits, medium stiff, moist.
10		CL		
100				Boring terminated at 12 ft bgs.

NOTES:

Northings and eastings recorded using a Garmin eTrex30 and converted to AR State Plane NAD83 North.
Borehole backfilled with bentonite grout to ground surface.


FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: B-4	
LOCATION: Entergy Independence Plant	WELL ID: B-4	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487863.7	EASTING: 1488421.3
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 207.5 ft	
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL DEPTH: 22.0 ft bgs	DEPTH TO WATER: N/A
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/22/2018	DATE COMPLETED: 5/22/2018

Depth (feet)	% REC	USCS	Graphic Log	Description
0				FILL
100		FILL		
5				LEAN CLAY, brown and green with orange mottles, brown carbonaceous deposits, medium stiff, moist.
100		CL		
10		ML		CLAYEY SILT, light gray with fine concretions, medium stiff, moist.
100		CH		FAT CLAY, brown to tan with orange and brown mottles and black carbonaceous deposits, stiff, moist.
15		ML		SILT, brownish tan with black and brown staining, stiff, moist to dry.
40		CL		LEAN CLAY, silty, orange and brown staining, moist.
100				Boring terminated at 22 ft bgs.

NOTES:

Northings and eastings recorded using a Garmin eTrex30 and converted to AR State Plane NAD83 North.
Borehole backfilled with bentonite grout to ground surface.

 FTN Project # R07920-1844-001	PROJECT: Monitoring Well Installations		BORING ID: B-5		
	LOCATION: Entergy Independence Plant		WELL ID: B-5		
	DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.		NORTHING: 487249.2	EASTING: 1488040.3	
	DRILLING EQUIPMENT: Geoprobe 8150LS		GROUND SURFACE ELEV.: 238.3 ft		
	DRILLING METHOD: Sonic with 4x6 in dia, core and case		TOTAL DEPTH: 10.0 ft bgs	DEPTH TO WATER: N/A	
LOGGED BY: DLD		SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel		DATE STARTED: 5/18/2018	DATE COMPLETED: 5/19/2018

Depth (feet)	% REC	USCS	Graphic Log	Description
0		CL		TOP SOIL
100				LEAN CLAY, silty, light brown, stiff, dry to moist.
				@ 2 ft bgs color changes to light gray with yellow and orange mottles.
100				
5		CL		
60				
10				Boring terminated at 10 ft bgs.

NOTES:
Northings and eastings recorded using a Garmin eTrex30 and converted to AR State Plane NAD83 North.
Borehole backfilled with bentonite grout to ground surface.



FTN Project #
R07920-1844-001

PROJECT: Monitoring Well Installations	BORING ID: B-6	
LOCATION: Entergy Independence Plant	WELL ID: PZ-1	
DRILLING CONTRACTOR: Walker-Hill Environmental, Inc.	NORTHING: 487518.1	EASTING: 1487843.0
DRILLING EQUIPMENT: Geoprobe 8150LS	GROUND SURFACE ELEV.: 238.3 ft	TOC ELEVATION: 241.41 ft
DRILLING METHOD: Sonic with 4x6 in dia, core and case	TOTAL WELL DEPTH: 52.9 ft below TOC	DEPTH TO WATER: 7/23/2018 34.92 ft below TOC
SAMPLING METHOD: Continuous with 10 ft, 4 in dia. core barrel	DATE STARTED: 5/20/2018	DATE COMPLETED: 5/20/2018

Depth (feet)	USCS	Graphic Log	Description	% REC	Well Construction
4					4
0	CL		LEAN CLAY, silty, brown, very stiff, dry.	100	0
4	CH		FAT CLAY, light gray with brown bottles, very stiff, dry to moist.	100	4 42.6 ft of 1 in dia., Sch. 40 PVC solid riser, including 3.1 ft of stickup
	CL		LEAN CLAY, silty, brown, very stiff, dry.	100	
8	CH		FAT CLAY, light gray with brown mottles, very stiff, dry to moist.	100	8
12	CL		LEAN CLAY, silty, light gray to dark brown with orange oxide staining, medium stiff, moist.	100	12 Cement/bentonite grout from 0 ft bgs to 35.0 ft bgs
16				100	16
20	ML		CLAYEY SILT, brown to yellowish orange, very soft, saturated.	100	20
24	CH		FAT CLAY, gray with brown and yellowish orange mottles, manganese staining and calcite gravels thought, stiff, moist.	100	24
	ML		SILT, clayey, light brown to yellowish orange, very soft, moist.	100	
28	CL		LEAN CLAY, silty, light brown to yellowish orange and some light gray mottles, stiff, to medium stiff, moist.	100	28
32	CH		FAT CLAY, gray, stiff, moist. @ 32-34 ft with orange mottles.	100	32
36	CL		LEAN CLAY, silty, gray, very moist, soft.	100	36 Bentonite pellet seal from 35 ft bgs to 38.0 ft bgs
40			WELL GRADED GRAVEL with SAND, medium to coarse-grained sand, angular to subrounded gravel (<1.5" dia), yellowish orange, wet.	100	40 Silica size 10/20 filter pack from 38 ft bgs to 49.8 ft bgs
44	GW			100	44 10.0 ft of 1 in dia., 0.010 in slot, Sch. 40 PVC screen
48					48 0.25 ft, 1 in dia., Sch. 40 PVC end cap
52					52 Drilling terminated at 50 ft bgs

NOTES: Horizontal and vertical data are based on the Harmon Surveying report dated July 12, 2018 (AR State Plane NAD83 North and NAVD88).

Geotechnical Data

FTN/ENTERGY INDEPENDENCE/AR
SUMMARY OF SOIL DATA

Sample Identification	Sample Type	Sample Depth	Soil Classification	Natural Moisture %	Atterberg Limits				Grain Size Distribution			Compaction		Gs	Unit Weight		Permeability (cm/sec)	Additional Tests Conducted (See Notes)
									% Finer No. 4 Sieve	% Finer No. 200 Sieve	% Finer .005 mm	Maximum Dry Density (lb/cuft)	Optimum Moisture %		Moisture %	Dry (lb/cuft)		
					L.L.	P.L.	P.I.	L.I.										
B-1	UD	3.0-5.0'	SC-SM	10.8	19	13	6	-0.31	96.7	35.5	19.0	-	-	-	-	-	-	-
B-1	UD	10.0-12.0'	ML	31.3	44	29	15	0.16	100.0	98.3	40.2	-	-	-	31.3	89.6	1.2E-08	-
B-1	UD	20.0-22.0'	CH	39.1	68	23	45	0.37	100.0	96.1	57.2	-	-	2.71	39.1	81.6	-	T-CU w/pp
B-1	UD	28.0-30.0'	CH	51.6	50	27	23	1.04	100.0	99.7	50.5	-	-	2.67	51.6	71.4	-	T-CU w/pp
B-2	UD	8.0-10.0'	CH	26.3	55	21	34	0.16	100.0	96.2	39.7	-	-	2.72	26.3	95.3	-	T-CU w/pp
B-3	UD	3.0-5.0'	ML	42.9	NP	NP	NP	NP	100.0	52.8	16.5	-	-	-	-	-	-	-
B-3	UD	10.0-12.0'	CL	30.1	45	20	25	0.41	98.2	97.2	30.9	-	-	-	30.1	91.4	1.1E-06	-
B-4	UD	5.0-7.0'	CL	23.2	35	15	20	0.40	100.0	96.5	45.0	-	-	-	23.2	103.1	4.9E-06	-
B-4	UD	15.0-17.0'	CH	34.1	50	26	24	0.36	100.0	96.1	40.5	-	-	2.67	34.1	86.1	-	C
B-4	UD	20.0-22.0'	CL	27.4	35	20	15	0.51	100.0	91.9	25.0	-	-	-	27.4	94.9	1.1E-06	-
B-5	UD	3.0-5.0'	CL	19.0	38	16	22	0.13	98.6	89.6	34.0	-	-	2.69	19.0	108.7	-	T-CU w/pp
RP-8	UD	8.0-10.0'	CL	24.6	49	24	25	0.04	100.0	95.6	43.1	-	-	-	24.6	98.5	3.4E-08	-
PZ-1	UD	5.0-7.0'	CL	22.8	43	24	19	-0.04	100.0	95.1	51.0	-	-	-	22.8	102.9	3.0E-08	-
PZ-1	UD	10.0-12.0'	CL	30.9	46	19	27	0.45	100.0	97.1	42.0	-	-	2.72	30.9	91.1	-	T-CU w/pp
PZ-1	UD	15.0-17.0'	CL	28.9	38	17	21	0.56	100.0	97.0	35.0	-	-	2.78	28.9	95.2	-	T-CU w/pp

ABBREVIATIONS: LIQUID LIMIT (LL)
PLASTIC LIMIT (PL)
PLASTICITY INDEX (PI)
LIQUIDITY INDEX (LI)
SPECIFIC GRAVITY (Gs)
MOISTURE (Mc)

NOTES: T = TRIAXIAL TEST
U = UNCONFINED COMPRESSION TEST
C = CONSOLIDATION TEST
DS = DIRECT SHEAR TEST
O = ORGANIC CONTENT
P = pH

**FTN/ENTERGY INDEPENDENCE/AR
SUMMARY OF SOIL DATA**

Sample Identification	Sample Type	Sample Depth	Soil Classification	Natural Moisture %	Atterberg Limits				Grain Size Distribution			Compaction		Gs	Unit Weight		Permeability (cm/sec)	Additional Tests Conducted (See Notes)
									% Finer No. 4 Sieve	% Finer No. 200 Sieve	% Finer .005 mm	Maximum Dry Density (lb/cuft)	Optimum Moisture %		Moisture %	Dry (lb/cuft)		
					L.L.	P.L.	P.I.	L.I.										
PZ-1	Bag	45.0-47.0'	GW	7.6	NP	NP	NP	NP	31.3	1.3	1.1	-	-	-	-	-	-	-
RP-6	Bag	30.0-33.0'	CH	46.5	67	30	37	0.45	100.0	97.5	65.0	-	-	-	-	-	-	-
RP-7	Bag	36.0-38.0'	CL	23.2	29	15	14	0.56	96.9	80.0	31.0	-	-	-	-	-	-	-
RP-8D	Bag	27.0-30.0'	SP-SM	10.2	NP	NP	NP	NP	59.8	11.0	3.5	-	-	-	-	-	-	-
RP-8D	Bag	42.0-50.0'	GW	3.9	NP	NP	NP	NP	23.6	0.6	0.4	-	-	-	-	-	-	-
RP-8D	Bag	68.0-70.0'	GW	7.2	-	-	-	-	15.8	2.3	1.5	-	-	-	-	-	-	-
RP-9	Bag	24.0-26.0'	CH	37.5	74	33	41	0.10	100.0	98.4	78.0	-	-	-	-	-	-	-
RP-9	Bag	45.0-46.0'	GW	7.8	NP	NP	NP	NP	16.0	1.5	0.8	-	-	-	-	-	-	-
RP-10	Bag	24.0-25.0'	CH	32.9	66	31	35	0.06	100.0	99.2	74.0	-	-	-	-	-	-	-
RP-10	Bag	33.0-35.0'	GP	6.6	NP	NP	NP	NP	18.6	0.6	0.3	-	-	-	-	-	-	-

ABBREVIATIONS: LIQUID LIMIT (LL)
PLASTIC LIMIT (PL)
PLASTICITY INDEX (PI)
LIQUIDITY INDEX (LI)
SPECIFIC GRAVITY (Gs)
MOISTURE (Mc)

NOTES: T = TRIAXIAL TEST
U = UNCONFINED COMPRESSION TEST
C = CONSOLIDATION TEST
DS = DIRECT SHEAR TEST
O = ORGANIC CONTENT
P = pH

Golder Associates Inc.

TABLE 1
FTN/ENERGY INDEPENDENCE/AR
SUMMARY OF SOIL DATA

Sample Type	Sample Identification	Sample Depth (ft.)	USCS Soil Classification	Delivered Moisture (%)	Atterberg Limits			Grain Size Distribution			Specific Gravity	Moisture/Density Relationship		Additional Tests Comments (See Notes)
								% Finer 3/4"	% Finer #4	% Finer #200		Standard Proctor		
					LL	PL	PI					Dry Density (pcf)	Moisture (%)	
B	RP-4D	38-39	GP-GM	--	NP	NP	NP	78	31	5	--	--	--	DS
B	RP-4D	64.5-67.4	SP	--	NP	NP	NP	100	97	4	--	--	--	DS
B	RP-4D	76.2-78	SM	--	NP	NP	NP	100	100	15	--	--	--	DS
B	RP-5	27-28	SP-SM	--	NP	NP	NP	100	79	8	--	--	--	DS
B	RP-8D	53-60	SP-SM	--	NP	NP	NP	98	91	7	--	--	--	DS

NOTES:

LL= LIQUID LIMIT
 PL= PLASTIC LIMIT
 PI= PLASTIC INDEX
 SL= SHRINKAGE LIMIT
 UW= UNIT WEIGHT

T = TRIAXIAL TEST
 U = UNCONFINED COMPRESSION TEST
 C = CONSOLIDATION TEST
 DS = DIRECT SHEAR TEST
 PERM = PERMEABILITY



PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-1

Depth: 3.0-5.0'

TYPE: UD

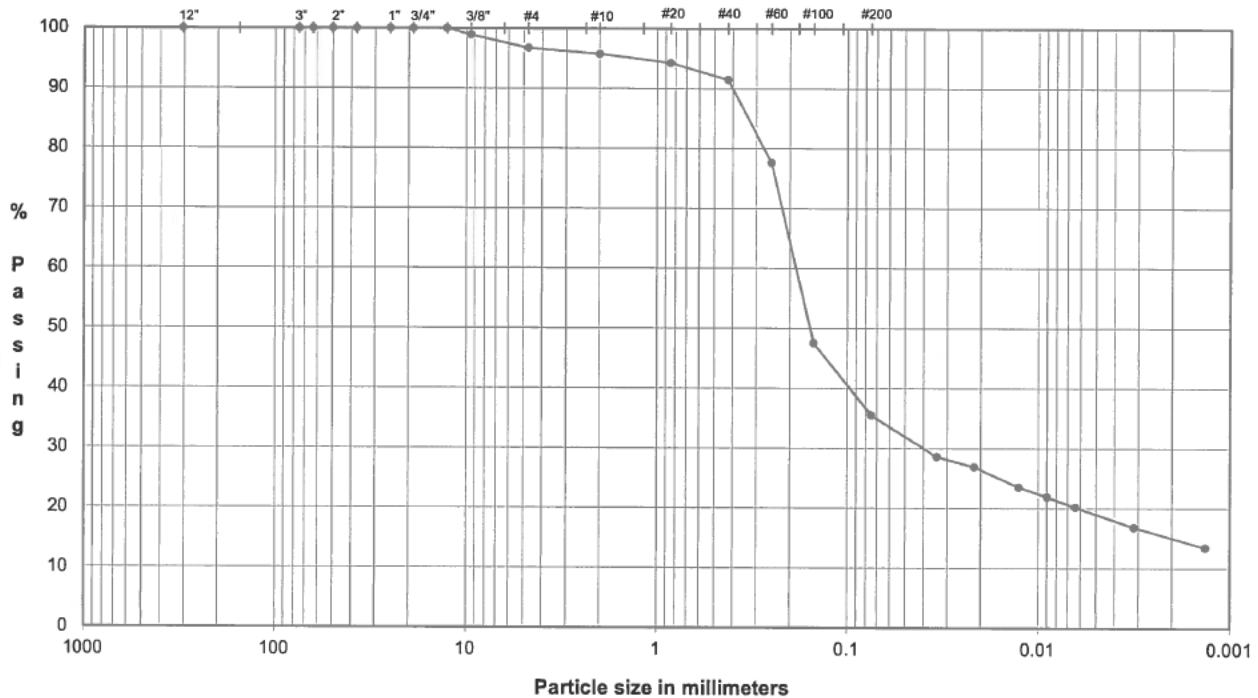

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	98.9	
#4	4.8	96.7	
#10	2.00	95.7	
#20	0.85	94.3	
#40	0.43	91.4	
#60	0.25	77.6	
#100	0.15	47.6	
#200	0.075	35.5	

Hydrometer Analysis

(mm)	% Finer	Classification	Percentage
0.034	28.6		
0.022	26.9		
0.013	23.5		
0.0090	21.9		
0.0064	20.2		
0.0032	16.8		
0.0013	13.5		

DESCRIPTION: SILTY CLAYEY to CLAYEY SILT and SAND, fine to coarse, trace fine gravel; grayish brown.

USCS: SC-SM

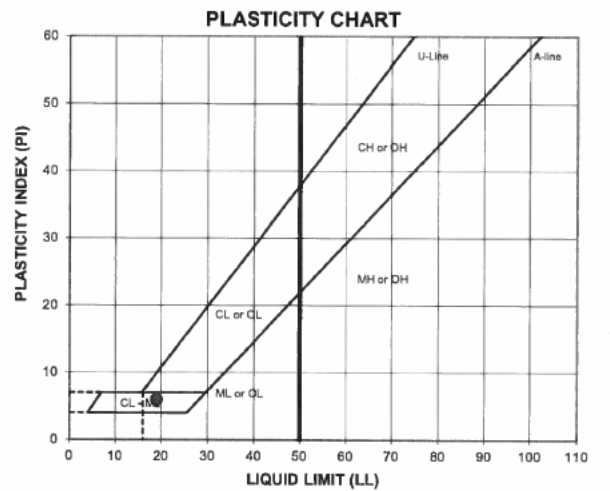ATTERBERG LIMITS
Method -B (Dry preparation)

M _c	LL	PL	PI	LI
10.8	19	13	6	-0.31

LL (oven-dried)
= 0.75 = ORGANIC (LO/OH)

TECH	TJ/HH
DATE	8/9/18
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>
APPROVE	

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-1

Depth: 10.0-12.0'

TYPE: UD

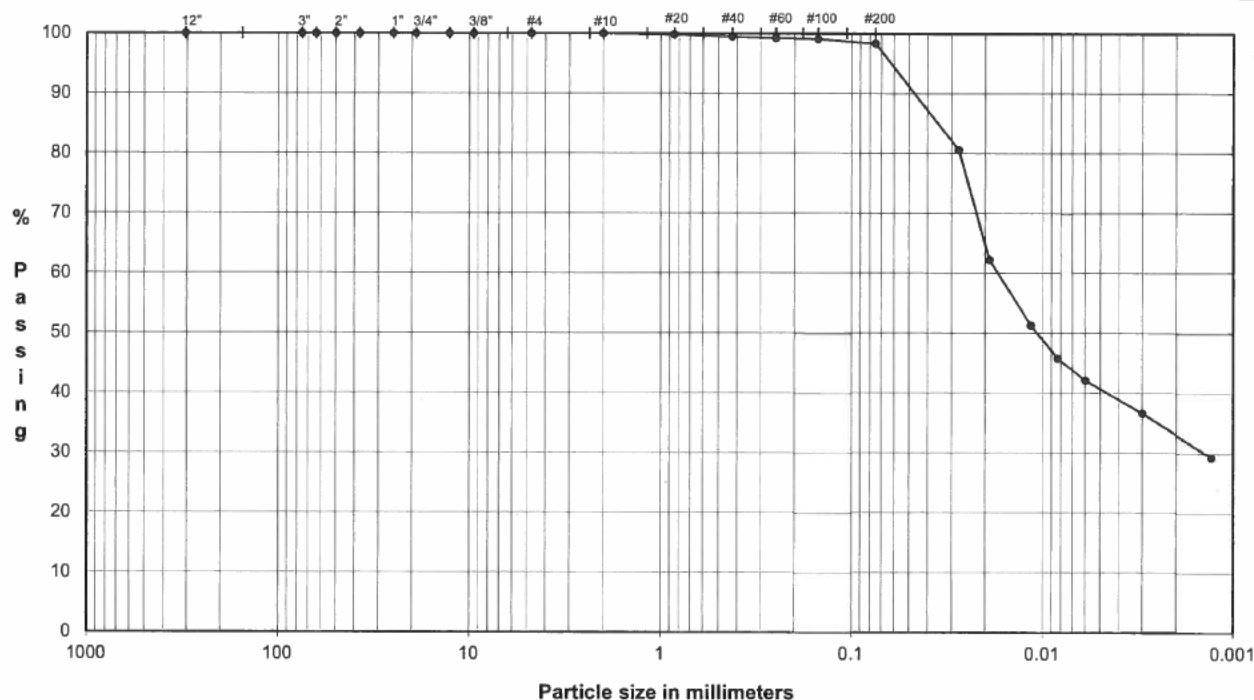

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	100.0	
#20	0.85	99.8	
#40	0.43	99.5	
#60	0.25	99.2	
#100	0.15	99.0	
#200	0.075	98.3	

Hydrometer Analysis

(mm)	% Finer		
0.027	80.6		
0.019	62.3		
0.012	51.3		
0.0083	45.8		
0.0060	42.1		
0.0030	36.6		
0.0013	29.3		

DESCRIPTION: CLAYEY SILT, trace fine to medium sand; light grayish brown and dark brown.

USCS: ML

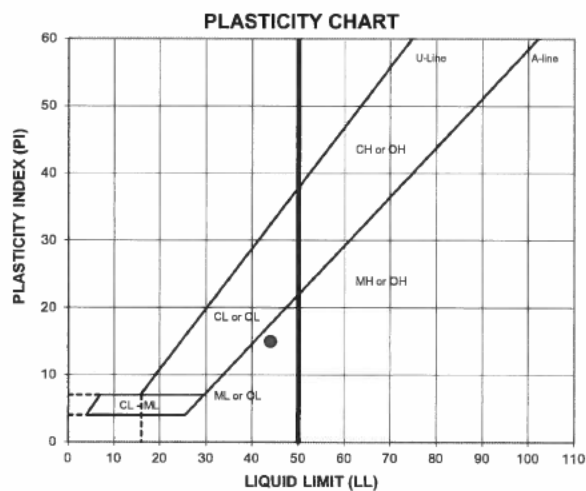

ATTERBERG LIMITS

Method -B (Dry preparation)

ML	LL	PL	PI	LI
31.3	44	29	15	0.16

LL (oven-dried)
 < 0.75 = ORGANIC (OL/OH)

TECH TJ
 DATE 6/6/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE	FTN/ENTERGY INDEPENDENCE/AR	
PROJECT NUMBER	18103172	
SAMPLE ID	B-1	10.0-12.0'
SAMPLE TYPE	UD	

Board #	7
Flow Pump	2
Flow Pump Speed	11
Technician	FT

COMMENTS

Sample Data, Initial

Height, inches	3.000	B-Value, f	1.00
Diameter, inches	2.871	Cell Pres.	88.0
Area, cm ²	41.77	Bot. Pres.	80.0
Volume, cm ³	318.26	Top Pres.	80.0
Mass, g	599.69	Tot. B.P.	80.0
Moisture Content, %	31.28	Head, max.	166.00
Dry Density, pcf	89.56	Head, min.	166.00
Spec. Gravity (assumed)	2.750	Max. Grad.	21.78
Volume Solids, cm ³	166.11	Min. Grad.	21.78
Volume Voids, cm ³	152.15		
Void Ratio	0.92		
Saturation, %	93.9%		

Sample Data, Final

Height, inches	3.001
Diameter, inches	2.873
Area, cm ²	41.82
Volume, cm ³	318.81
Mass, g	611.01
Moisture Content, %	33.76
Dry Density, pcf	89.41
Volume Solids, cm ³	166.11
Volume Voids, cm ³	152.70
Void Ratio	0.92
Saturation, %	100.0%

WATER CONTENTS

Wt Soil & Tare, i	g
Wt Soil & Tare, f	g
Wt Tare	g
Wt Moisture Lost	g
Wt Dry Soil	g
Water Content	%

Sample Initial

599.69
456.79
0.00
142.90
456.79
31.28%

Sample Final

692.85
538.65
81.92
154.20
456.73
33.76%

DESCRIPTION

CLAYEY SILT, trace fine to medium sand; light grayish brown and dark brown.

Flow Pump Rate **1.18E-05** cm³/sec

USCS **ML**

TIME FUNCTIONS, SECONDS								dP	Reading	Head	Gradient	Permeability
DATE	DAY	HOUR	MIN	TEMP	dt	dt,acc	dt	dt,acc				
				(°C)	(min)	(min)	(sec)	(sec)	(psi)	(cm)		(cm/sec)
06/08/18	43259	13	30	21.6	0	0	0	0	2.36	166.00	21.78	1.2E-08
06/08/18	43259	13	35	21.6	5	5	300	300	2.36	166.00	21.78	1.2E-08
06/08/18	43259	13	40	21.6	5	10	300	600	2.36	166.00	21.78	1.2E-08
06/08/18	43259	13	45	21.6	5	15	300	900	2.36	166.00	21.78	1.2E-08 *
06/08/18	43259	13	50	21.6	5	20	300	1200	2.36	166.00	21.78	1.2E-08 *
06/08/18	43259	13	55	21.6	5	25	300	1500	2.36	166.00	21.78	1.2E-08 *
06/08/18	43259	14	0	21.6	5	30	300	1800	2.36	166.00	21.78	1.2E-08 *

*TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** **1.2E-08** cm/sec **

DATE **6/8/18**
 CHECK
 REVIEW
 APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENERGY INDEPENDENCE/AR

SAMPLE ID: B-1

Depth: 20.0-22.0'

TYPE: UD

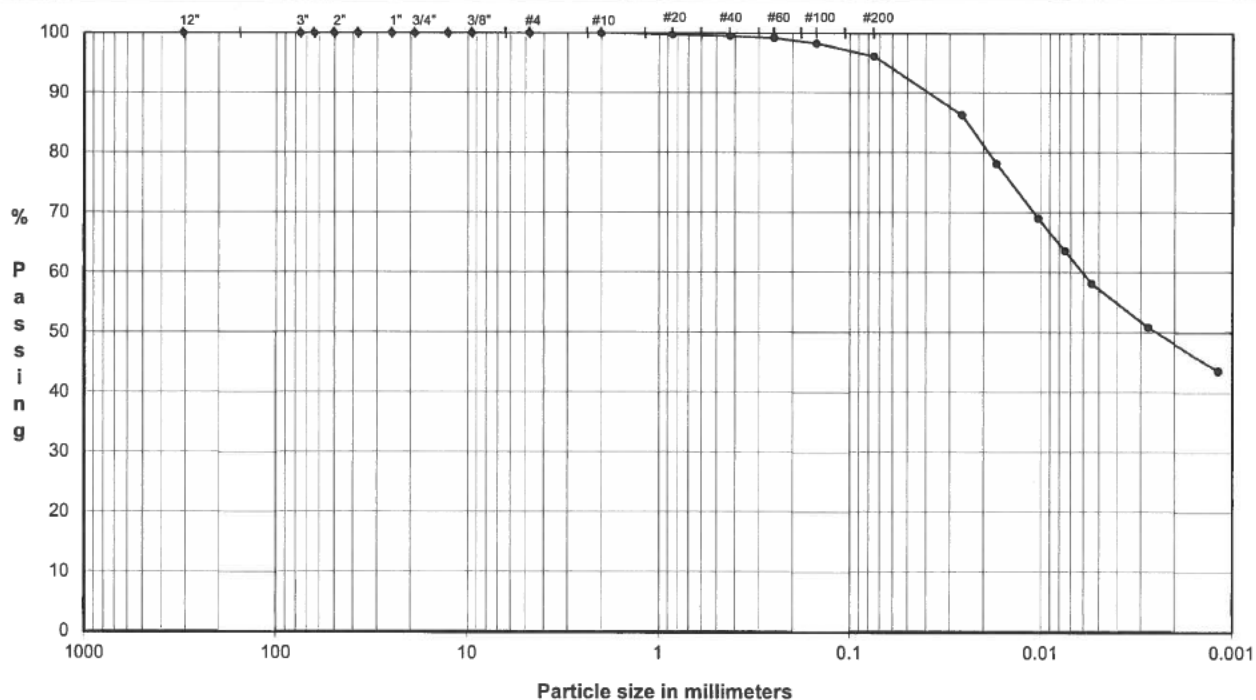

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.9	
#20	0.85	99.7	
#40	0.43	99.4	
#60	0.25	99.2	
#100	0.15	98.2	
#200	0.075	96.1	

Hydrometer Analysis

(mm)	% Finer		
0.026	86.3		
0.017	78.1		
0.010	69.0		
0.0075	63.6		
0.0054	58.1		
0.0027	50.9		
0.0012	43.6		

DESCRIPTION: CLAY; grayish brown.

USCS: CH

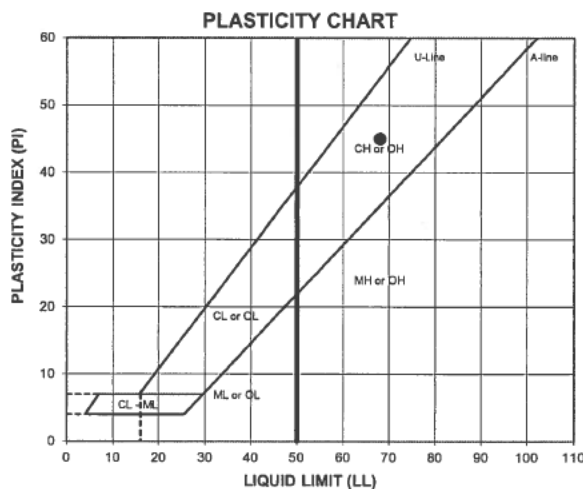ATTERBERG LIMITS
Method -B (Dry preparation)

M _r	LL	PL	PI	LI
39.1	68	23	45	0.37

LL (oven-dried)
0.75 ORGANIC (LO/OH)

TECH HH/PWM
DATE 6/1/18
CHECK *[Signature]*
REVIEW *[Signature]*
APPROVE

Boring or Test Pit: **B-1**
 Sample: **1**
 Depth: **20.0-22.0'** ft
 Point No.: **1**

Initial
 Length = **6.005** in
 Diameter = **2.859** in
 Wet Mass = 2.602 lb
 Area = 6.420 in²
 Volume = 38.551 in³
 Specific Gravity = **2.71** (ASTM D854)
 Dry Mass of Solids = 1.988 lb
 Moisture Content = **30.9%**
 Wet Unit Weight = 116.6 pcf
 Dry Unit Weight = 89.1 pcf
 Void Ratio = 0.90
 Percent Saturation = 93%

After Consolidation
 Length = **5.867** in
 Diameter = 2.799 in
 Area = 6.153 in² (Method B)
 Volume = 36.098 in³
 Moisture Content = **28.6%**
 Wet Unit Weight = 122.4 pcf
 Dry Unit Weight = 95.2 pcf
 Void Ratio = 0.78
 Percent Saturation = 100%

B Parameter = **1.00**
 Shear Rate = 0.002% /min.
 t_{50} = **350.00** min.
 Strain at Failure = 5.1%

Cell Pressure = **68.0** psi
 Back Pressure = **50.0** psi
 Confining Pressure = 18.0 psi

Boring or Test Pit: **B-1**
 Sample: **1**
 Depth: **20.0-22.0'** ft
 Point No.: **2**

Initial
 Length = **6.006** in
 Diameter = **2.865** in
 Wet Mass = 2.538 lb
 Area = 6.447 in²
 Volume = 38.719 in³
 Specific Gravity = **2.71** (ASTM D854)
 Dry Mass of Solids = 1.817 lb
 Moisture Content = **39.7%**
 Wet Unit Weight = 113.3 pcf
 Dry Unit Weight = 81.1 pcf
 Void Ratio = 1.09
 Percent Saturation = 99%

After Consolidation
 Length = **5.898** in
 Diameter = 2.842 in
 Area = 6.344 in² (Method B)
 Volume = 37.412 in³
 Moisture Content = **37.4%**
 Wet Unit Weight = 115.3 pcf
 Dry Unit Weight = 83.9 pcf
 Void Ratio = 1.02
 Percent Saturation = 100%

B Parameter = **0.97**
 Shear Rate = 0.003% /min.
 t_{50} = **155.00** min.
 Strain at Failure = 4.2%

Cell Pressure = **76.0** psi
 Back Pressure = **50.0** psi
 Confining Pressure = 26.0 psi

Boring or Test Pit: **B-1**
 Sample: **1**
 Depth: **20.0-22.0'** ft
 Point No.: **3**

Initial
 Length = **6.009** in
 Diameter = **2.869** in
 Wet Mass = 2.466 lb
 Area = 6.465 in²
 Volume = 38.847 in³
 Specific Gravity = **2.71** (ASTM D854)
 Dry Mass of Solids = 1.680 lb
 Moisture Content = **46.8%**
 Wet Unit Weight = 109.7 pcf
 Dry Unit Weight = 74.7 pcf
 Void Ratio = 1.26
 Percent Saturation = 101%

After Consolidation
 Length = **5.824** in
 Diameter = 2.860 in
 Area = 6.425 in² (Method B)
 Volume = 37.419 in³
 Moisture Content = **43.5%**
 Wet Unit Weight = 111.3 pcf
 Dry Unit Weight = 77.6 pcf
 Void Ratio = 1.18
 Percent Saturation = 100%

B Parameter = **1.00**
 Shear Rate = 0.003% /min.
 t_{50} = **135.00** min.
 Strain at Failure = 2.9%

Cell Pressure = **104.0** psi
 Back Pressure = **50.0** psi
 Confining Pressure = 54.0 psi

Notes: Sample description: **(CH) CLAY; grayish brown.**



Atterberg limits: LL = **68** PL = **23** PI = **45** (ASTM D4318)
 Percent finer: 3/4 in. = **100%** No. 4 = **100%** No. 200 = **96%** (ASTM D422, refer to separate report for gradation curve)
 Specimen type: ☒ Intact ☐ Reconstituted
 Moisture from: ☐ Cuttings ☒ Entire specimen
 Saturation method: ☒ Wet ☐ Dry
 Failure criterion: ☒ $(\sigma'_1/\sigma'_3)_{max}$ ☐ % strain
 Membrane effect: ☒ Corrected ☐ Not Corrected



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:
FTN/ENERGY INDEPENDENCE/AR



Sample:
B-1 20.0-22.0'



Title:
ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SAMPLE AND TEST DATA

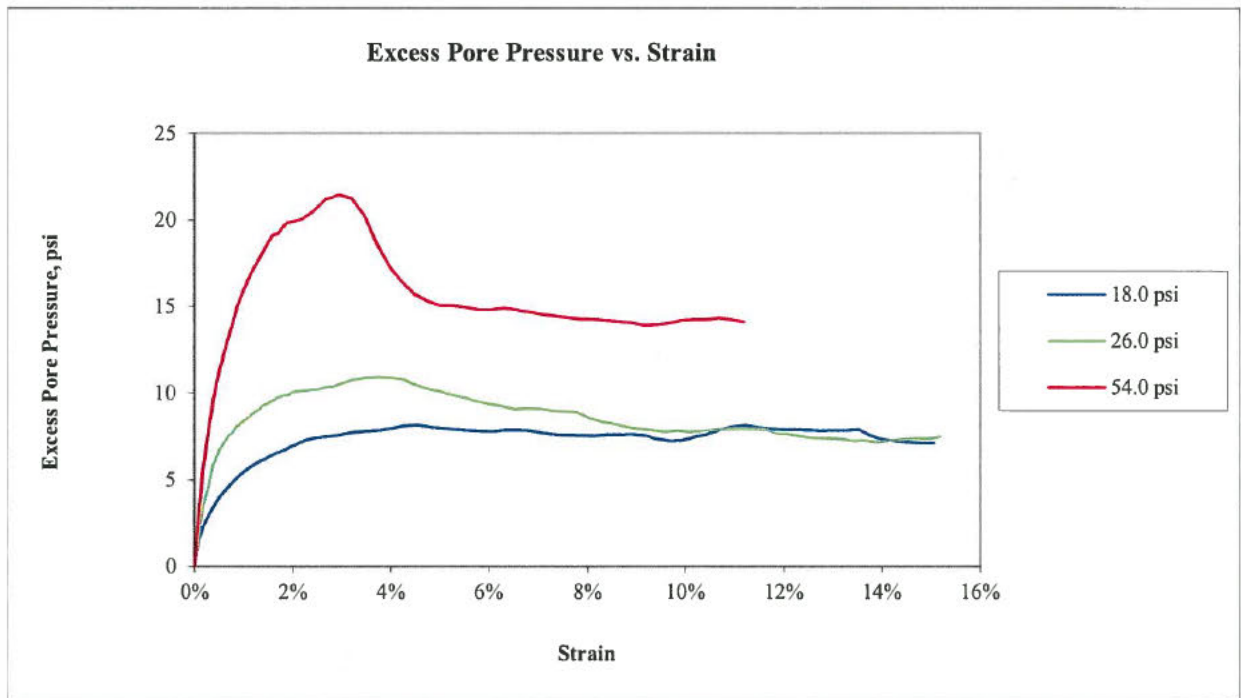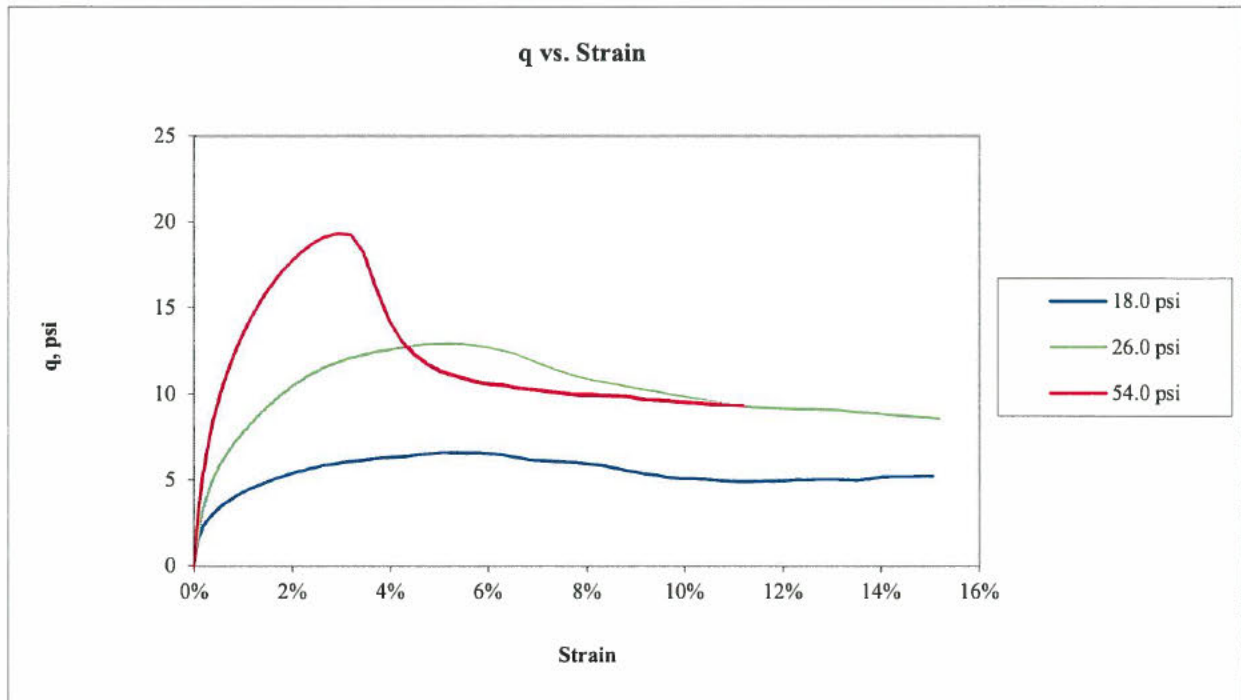Technician: FT/PWM	Reviewed: 	Start Date: 6/5/2018	Job Number: 18103172	Figure: 1
Check: 	Approved:			

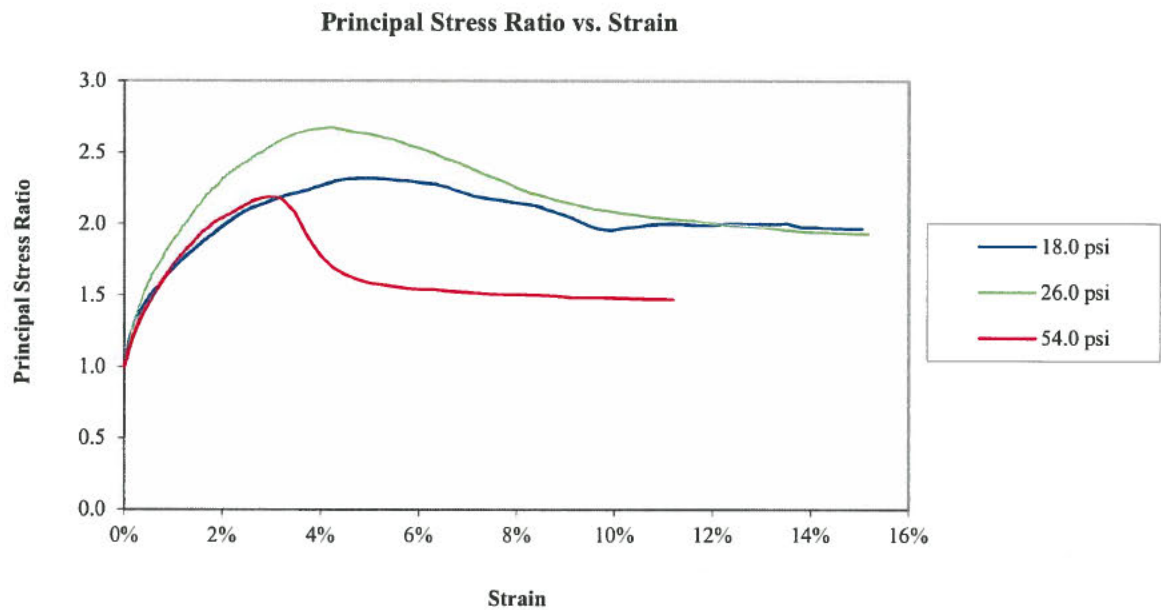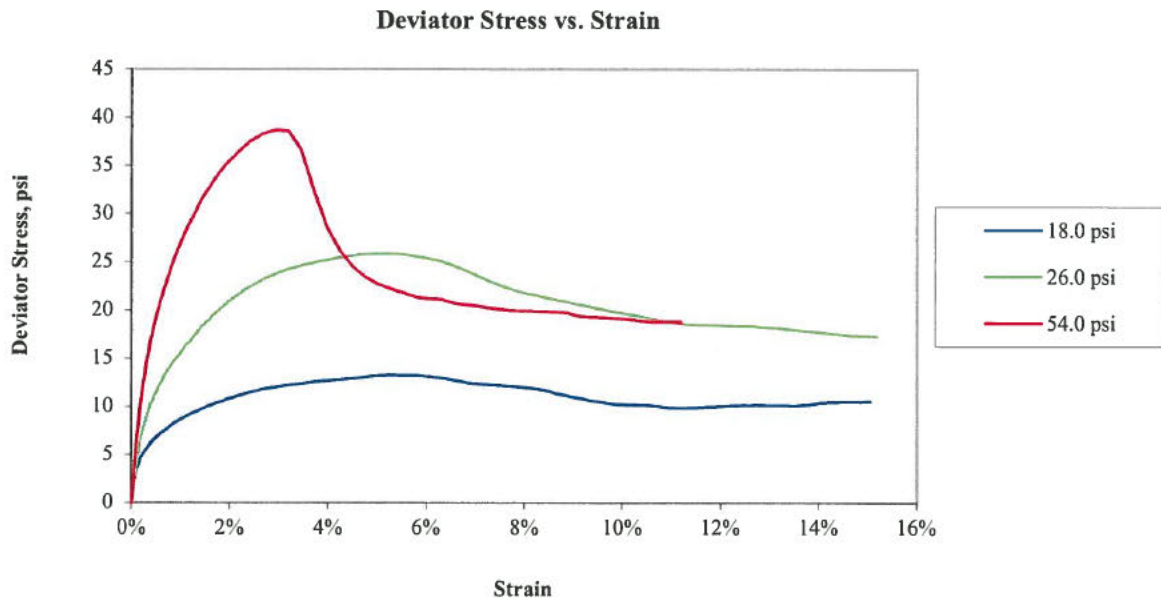


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-1 20.0-22.0'		Technician: FT/PWM Check: <i>FT/PWM</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/5/2018	Job Number: 18103172	Figure: 2



Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT DEVIATOR STRESS AND PRINCIPAL STRESS RATIO PLOT				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-1 20.0-22.0'		Technician: FT/PWM Check: 	Reviewed:  Approved:	Start Date: 6/5/2018	Job Number: 18103172	Figure: 3

Stress Path (p'-q) Plot

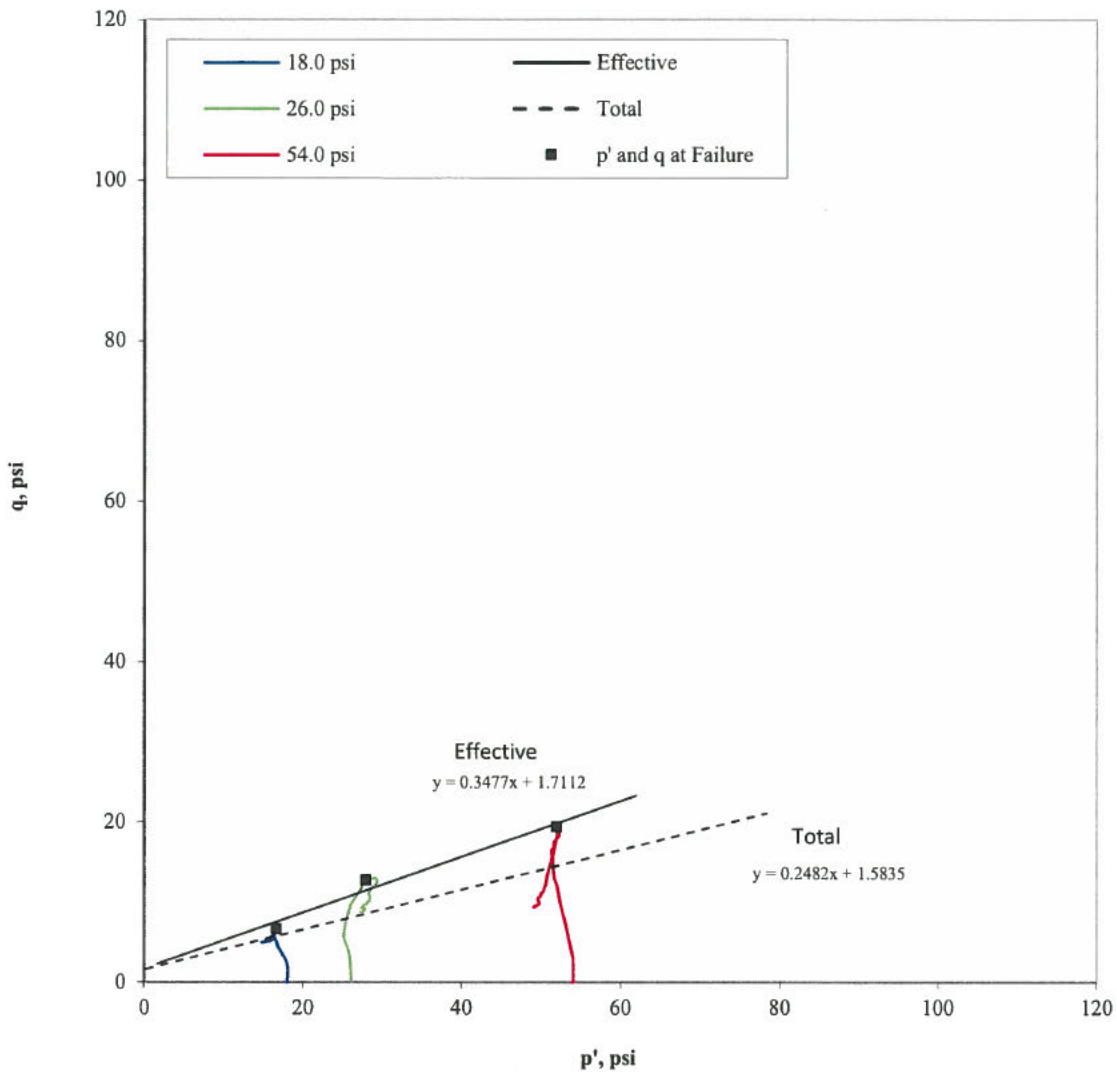

Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
18.0	24.6	16.6	6.6
26.0	38.7	27.9	12.7
54.0	73.4	51.9	19.4

Effective

$\alpha' = 19.2$ degree

$a' = 1.7$ psi

Total

$\alpha = 13.9$ degree

$a = 1.6$ psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc.
Atlanta, Georgia

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
STRESS PATH PLOT

Job Short Title:

FTN/ENERGY INDEPENDENCE/AR

Sample:

B-1 20.0-22.0'

Technician:

FT/PWM

Check:

[Signature]

Reviewed:

[Signature]

Approved:

Start Date:

6/5/2018


Job Number:

18103172

Figure:

4

Mohr's Circle Diagram

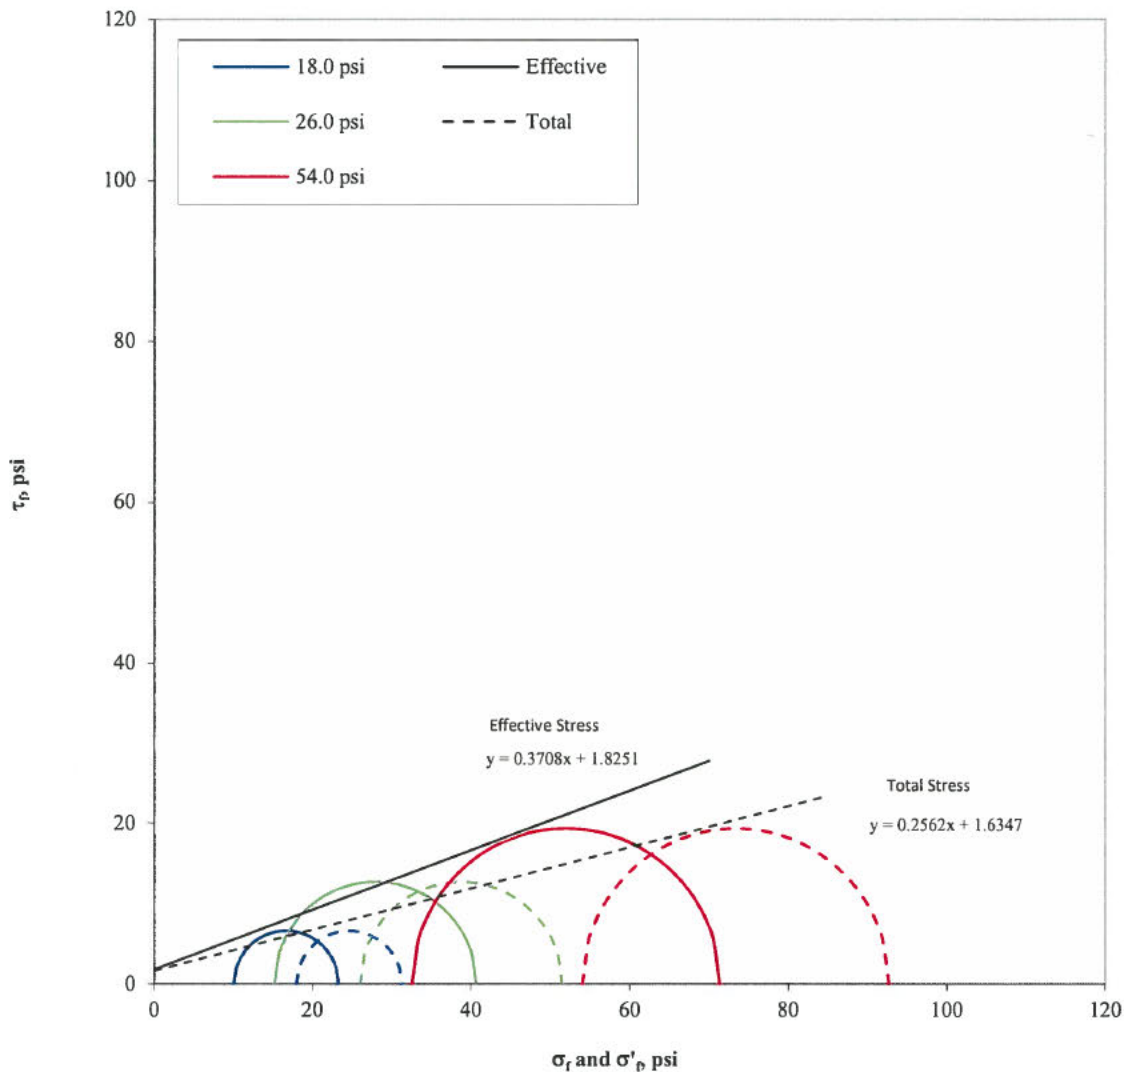

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
18.0	23.3	10.0	31.2	18.0
26.0	40.6	15.2	51.4	26.0
54.0	71.3	32.6	92.7	54.0

Effective	$\phi' =$	20.3	degree
	$c' =$	1.8	psi
Total	$\phi =$	14.4	degree
	$c =$	1.6	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT MOHR'S CIRCLE DIAGRAM			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR		Technician: FT/PWM Check: <i>[Signature]</i>			
Sample: B-1 20.0-22.0'		Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/5/2018	Job Number: 18103172	Figure: 5

18.0 psi



26.0 psi



54.0 psi



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:

FTN/ENERGY INDEPENDENCE/AR

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT

SPECIMENS PHOTOGRAPH - 18.0 26.0 54.0 psi

Sample:

B-1 20.0-22.0'

Technician:

FT/PWM

Check:

[Signature]

Reviewed:

[Signature]

Approved:

Start Date:

6/5/2018

Job Number:

18103172

Figure:

6

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-1

Depth: 28.0-30.0'

TYPE: UD

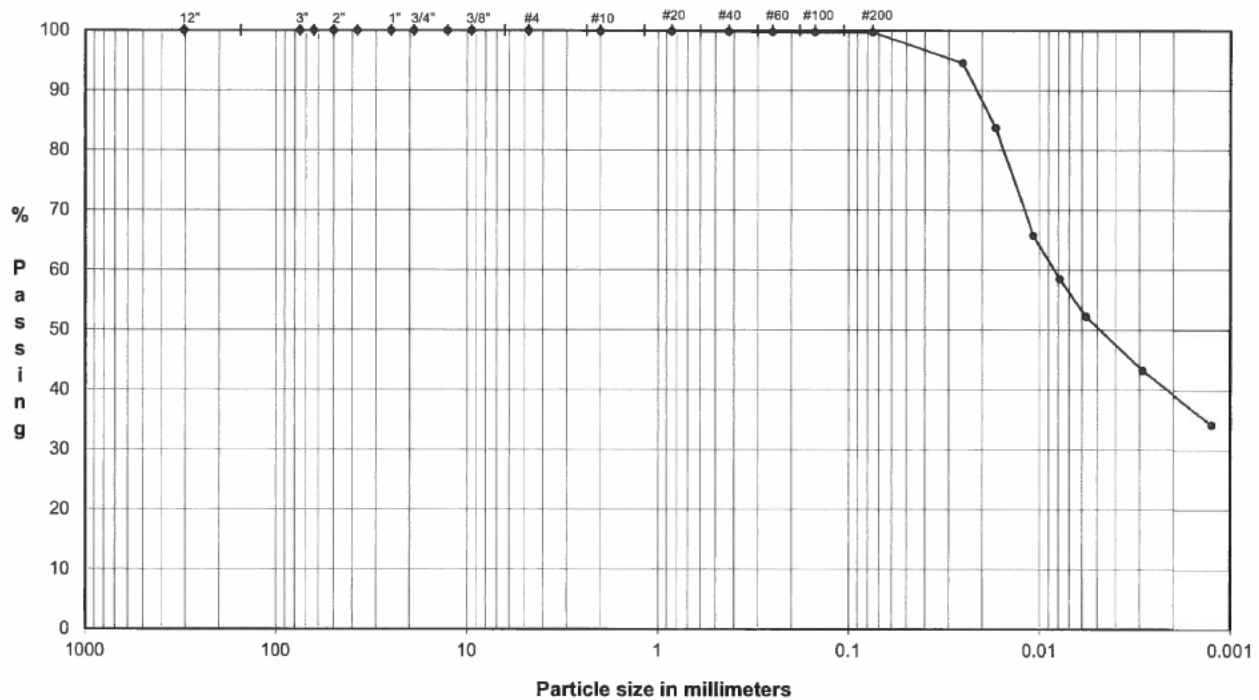

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.9	
#20	0.85	99.9	
#40	0.43	99.8	
#60	0.25	99.8	
#100	0.15	99.7	
#200	0.075	99.7	

Hydrometer Analysis

(mm)	% Finer		
0.025	94.5		
0.017	83.7		
0.011	65.7		
0.0079	58.5		
0.0057	52.2		
0.0029	43.2		
0.0013	34.2		

DESCRIPTION: CLAY, trace fine to coarse sand; gray.

USCS: CH

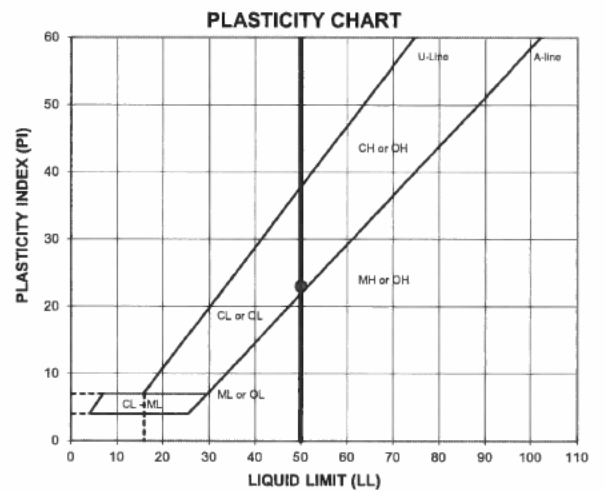

ATTERBERG LIMITS

Method -B (Dry preparation)

M _L	LL	PL	PI	L _I
51.6	50	27	23	1.04

 LL (oven-dried)
 < 0.75 - ORGANIC (LO/OH)

TECH	TJ/HH/BA
DATE	8/9/18
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>
APPROVE	

SPECIFIC GRAVITY OF SOILS
ASTM D-854
PYCNO METER METHOD

PROJECT TITLE	FTN/ENTERGY INDEPENDENCE/AR	SAMPLE ID	B-1
PROJECT NUMBER	18103172	SAMPLE TYPE	UD
TESTED FOR	Gs	SAMPLE DEPTH	28.0-30.0'

MOISTURE CONTENT OF MATERIAL PASSING THE #4 SIEVE

Weight Soil and Tare, Initial (gm)	84.00
Weight Soil and Tare, Final (gm)	82.79
Weight Of Tare (gm)	51.68
Weight Of Moisture (gm)	1.21
Weight Of Dry Soil (gm)	31.11
Hygroscopic Moisture In (%)	3.9%

Test Method

Method - B

Pycnometer Number

13

Weight Pycnometer Empty (gm)	177.87
Volume of Pycnometer (gm)	499.40
Weight Pycnometer and Water (gm)	676.24
Mass of Pycnometer and Water at the test Temperture (A)	676.17
Observed Temperature (Tb), for (Mb) In Degrees C	21.90

Weight of Soil, Water & Pycnometer (gm)
Temperature, C

(B)

706.30

21.9

Density of water @ tested temperature (g/ml)

1.00

Tare Number

Weight of Dry Soil Slurry plus Tare
Weight of Tare

-

48.19

0.00

Weight of Dry Soil (gm)

(C)

48.19

Temperature Coefficient

0.9996

SPECIFIC GRAVITY (G)
 $G @ 20^{\circ}C = [C/(A-(B-C))]*(K)$

2.668



METHOD - A
METHOD - B

WET METHOD
OVEN-DRIED METHOD

METHOD OF AIR REMOVAL
VACUUM

Recommended Mass for Test Specimen

Soil Type	Specimen Dry Mass when using 500 ml Pycnometer
SP, SP-SM	100
SP-SC, SM, SC	75
SILT OR CLAY	50

TECH	FT
DATE	8/16/18
CHECK	
REVIEW	
APPROVE	

Boring or Test Pit: **B-1**
Sample: **1**
Depth: **28.0-30.0** ft
Point No.: **1**

Initial
Length = **6.307** in
Diameter = **2.817** in
Wet Mass = 2.455 lb
Area = 6.233 in²
Volume = 39.308 in³
Specific Gravity = **2.67** (ASTM D854)
Dry Mass of Solids = 1.636 lb
Moisture Content = **50.1%**
Wet Unit Weight = 107.9 pcf
Dry Unit Weight = 71.9 pcf
Void Ratio = 1.31
Percent Saturation = 102%

After Consolidation
Length = **6.105** in
Diameter = 2.779 in
Area = 6.063 in² (Method B)
Volume = 37.017 in³
Moisture Content = **44.1%**
Wet Unit Weight = 110.1 pcf
Dry Unit Weight = 76.4 pcf
Void Ratio = 1.18
Percent Saturation = 100%

B Parameter = **0.99**
Shear Rate = 0.003% /min.
 t_{50} = **109.0** min.
Strain at Failure = 8.1%

Cell Pressure = **65.0** psi
Back Pressure = **40.0** psi
Confining Pressure = 25.0 psi

Boring or Test Pit: **B-1**
Sample: **1**
Depth: **28.0-30.0** ft
Point No.: **2**

Initial
Length = **6.385** in
Diameter = **2.801** in
Wet Mass = 2.462 lb
Area = 6.162 in²
Volume = 39.344 in³
Specific Gravity = **2.67** (ASTM D854)
Dry Mass of Solids = 1.609 lb
Moisture Content = **53.1%**
Wet Unit Weight = 108.1 pcf
Dry Unit Weight = 70.7 pcf
Void Ratio = 1.35
Percent Saturation = 105%

After Consolidation
Length = **6.125** in
Diameter = 2.701 in
Area = 5.729 in² (Method B)
Volume = 35.088 in³
Moisture Content = **41.2%**
Wet Unit Weight = 111.8 pcf
Dry Unit Weight = 79.2 pcf
Void Ratio = 1.10
Percent Saturation = 100%

B Parameter = **0.99**
Shear Rate = 0.0005% /min.
 t_{50} = **1245** min.
Strain at Failure = 11.1%

Cell Pressure = **90.0** psi
Back Pressure = **40.0** psi
Confining Pressure = 50.0 psi

Boring or Test Pit: **B-1**
Sample: **1**
Depth: **28.0-30.0** ft
Point No.: **3**

Initial
Length = **6.348** in
Diameter = **2.803** in
Wet Mass = 2.465 lb
Area = 6.171 in²
Volume = 39.172 in³
Specific Gravity = **2.67** (ASTM D854)
Dry Mass of Solids = 1.624 lb
Moisture Content = **51.8%**
Wet Unit Weight = 108.7 pcf
Dry Unit Weight = 71.6 pcf
Void Ratio = 1.32
Percent Saturation = 105%

After Consolidation
Length = **5.998** in
Diameter = 2.677 in
Area = 5.627 in² (Method B)
Volume = 33.752 in³
Moisture Content = **37.5%**
Wet Unit Weight = 114.3 pcf
Dry Unit Weight = 83.1 pcf
Void Ratio = 1.00
Percent Saturation = 100%

B Parameter = **0.98**
Shear Rate = 0.006% /min.
 t_{50} = **54.7** min.
Strain at Failure = 8.1%

Cell Pressure = **115.0** psi
Back Pressure = **40.0** psi
Confining Pressure = 75.0 psi

Notes: Sample description: **(CH) CLAY, trace fine to coarse sand; gray.**
Atterberg limits: **LL = 50** **PL = 27** **PI = 23** (ASTM D4318)
Percent finer: **3/4 in. = 100%** **No. 4 = 100%** **No. 200 = 100%** (ASTM D422, refer to separate report for gradation curve)
Specimen type: ☒ Intact ☐ Reconstituted
Moisture from: ☐ Cuttings ☒ Entire specimen
Saturation method: ☒ Wet ☐ Dry
Failure criterion: ☒ $(\sigma'_1/\sigma'_3)_{max}$ ☐ $(\sigma'_1/\sigma'_3)_{max}$ % strain
Membrane effect: ☒ Corrected ☐ Not Corrected



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:
FTN/ENERGY INDEPENDENCE/AR



Sample:
B-1 UD 28.0-30.0'

Title:
ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SAMPLE AND TEST DATA

Technician: FT/PWM	Reviewed: DA	Start Date: 8/13/2018	Job Number: 18103172	Figure: 1
Check: PWM	Approved:			

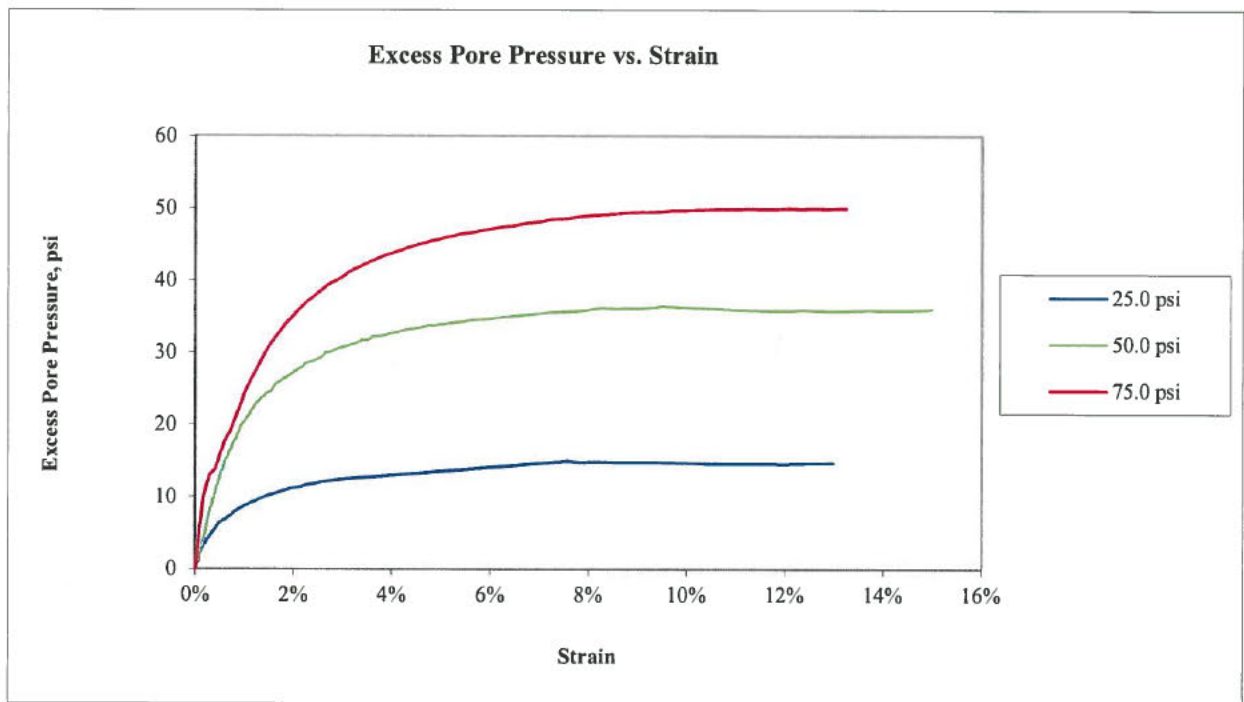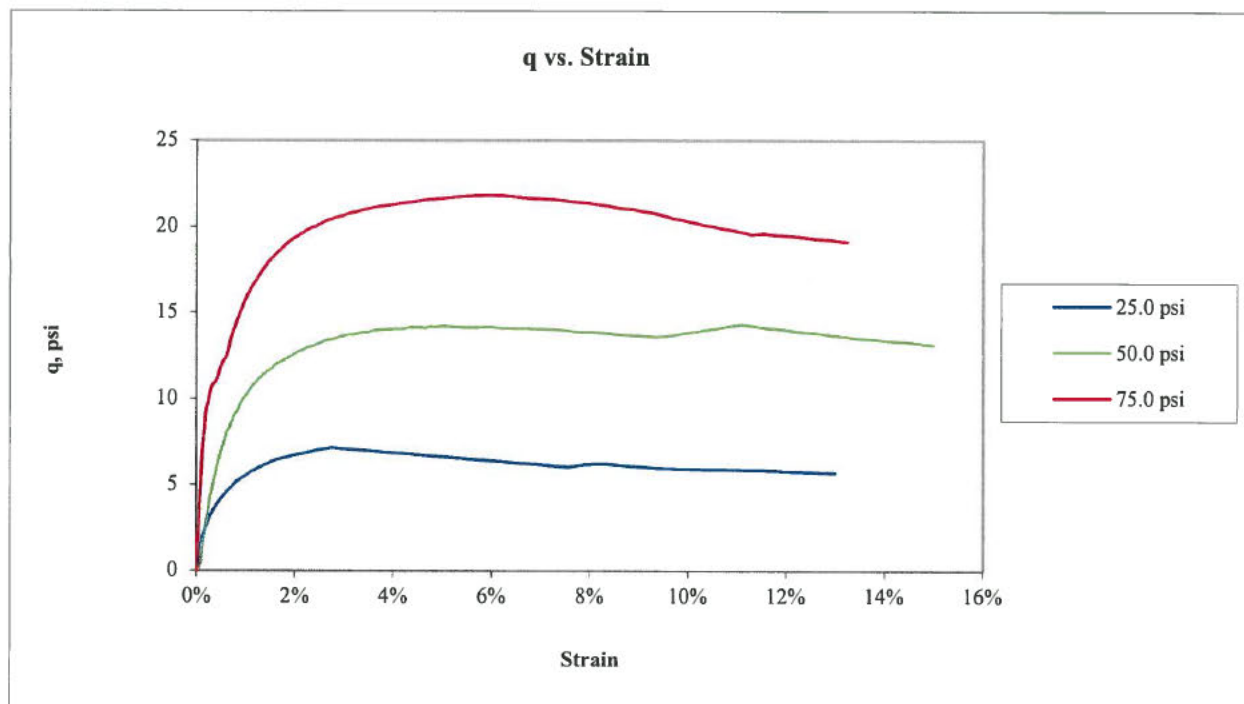


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-1 UD 28.0-30.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 8/13/2018	Job Number: 18103172
				Figure: 2	

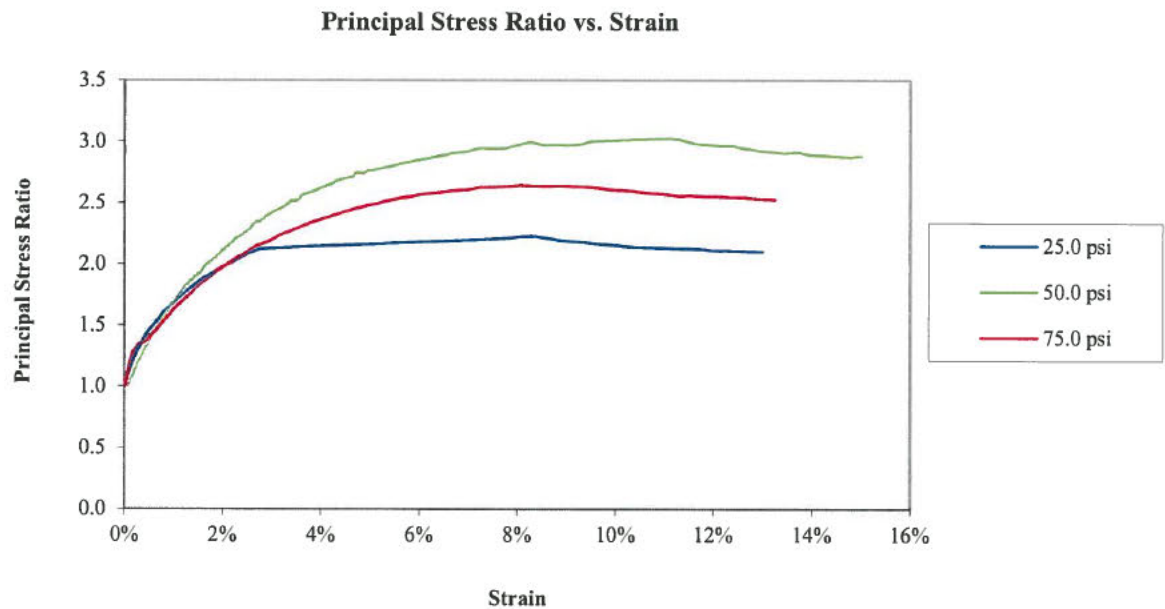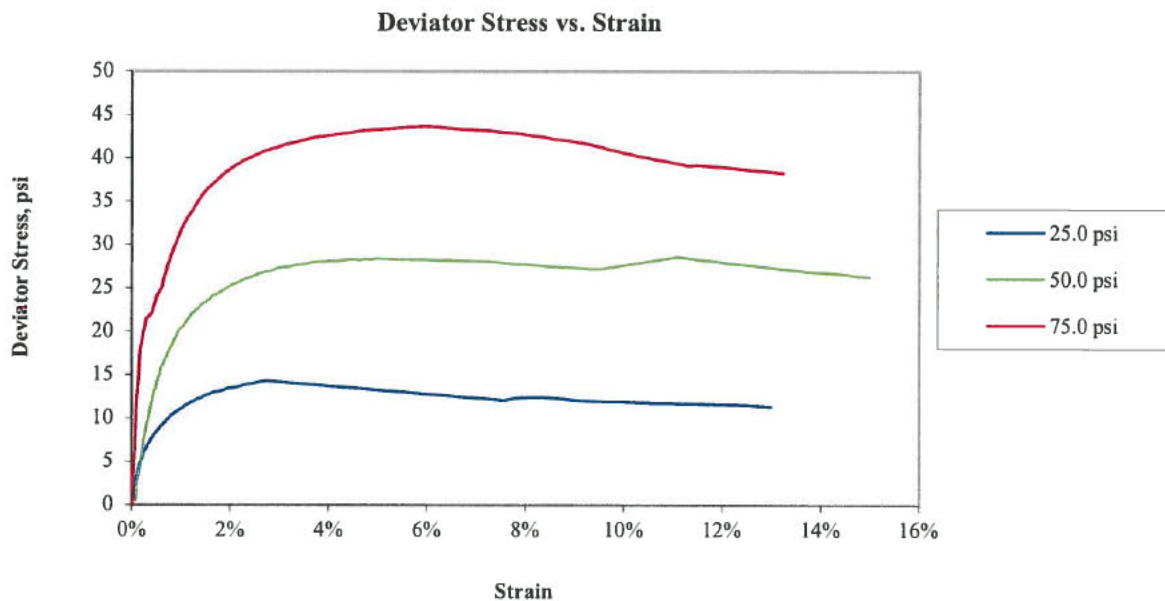

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT DEVIATOR STRESS AND PRINCIPAL STRESS RATIO PLOT			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR		Technician: FT/PWM Check: <i>[Signature]</i>			
Sample: B-1 UD 28.0-30.0'		Reviewed: <i>[Signature]</i> Approved:	Start Date: 8/13/2018	Job Number: 18103172	Figure: 3

Stress Path (p'-q) Plot

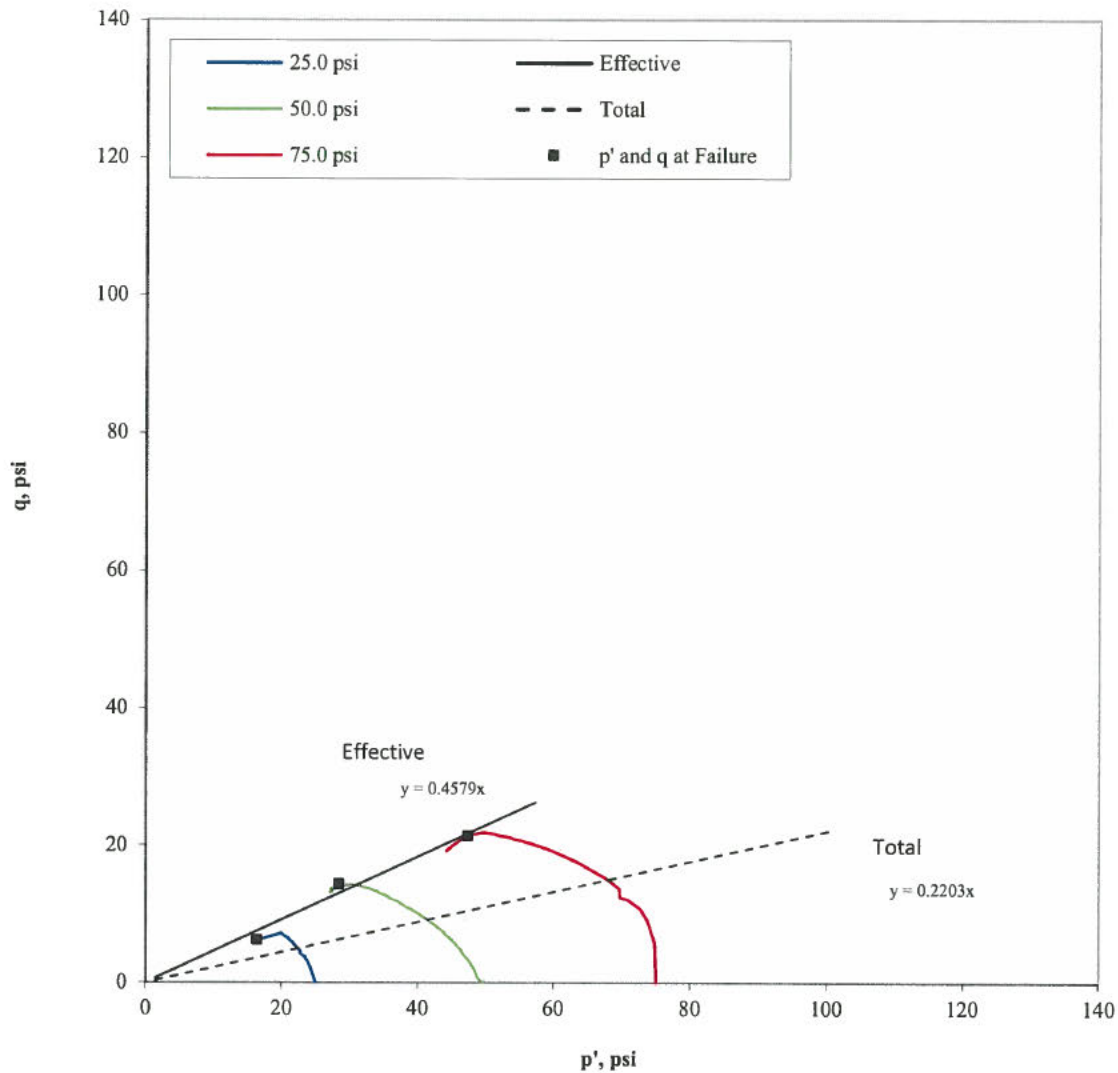


Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
25.0	31.2	16.4	6.2
50.0	64.3	28.4	14.3
75.0	96.3	47.3	21.3

Effective		
α'	24.6	degree
a'	0.0	psi
Total		
α	12.4	degree
a	0.0	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT STRESS PATH PLOT			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-1 UD 28.0-30.0'		Technician: FT/PWM Check: 	Reviewed: Approved:	Start Date: 8/13/2018	Job Number: 18103172
				Figure: 4	

Mohr's Circle Diagram

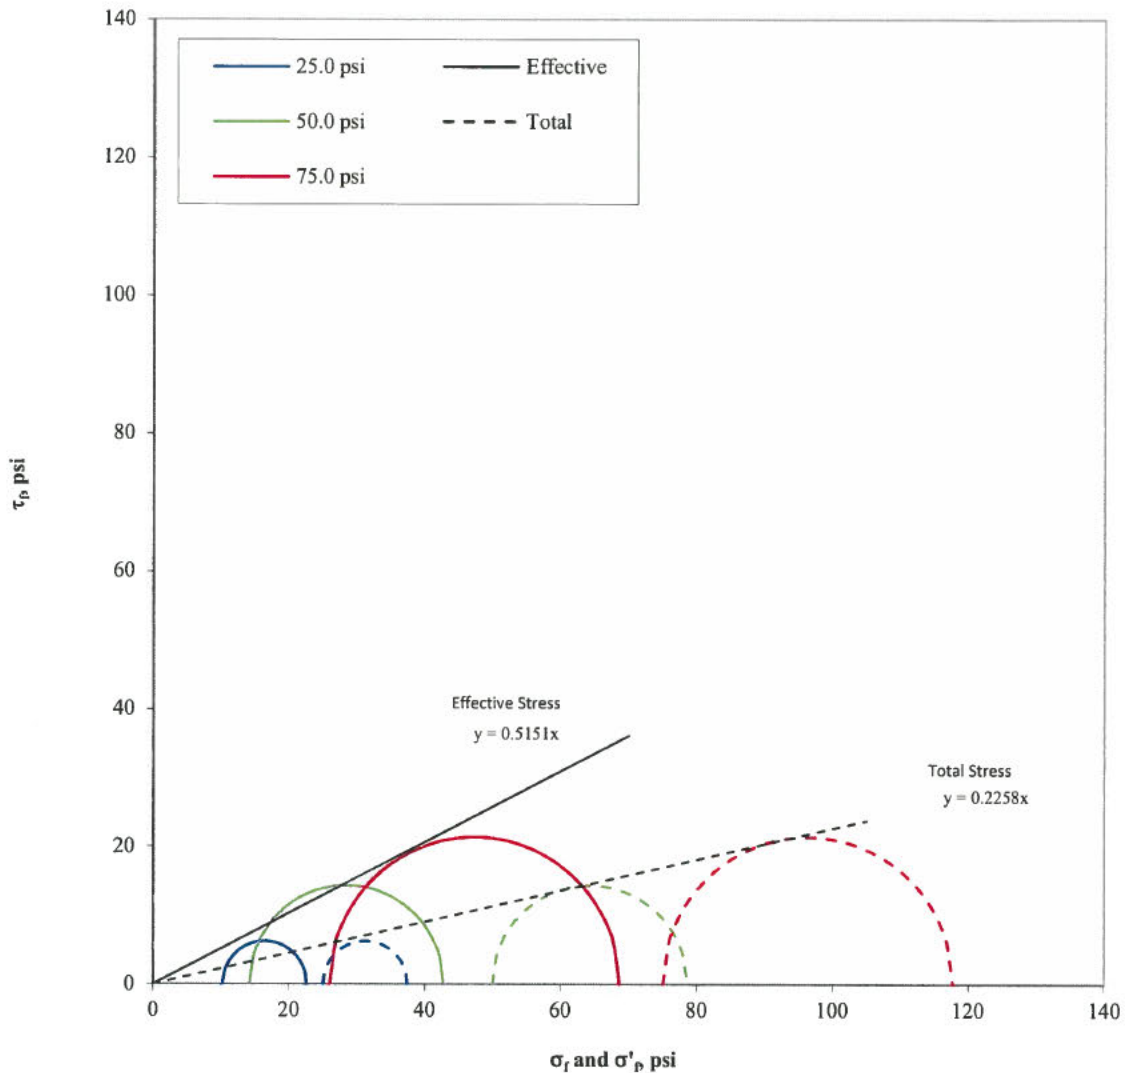

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
25.0	22.6	10.1	37.4	25.0
50.0	42.7	14.1	78.6	50.0
75.0	68.7	26.0	117.7	75.0

Effective

$\phi' = 27.3$ degree
 $c' = 0.0$ psi

Total

$\phi = 12.7$ degree
 $c = 0.0$ psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc.
Atlanta, Georgia

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
MOHR'S CIRCLE DIAGRAM

Job Short Title:

FTN/ENERGY INDEPENDENCE/AR

Sample:

B-1 UD 28.0-30.0'

Technician:

FT/PWM

Check:

[Signature]

Reviewed:

[Signature]
 Approved:

Start Date:

8/13/2018

Job Number:

18103172

Figure:

5

25.0 psi



50.0 psi



75.0 psi



Golder Associates Inc.
Atlanta, Georgia

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT

Job Short Title:

FTN/ENTERGY INDEPENDENCE/AR

SPECIMENS PHOTOGRAPH - 25.0 50.0 75.0 psi

Sample:

B-1 UD 28.0-30.0'

Technician:

FT/PWM

Check:

Reviewed:

DA

Approved:

Start Date:

8/13/2018

Job Number:

18103172

Figure:

6

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENERGY INDEPENDENCE/AR

SAMPLE ID: B-2

Depth: 8.0-10.0'

TYPE: UD

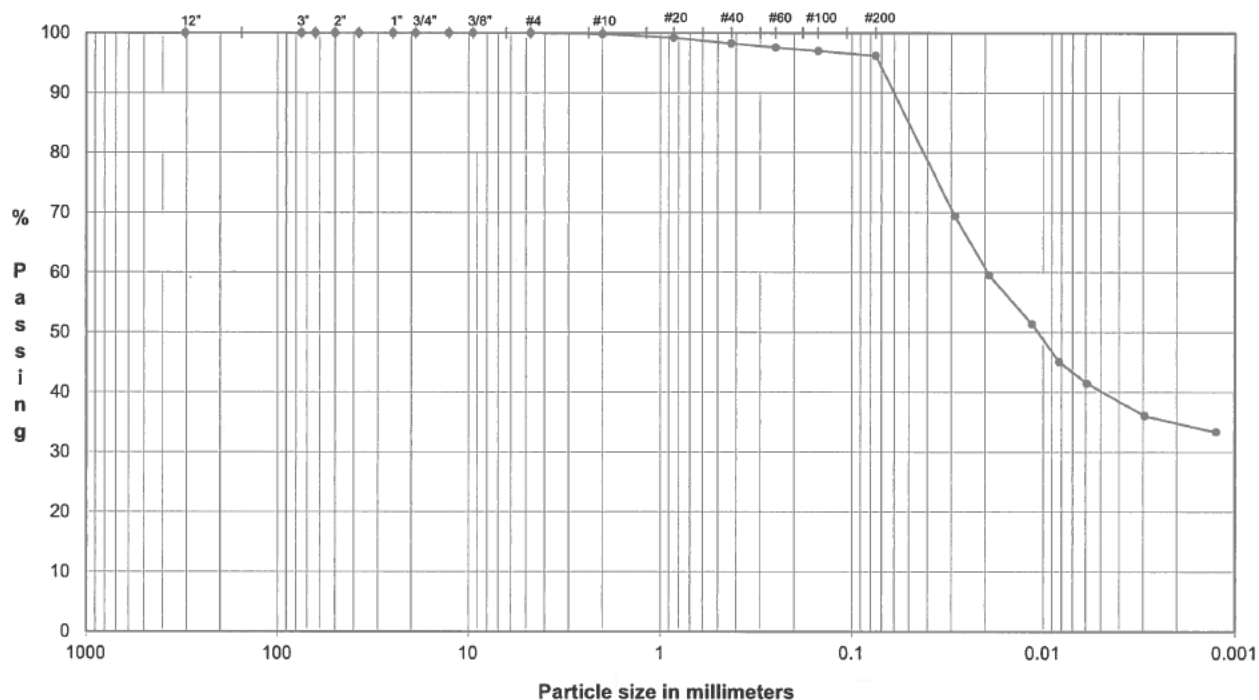

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.8	
#20	0.85	99.2	
#40	0.43	98.3	
#60	0.25	97.5	
#100	0.15	97.0	
#200	0.075	96.2	


Hydrometer Analysis

(mm)	% Finer		
0.029	69.4		
0.019	59.5		
0.011	51.4		
0.0082	45.1		
0.0059	41.5		
0.0030	36.1		
0.0013	33.4		

DESCRIPTION: CLAY; dark brown, dark olive brown and brown.

USCS: CH

PLASTICITY CHART

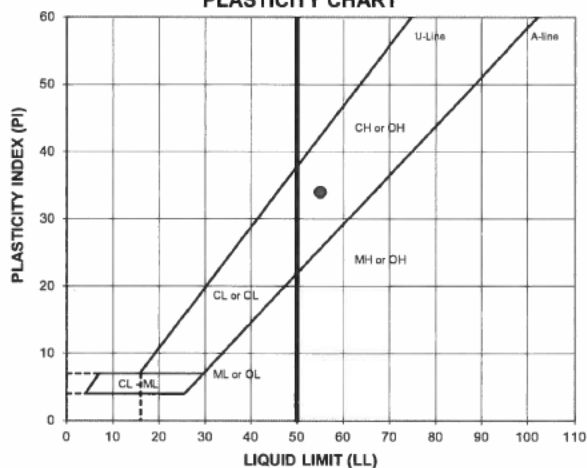ATTERBERG LIMITS
Method -B (Dry preparation)

M _c	LL	PL	PI	LI
26.3	55	21	34	0.16

LL (oven-dried)
< 0.75 ORGANIC (OL/OH)

TECH: HEH
DATE: 6/2/18
CHECK: [Signature]
REVIEW: [Signature]
APPROVE: [Signature]




Boring or Test Pit: B-2	Boring or Test Pit: B-2	Boring or Test Pit: B-2
Sample: 1	Sample: 1	Sample: 1
Depth: 8.0-10.0 ft	Depth: 8.0-10.0 ft	Depth: 8.0-10.0 ft
Point No.: 1	Point No.: 2	Point No.: 3
Initial	Initial	Initial
Length = 6.019 in	Length = 5.999 in	Length = 6.020 in
Diameter = 2.901 in	Diameter = 2.856 in	Diameter = 2.906 in
Wet Mass = 2.750 lb	Wet Mass = 2.747 lb	Wet Mass = 2.734 lb
Area = 6.610 in ²	Area = 6.406 in ²	Area = 6.633 in ²
Volume = 39.784 in ³	Volume = 38.431 in ³	Volume = 39.928 in ³
Specific Gravity = 2.72 (ASTM D854)	Specific Gravity = 2.72 (ASTM D854)	Specific Gravity = 2.72 (ASTM D854)
Dry Mass of Solids = 2.166 lb	Dry Mass of Solids = 2.204 lb	Dry Mass of Solids = 2.146 lb
Moisture Content = 26.9%	Moisture Content = 24.6%	Moisture Content = 27.4%
Wet Unit Weight = 119.4 pcf	Wet Unit Weight = 123.5 pcf	Wet Unit Weight = 118.3 pcf
Dry Unit Weight = 94.1 pcf	Dry Unit Weight = 99.1 pcf	Dry Unit Weight = 92.9 pcf
Void Ratio = 0.80	Void Ratio = 0.71	Void Ratio = 0.82
Percent Saturation = 91%	Percent Saturation = 94%	Percent Saturation = 90%
After Consolidation	After Consolidation	After Consolidation
Length = 5.978 in	Length = 5.961 in	Length = 5.954 in
Diameter = 2.893 in	Diameter = 2.869 in	Diameter = 2.878 in
Area = 6.571 in ² (Method B)	Area = 6.464 in ² (Method B)	Area = 6.507 in ² (Method B)
Volume = 39.284 in ³	Volume = 38.531 in ³	Volume = 38.745 in ³
Moisture Content = 28.6%	Moisture Content = 26.3%	Moisture Content = 28.3%
Wet Unit Weight = 122.5 pcf	Wet Unit Weight = 124.8 pcf	Wet Unit Weight = 122.8 pcf
Dry Unit Weight = 95.3 pcf	Dry Unit Weight = 98.9 pcf	Dry Unit Weight = 95.7 pcf
Void Ratio = 0.78	Void Ratio = 0.71	Void Ratio = 0.77
Percent Saturation = 100%	Percent Saturation = 100%	Percent Saturation = 100%
B Parameter = 0.98	B Parameter = 0.97	B Parameter = 0.99
Shear Rate = 0.065% /min.	Shear Rate = 0.008% /min.	Shear Rate = 0.015% /min.
t ₅₀ = 5.61 min.	t ₅₀ = 39.49 min.	t ₅₀ = 23.36 min.
Strain at Failure = 1.7%	Strain at Failure = 2.1%	Strain at Failure = 2.5%
Cell Pressure = 78.0 psi	Cell Pressure = 86.0 psi	Cell Pressure = 94.0 psi
Back Pressure = 70.0 psi	Back Pressure = 70.0 psi	Back Pressure = 70.0 psi
Confining Pressure = 8.0 psi	Confining Pressure = 16.0 psi	Confining Pressure = 24.0 psi



Notes: Sample description: **(CH) CLAY, dark brown, dark olive brown and brown.**

Atterberg limits: LL = **55** PL = **21** PI = **34** (ASTM D4318)



Percent finer: 3/4 in. = **100%** No. 4 = **100%** No. 200 = **96%** (ASTM D422, refer to separate report for gradation curve)

Specimen type:	X Intact	X Reconstituted
Moisture from:	X Cuttings	X Entire specimen
Saturation method:	X Wet	X Dry
Failure criterion:	X (σ ₁ /σ ₃) _{max}	(σ ₁ -σ ₃) _{max} <input type="text"/> % strain
Membrane effect:	X Corrected	X Not Corrected

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT SAMPLE AND TEST DATA			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR		Technician: FT/PWM	Reviewed: 	Start Date: 6/11/2018	Job Number: 18103172
Sample: B-2 8.0-10.0'		Check: 	Approved: 	Figure: 1	

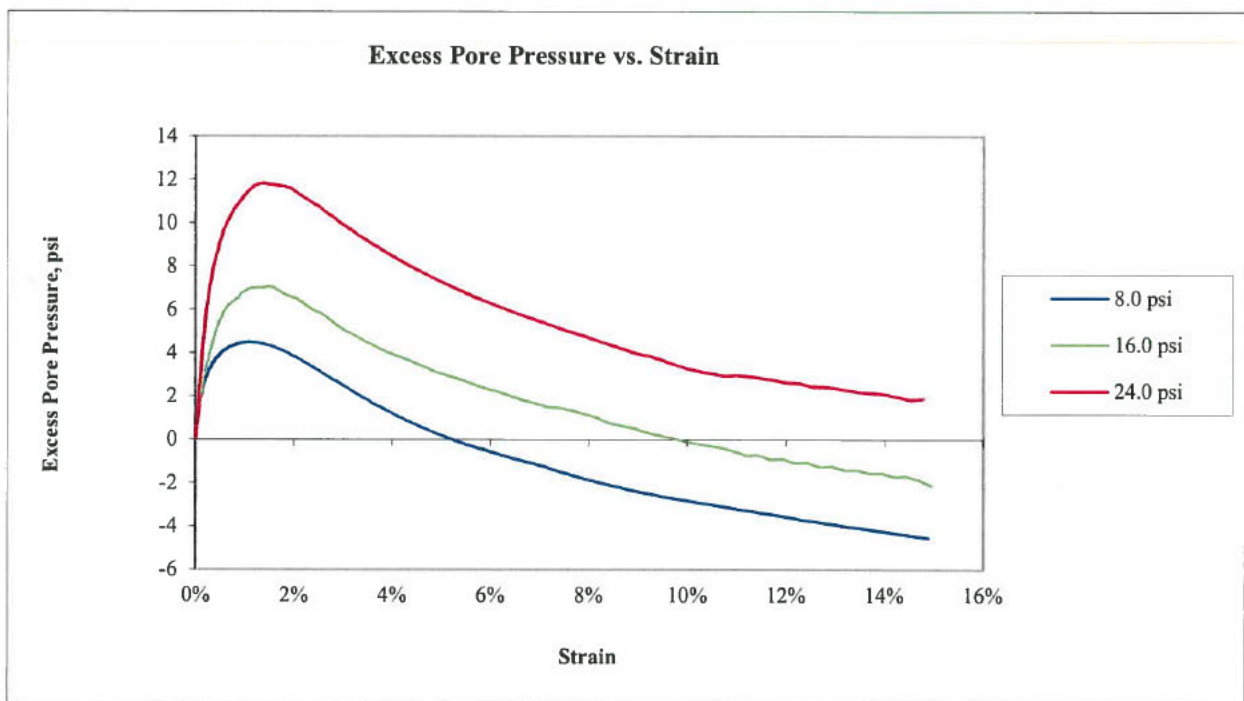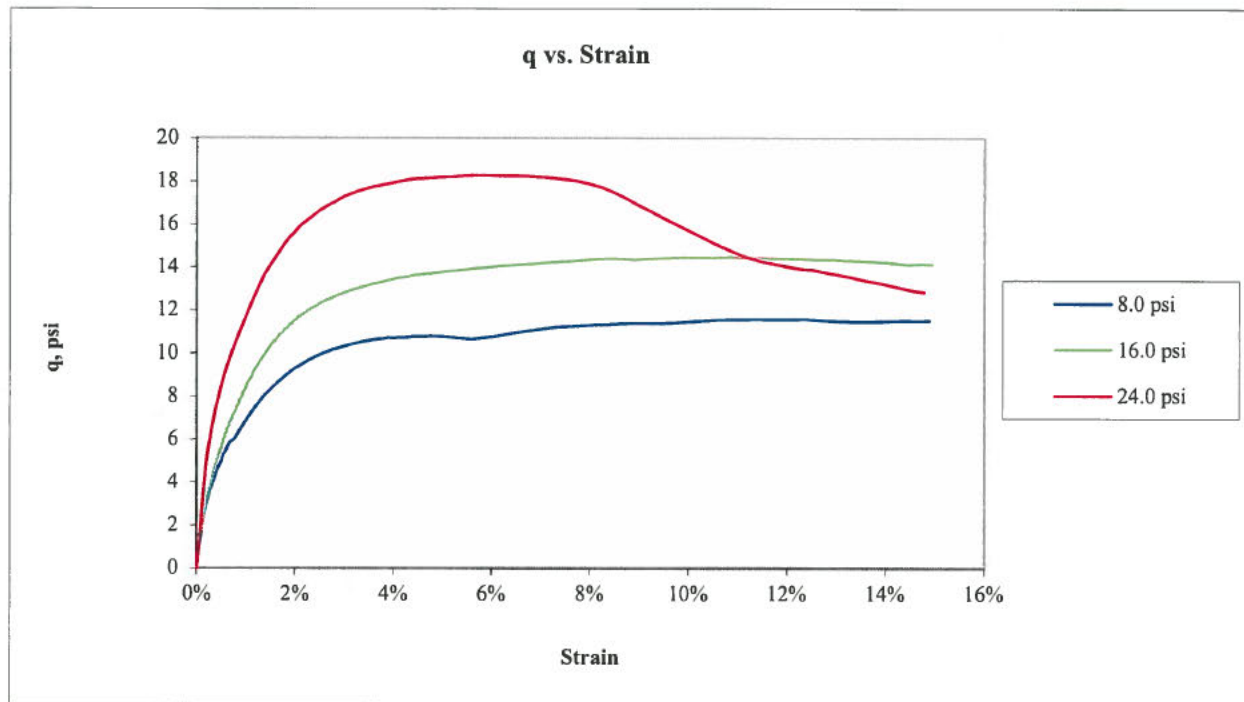


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-2 8.0-10.0'		Technician: FT/PWM Check: 	Reviewed: Approved:	Start Date: 6/11/2018	Job Number: 18103172	Figure: 2

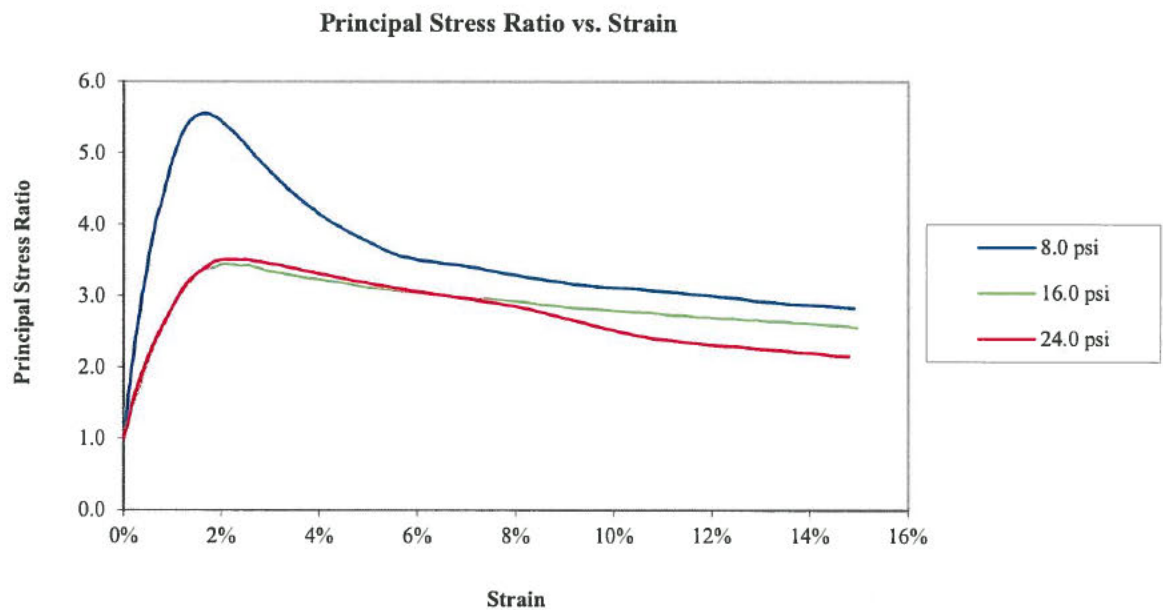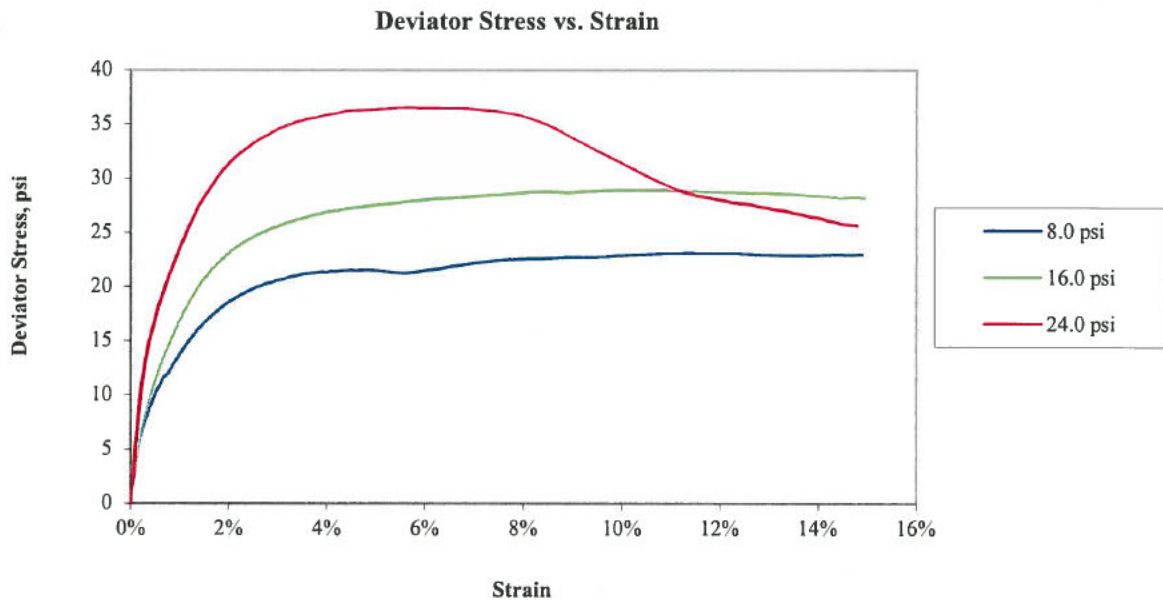

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT DEVIATOR STRESS AND PRINCIPAL STRESS RATIO PLOT													
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 15%; vertical-align: top;">Technician: FT/PWM</td> <td style="width: 15%; vertical-align: top;">Reviewed: <i>SA</i></td> <td style="width: 15%; vertical-align: top;">Start Date:</td> <td style="width: 15%; vertical-align: top;">Job Number:</td> <td style="width: 10%; vertical-align: top;">Figure:</td> </tr> <tr> <td style="vertical-align: top;">Check: <i>WY</i></td> <td style="vertical-align: top;">Approved:</td> <td style="vertical-align: top;">6/11/2018</td> <td style="vertical-align: top;">18103172</td> <td style="vertical-align: top;">3</td> </tr> </table>				Technician: FT/PWM	Reviewed: <i>SA</i>	Start Date:	Job Number:	Figure:	Check: <i>WY</i>	Approved:	6/11/2018	18103172	3
Technician: FT/PWM	Reviewed: <i>SA</i>	Start Date:	Job Number:	Figure:											
Check: <i>WY</i>	Approved:	6/11/2018	18103172	3											
Sample: B-2 8.0-10.0'															

Stress Path (p'-q) Plot

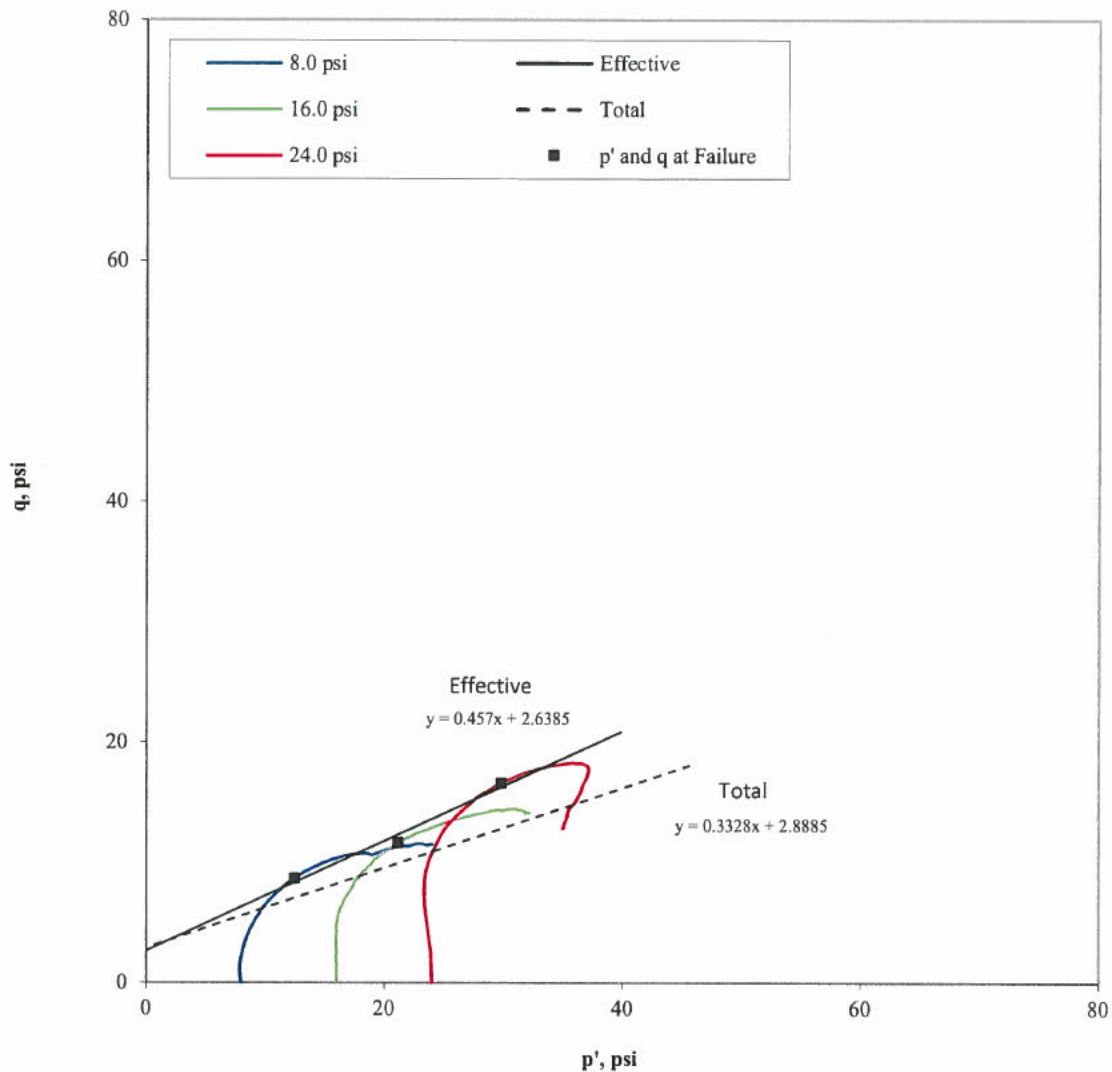


Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
8.0	16.7	12.5	8.7
16.0	27.7	21.2	11.7
24.0	40.6	29.8	16.6

Effective		
α'	24.6	degree
a'	2.6	psi
Total		
α	18.4	degree
a	2.9	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT STRESS PATH PLOT				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-2 8.0-10.0'		Technician: FT/PWM Check:	Reviewed: Approved:	Start Date: 6/11/2018	Job Number: 18103172	Figure: 4

Mohr's Circle Diagram

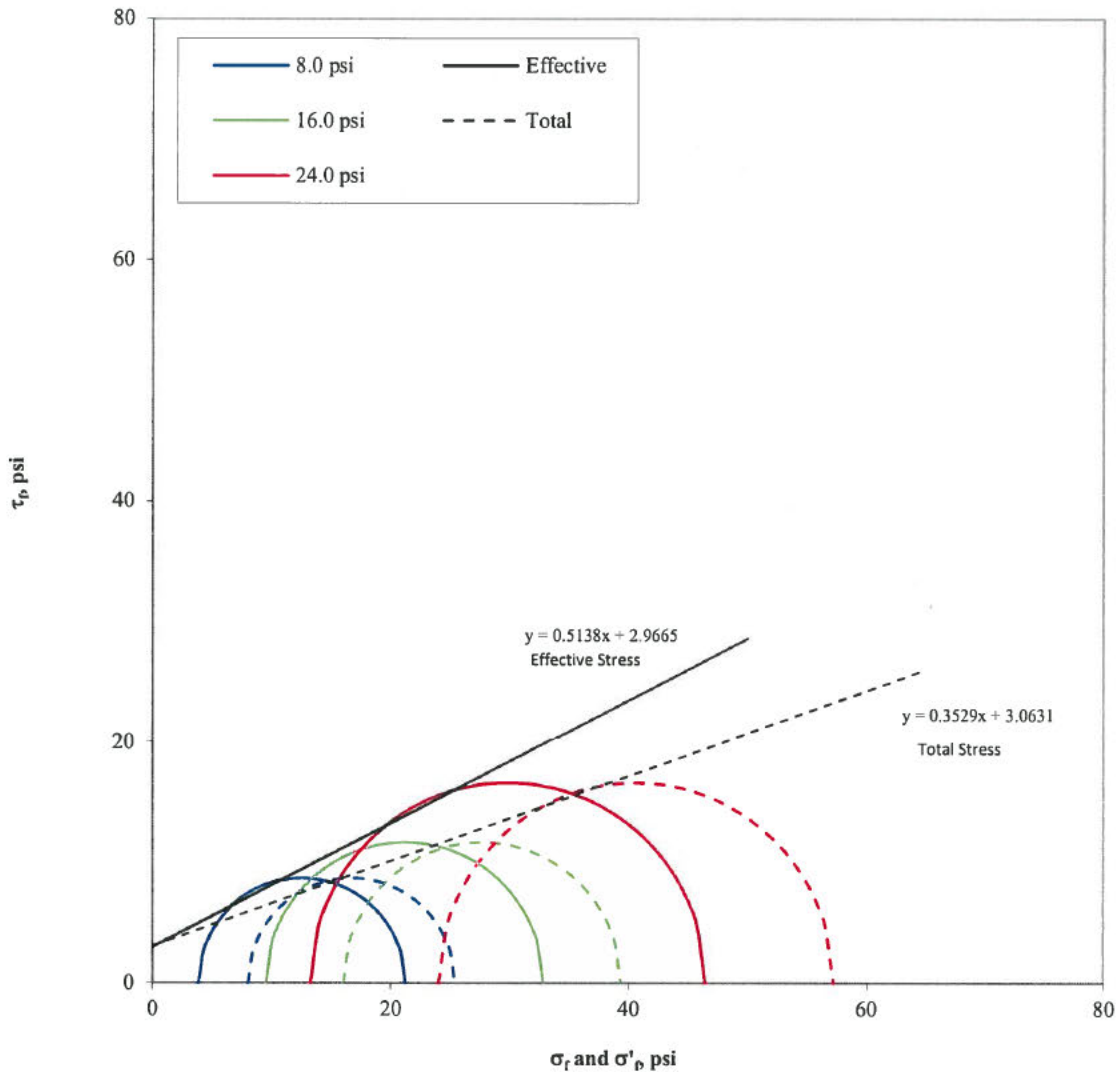

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
8.0	21.2	3.8	25.4	8.0
16.0	32.8	9.5	39.3	16.0
24.0	46.4	13.2	57.2	24.0

Effective	$\phi' =$	27.2	degree
	$c' =$	3.0	psi
Total	$\phi =$	19.4	degree
	$c =$	3.1	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT MOHR'S CIRCLE DIAGRAM			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-2 8.0-10.0'		Technician: FT/PWM Check: <i>W M</i>	Reviewed: <i>Sh r</i> Approved:	Start Date: 6/11/2018	Job Number: 18103172
				Figure: 5	

8.0 psi



16.0 psi



24.0 psi



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:

FTN/ENTERGY INDEPENDENCE/AR

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT

SPECIMENS PHOTOGRAPH - 8.0 16.0 24.0 psi

Sample:

B-2 8.0-10.0'

Technician:

FT/PWM

Check:

[Signature]

Reviewed:

8x

Approved:

Start Date:

6/11/2018

Job Number:

18103172

Figure:

6

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-3 -

Depth: 3.0-5.0'

TYPE: UD

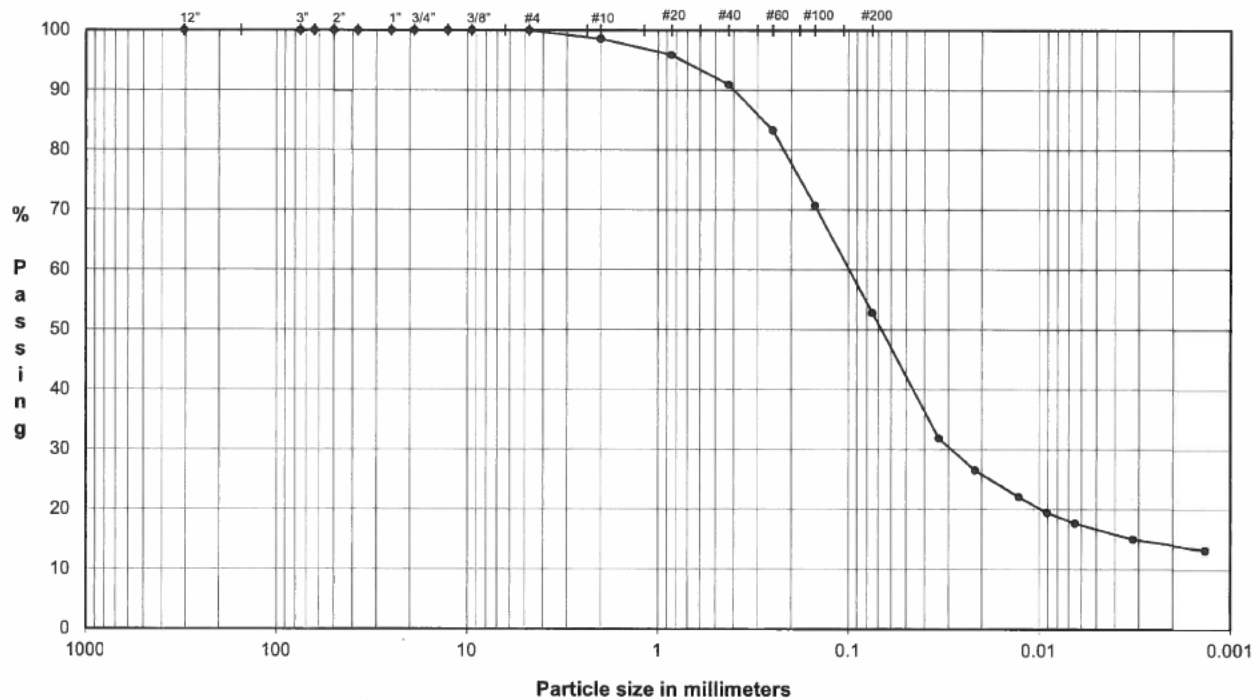

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES


U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	Cobbles
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	Coarse Gravel
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	Fine Gravel
#10	2.00	98.5	Coarse Sand
#20	0.85	95.9	
#40	0.43	90.9	Medium Sand
#60	0.25	83.3	
#100	0.15	70.7	
#200	0.075	52.8	Fine Sand

(mm)	% Finer		
0.034	31.8		
0.022	26.5		
0.013	22.1		
0.0091	19.5		
0.0065	17.7		
0.0032	15.0		
0.0013	13.3		

DESCRIPTION: SILT and SAND, fine to coarse; grayish brown.

USCS: ML

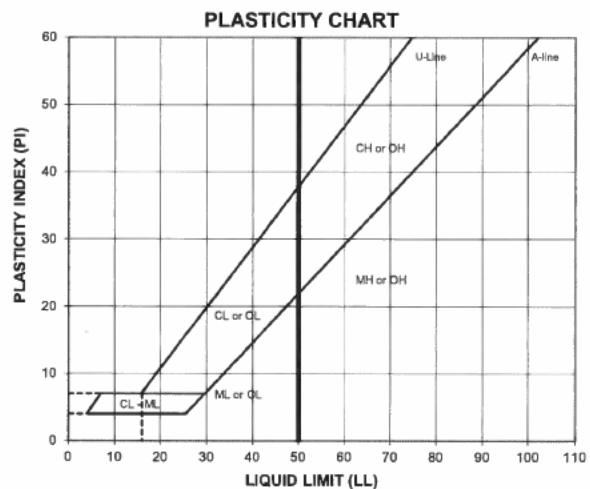ATTERBERG LIMITS
Method -B (Dry preparation)

ML	LL	PL	PI	LI
42.9	NP	NP	NP	NP

LL (oven-dried)
< 0.75 - ORGANIC
(OL/OH)

TECH TJ/HH/BA
DATE 8/9/18
CHECK *DA*
REVIEW *Realy*
APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-3

Depth: 10.0-12.0'

TYPE: UD

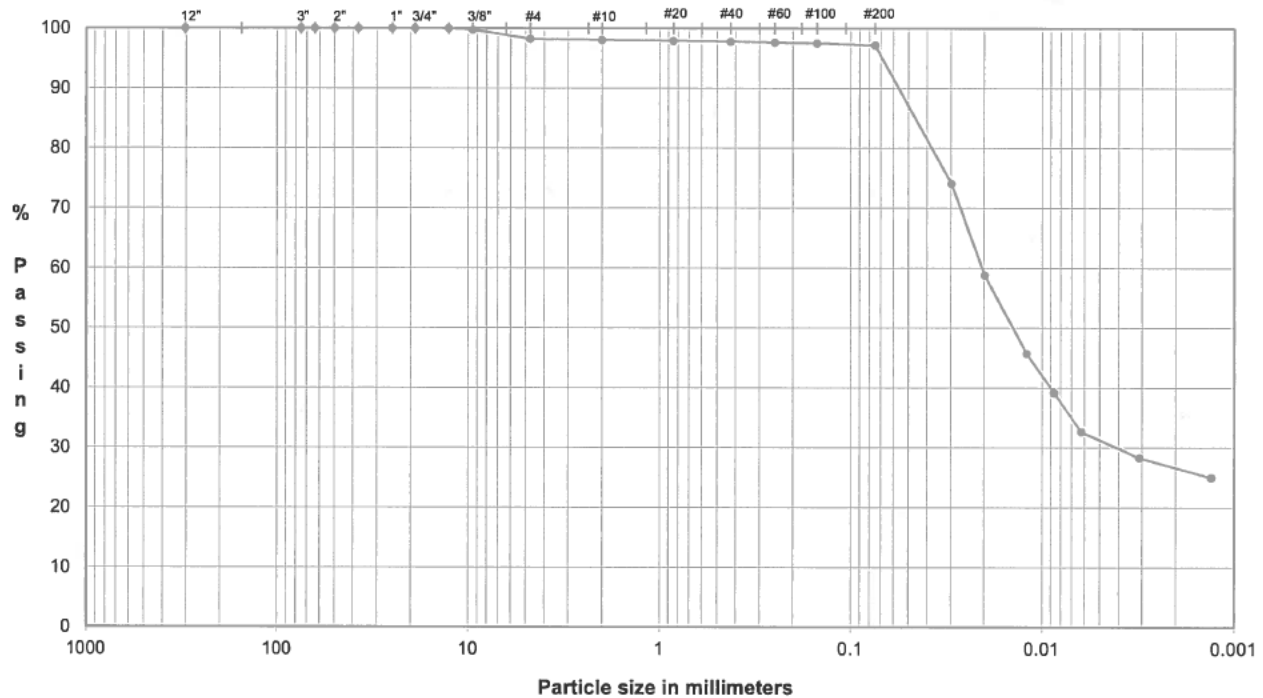

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	99.7	
#4	4.8	98.2	
#10	2.00	98.1	
#20	0.85	97.9	
#40	0.43	97.8	
#60	0.25	97.7	
#100	0.15	97.5	
#200	0.075	97.2	

Hydrometer Analysis

(mm)	% Finer		
0.030	74.0		
0.020	58.8		
0.012	45.7		
0.0087	39.2		
0.0063	32.7		
0.0031	28.3		
0.0013	25.0		

DESCRIPTION: SILTY CLAY, trace fine to coarse sand, trace fine gravel; dark brown, dark olive brown and brown.

USCS: CL

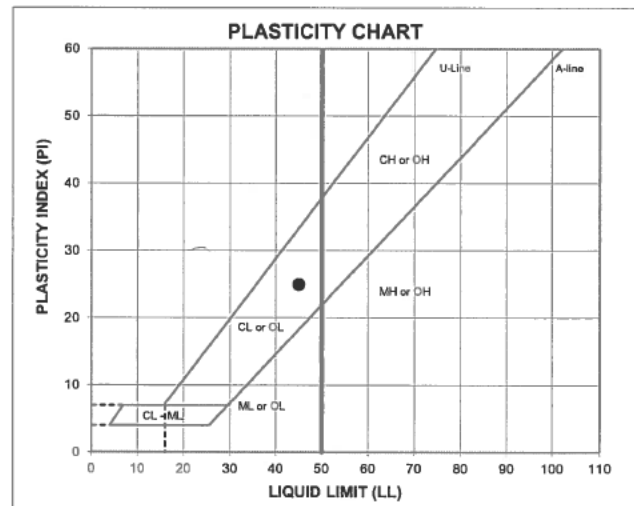

ATTERBERG LIMITS

Method -B (Dry preparation)

M _h	LL	PL	PI	LI
30.1	45	20	25	0.41

LL (oven-dried)
 < 0.75 = ORGANIC (LO/OH)

TECH HEH/HH/TJ
 DATE 6/27/18
 CHECK *[Signature]*
 REVIEW *[Signature]*
 APPROVE

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE FTN/ENTERGY INDEPENDENCE/AR
PROJECT NUMBER 18103172
SAMPLE ID B-3 10.0-12.0'
SAMPLE TYPE UD

Board # 3
Flow Pump 2
Flow Pump Speed 6
Technician PWM

COMMENTS

Sample Data, Initial

Height, inches	3.000	B-Value, f	0.99
Diameter, inches	2.867	Cell Pres.	88.0
Area, cm ²	41.65	Bot. Pres.	80.0
Volume, cm ³	317.37	Top Pres.	80.0
Mass, g	605.25	Tot. B.P.	80.0
Moisture Content, %	30.1	Head, max.	79.48
Dry Density, pcf	91.4	Head, min.	79.48
Spec. Gravity(assumed)	2.750	Max. Grad.	10.45
Volume Solids, cm ³	169.12	Min. Grad.	10.45
Volume Voids, cm ³	148.25		
Void Ratio	0.88		
Saturation, %	94.5%		

Sample Data, Final

Height, inches	2.995
Diameter, inches	2.848
Area, cm ²	41.10
Volume, cm ³	312.66
Mass, g	609.01
Moisture Content, %	30.95
Dry Density, pcf	92.82
Volume Solids, cm ³	169.12
Volume Voids, cm ³	143.54
Void Ratio	0.85
Saturation, %	100.0%

WATER CONTENTS

	Sample Initial	Sample Final
Wt Soil & Tare, i g	605.25	691.29
Wt Soil & Tare, f g	465.08	547.39
Wt Tare g	0.00	82.41
Wt Moisture Lost g	140.17	143.90
Wt Dry Soil g	465.08	464.98
Water Content %	30.14%	30.95%

DESCRIPTION

SILTY CLAY, trace fine to coarse sand, trace fine gravel; dark brown, dark olive brown and brown.

Flow Pump Rate 4.70E-04 cm³/sec

USCS CL

TIME FUNCTIONS, SECONDS								dP	Reading	Head	Gradient	Permeability
DATE	DAY	HOUR	MIN	TEMP	dt	dt,acc	dt	dt,acc				
				(°C)	(min)	(min)	(sec)	(sec)	(psi)	(cm)		(cm/sec)
06/28/18	43279	8	15	20.6	0	0	0	0	1.13	79.48	10.45	1.1E-06
06/28/18	43279	8	20	20.6	5	5	300	300	1.13	79.48	10.45	1.1E-06
06/28/18	43279	8	25	20.6	5	10	300	600	1.13	79.48	10.45	1.1E-06
06/28/18	43279	8	30	20.6	5	15	300	900	1.13	79.48	10.45	1.1E-06 *
06/28/18	43279	8	35	20.6	5	20	300	1200	1.13	79.48	10.45	1.1E-06 *
06/28/18	43279	8	40	20.6	5	25	300	1500	1.13	79.48	10.45	1.1E-06 *
06/28/18	43279	8	45	20.6	5	30	300	1800	1.13	79.48	10.45	1.1E-06 *

TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** 1.1E-06 cm/sec **

DATE 6/28/18
CHECK
REVIEW
APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-4

Depth: 5.0-7.0'

TYPE: UD

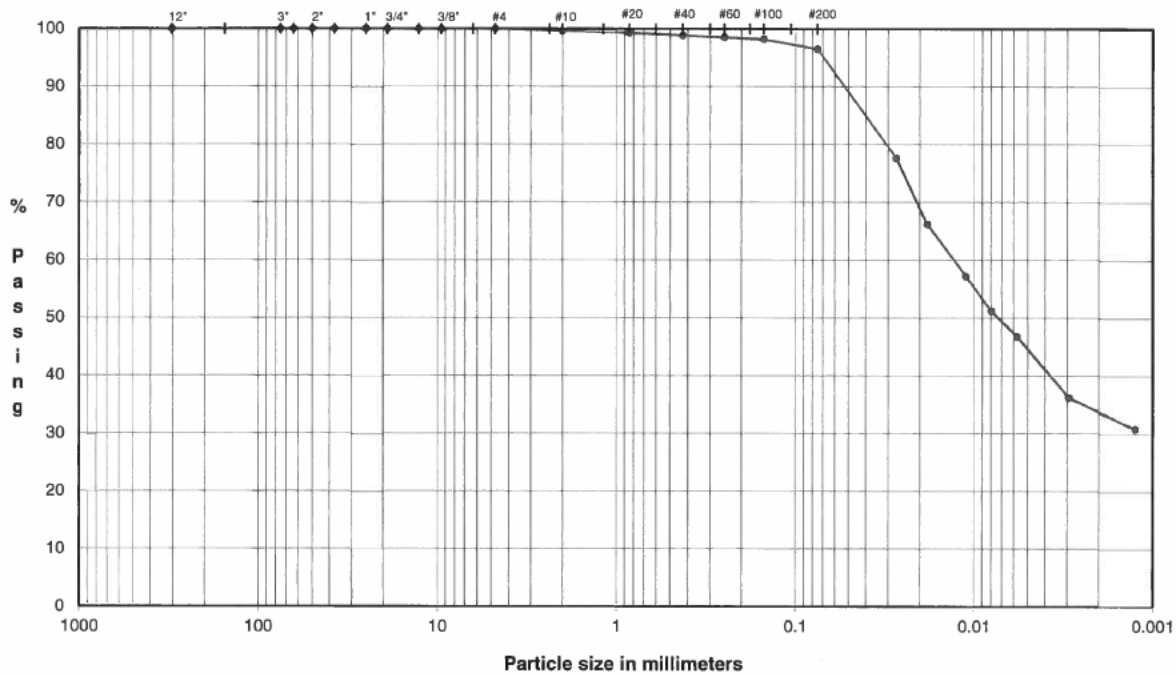


	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers	Particle Size		Particle Size	
	(mm)	% Passing	Classification	Percentage
	12.0"	304.8	100.0	
	3.0"	75.0	100.0	Cobbles
	2.5"	63.5	100.0	0.0
	2.0"	50.0	100.0	
	1.5"	37.5	100.0	
	1.0"	25.0	100.0	
	0.75"	19.0	100.0	Coarse Gravel
	0.50"	12.7	100.0	0.0
	0.375"	9.5	100.0	
	#4	4.8	100.0	Fine Gravel
	#10	2.00	99.6	Coarse Sand
	#20	0.85	99.3	0.4
	#40	0.43	98.8	Medium Sand
	#60	0.25	98.5	0.8
	#100	0.15	98.2	
	#200	0.075	96.5	Fine Sand
				2.3

Hydrometer Analysis	Particle Size		Particle Size	
	(mm)	% Finer	Classification	Percentage
	0.027	77.6		
	0.018	66.1		
	0.011	57.1		
	0.0080	51.1		
	0.0057	46.7		
	0.0029	36.2		
	0.0013	30.9		
			Fines	96.5
			Silt or Clay	

DESCRIPTION: SILTY CLAY, trace fine to coarse sand; trace fine to coarse sand; olive gray.

USCS: CL

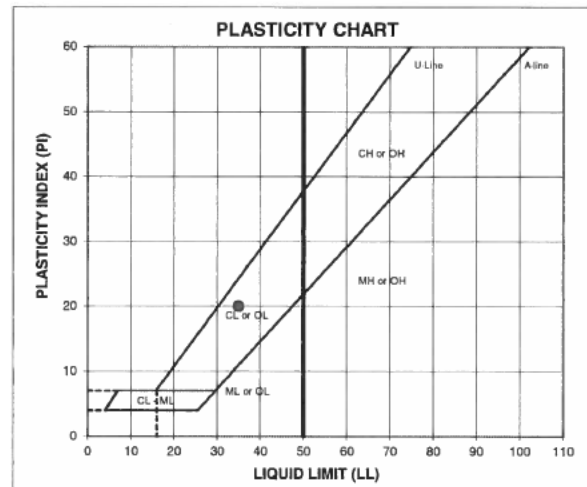

ATTERBERG LIMITS

Method -B (Dry preparation)

M _v	LL	PL	PI	L.I
23.2	35	15	20	0.40

LL (oven-dried)

< 0.75 = ORGANIC (OL/OH)

TECH HH/TB
DATE 7/10/18
CHECK
REVIEW
APPROVE

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE
PROJECT NUMBER
SAMPLE ID
SAMPLE TYPE

FTN/ENTERGY INDEPENDENCE/AR
18103172
B-4 5.0-7.0'
UD

Board #
Flow Pump
Flow Pump Speed
Technician

10
2
5
FT

COMMENTS

Sample Data, Initial

Height, inches	3.085	B-Value, f	1.00
Diameter, inches	2.825	Cell Pres.	88.0
Area, cm ²	40.44	Bot. Pres.	80.0
Volume, cm ³	316.87	Top Pres.	80.0
Mass, g	645.28	Tot. B.P.	80.0
Moisture Content, %	23.2	Head, max.	43.61
Dry Density, pcf	103.1	Head, min.	43.61
Spec. Gravity(assumed)	2.750	Max. Grad.	5.59
Volume Solids, cm ³	190.42	Min. Grad.	5.59
Volume Voids, cm ³	126.46		
Void Ratio	0.66		
Saturation, %	96.2%		

Sample Data, Final

Height, inches	3.074
Diameter, inches	2.818
Area, cm ²	40.24
Volume, cm ³	314.18
Mass, g	647.52
Moisture Content, %	23.66
Dry Density, pcf	104.00
Volume Solids, cm ³	190.42
Volume Voids, cm ³	123.76
Void Ratio	0.65
Saturation, %	100.0%

WATER CONTENTS

	Sample Initial	Sample Final
Wt Soil & Tare, i g	645.28	727.25
Wt Soil & Tare, f g	523.64	603.40
Wt Tare g	0.00	79.88
Wt Moisture Lost g	121.64	123.85
Wt Dry Soil g	523.64	523.52
Water Content %	23.23%	23.66%

DESCRIPTION

SILTY CLAY, trace fine to coarse sand; trace fine to coarse sand; olive gray.

Flow Pump Rate 1.17E-03 cm³/sec

USCS CL

TIME FUNCTIONS, SECONDS								dP	Reading	Head	Gradient	Permeability
DATE	DAY	HOUR	MIN	TEMP	dt	dt,acc	dt	dt,acc				
				(°C)	(min)	(min)	(sec)	(sec)	(psi)	(cm)		(cm/sec)
07/11/18	43292	13	30	22.8	0	0	0	0	0.62	43.61	5.59	4.9E-06
07/11/18	43292	13	32	22.8	2	2	120	120	0.62	43.61	5.59	4.9E-06
07/11/18	43292	13	34	22.8	2	4	120	240	0.62	43.61	5.59	4.9E-06
07/11/18	43292	13	36	22.8	2	6	120	360	0.62	43.61	5.59	4.9E-06 *
07/11/18	43292	13	38	22.8	2	8	120	480	0.62	43.61	5.59	4.9E-06 *
07/11/18	43292	13	40	22.8	2	10	120	600	0.62	43.61	5.59	4.9E-06 *
07/11/18	43292	13	42	22.8	2	12	120	720	0.62	43.61	5.59	4.9E-06 *

TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** 4.9E-06 cm/sec **

DATE 7/11/18
CHECK
REVIEW
APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: B-4

Depth: 15.0-17.0'

TYPE: UD

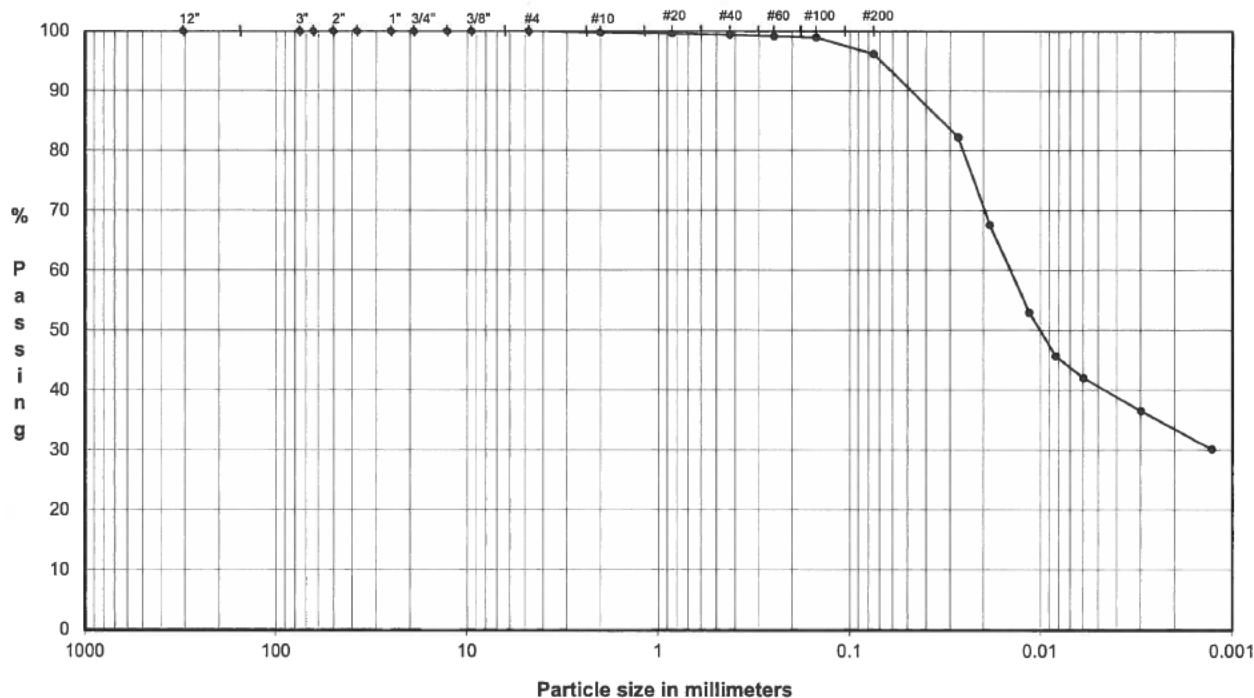

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.7	
#20	0.85	99.5	
#40	0.43	99.3	
#60	0.25	99.1	
#100	0.15	98.8	
#200	0.075	96.1	

Hydrometer Analysis

(mm)	% Finer		
0.027	82.2		
0.018	67.6		
0.011	53.0		
0.0083	45.7		
0.0060	42.0		
0.0030	36.5		
0.0013	30.1		

DESCRIPTION: CLAY, trace fine to coarse sand; brown.

USCS: CH

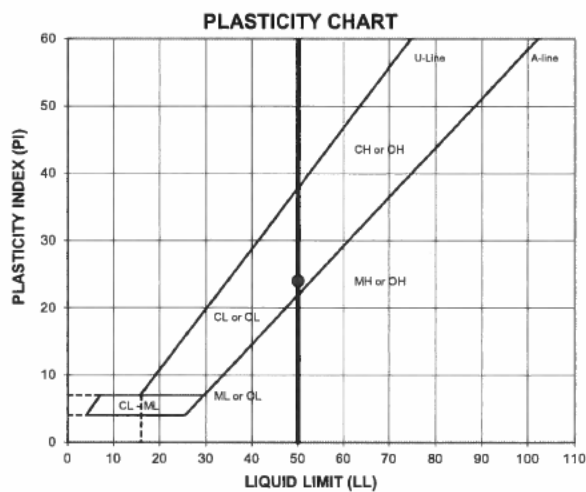ATTERBERG LIMITS
Method -B (Dry preparation)

M _h	LL	PL	PI	LI
34.1	50	26	24	0.36

LL (oven-dried)
< 0.75 = ORGANIC (LOOI)

TECH TJ/BA
DATE 8/29/18
CHECK [Signature]
REVIEW [Signature]
APPROVE [Signature]

SPECIFIC GRAVITY OF SOILS
ASTM D-854
PYCNOMETER METHOD

PROJECT TITLE	FTN/ENTERGY INDEPENDENCE/AR	SAMPLE ID	B-4
PROJECT NUMBER	18103172	SAMPLE TYPE	UD
TESTED FOR	Gs	SAMPLE DEPTH	15.0-17.0'

MOISTURE CONTENT OF MATERIAL PASSING THE #4 SIEVE

Weight Soil and Tare, Initial (gm)	147.69
Weight Soil and Tare, Final (gm)	145.02
Weight Of Tare (gm)	51.54
Weight Of Moisture (gm)	2.67
Weight Of Dry Soil (gm)	93.48
Hygroscopic Moisture In (%)	2.9%

Test Method

Method - B

Pycnometer Number

13

Weight Pycnometer Empty (gm)	177.87
Volume of Pycnometer (gm)	499.40
Weight Pycnometer and Water (gm)	676.24
Mass of Pycnometer and Water at the test Temperature (A)	676.10
Observed Temperature (Tb), for (Mb) In Degrees C	22.50

Weight of Soil, Water & Pycnometer (gm)

(B)

706.51

Temperature, C

22.5

Density of water @ tested temperature (g/ml)

1.00

Tare Number

-

Weight of Dry Soil Slurry plus Tare

48.66

Weight of Tare

0.00

Weight of Dry Soil (gm)

(C)

48.66

Temperature Coefficient

0.9995

SPECIFIC GRAVITY (G)

2.665

$G @ 20^{\circ}C = [C/(A-(B-C))] * (K)$

METHOD - A

WET METHOD

METHOD OF AIR REMOVAL

METHOD - B

OVEN-DRIED METHOD

VACUUM

Recommended Mass for Test Specimen

Soil Type	Specimen Dry Mass when using 500 ml Pycnometer
SP, SP-SM	100
SP-SC, SM, SC	75
SILT OR CLAY	50

TECH
DATE
CHECK
REVIEW
APPROVE

FT
9/4/18

Notes

Visual description (Golder procedure):

Atterberg Limits (ASTM D4318):

Percent Finer (ASTM D422):

Specimen Type:

Remold Targets:

Water Content of Trimmings (ASTM D2216):

Trimming Procedure:

Inundation:

Test Method:

Apparatus:

Final Water Content Specimen:



Final Differential Height:

Estimated Preconsolidation Stress:



LL = 50	PL = 26
3/4 in. = 100%	No. 4 = 100%
<input type="checkbox"/> Intact	<input type="checkbox"/> Reconstituted
-	
trimming ring	
<input type="checkbox"/> Not inundated	<input checked="" type="checkbox"/> Inundated at
<input type="checkbox"/> A	<input checked="" type="checkbox"/> B
GeoTac automated consolidometer	
<input checked="" type="checkbox"/> Entire	<input type="checkbox"/> Partial
0.0000 in	
ksf	

Seating	1
	2
	3
	4
	5
	6
	7
	8
	9
	10
	11
	12
	13




Figure: 1

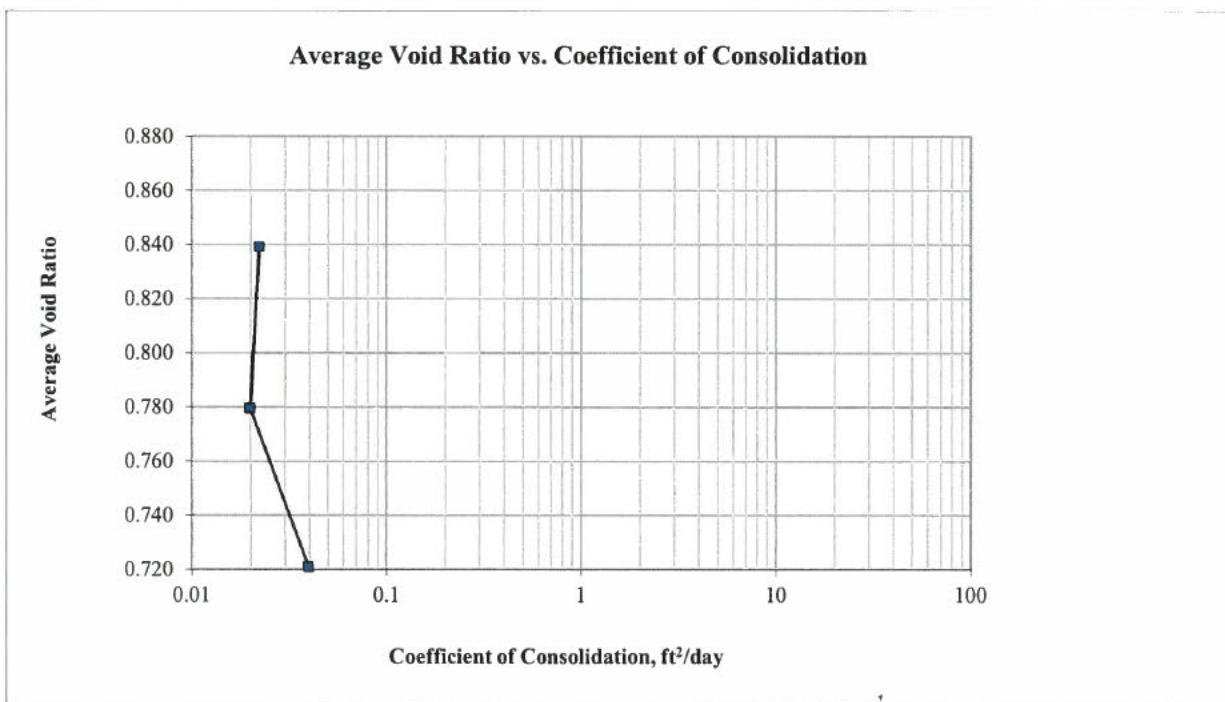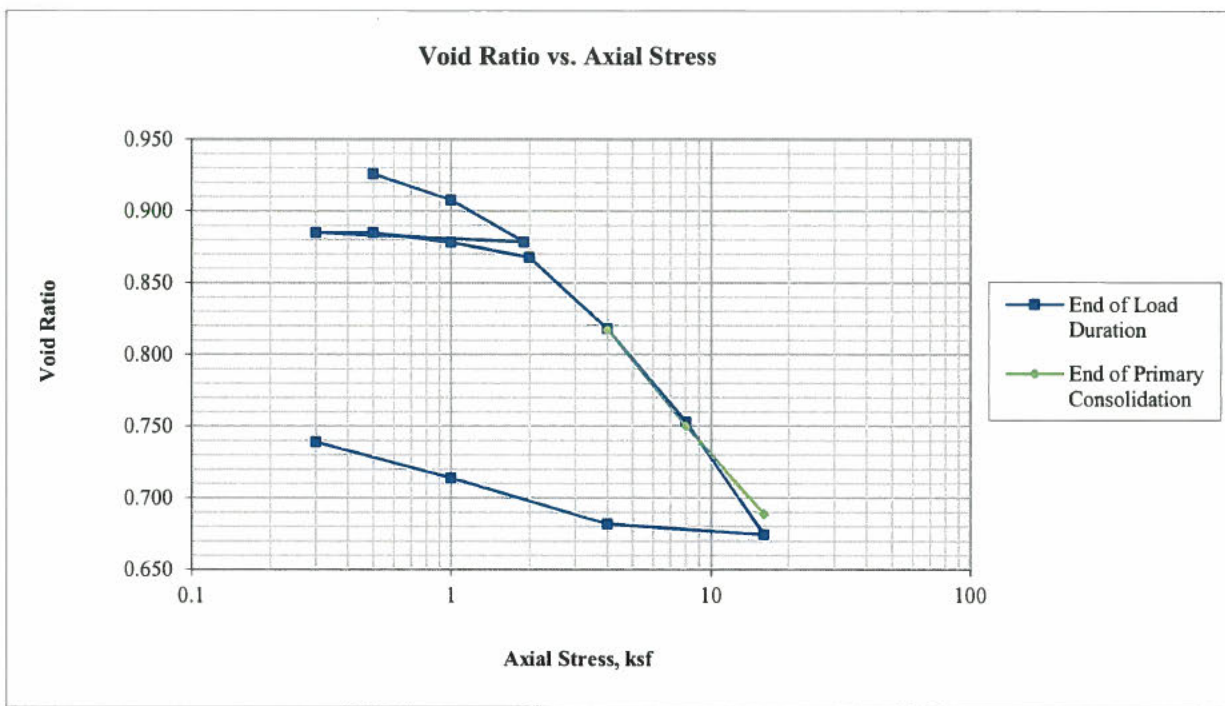


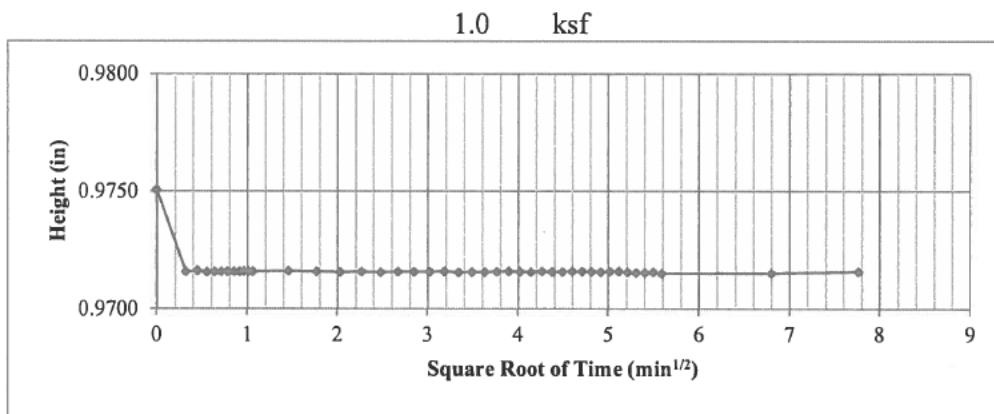
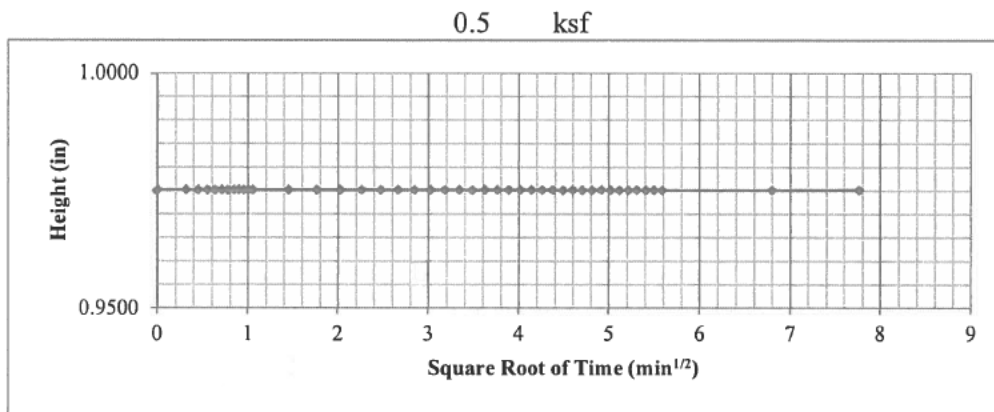
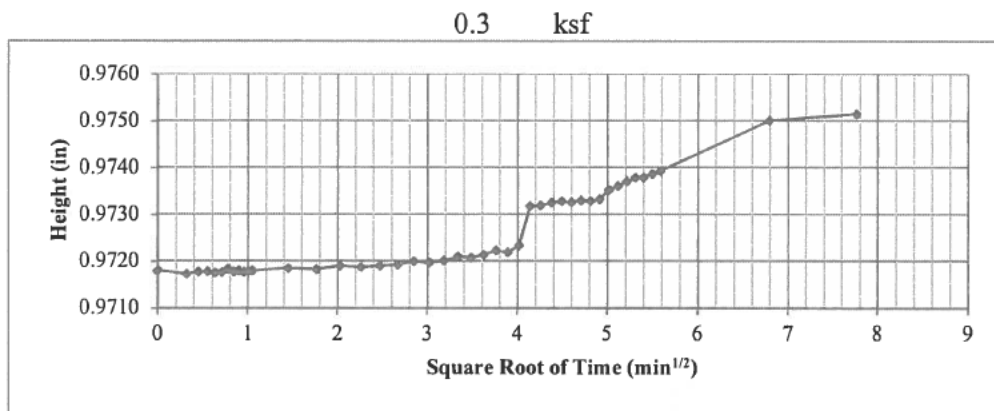
Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT CONSOLIDATION PLOTS				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: DA	Start Date: 9/4/2018	Job Number: 18103172	Figure: 2	

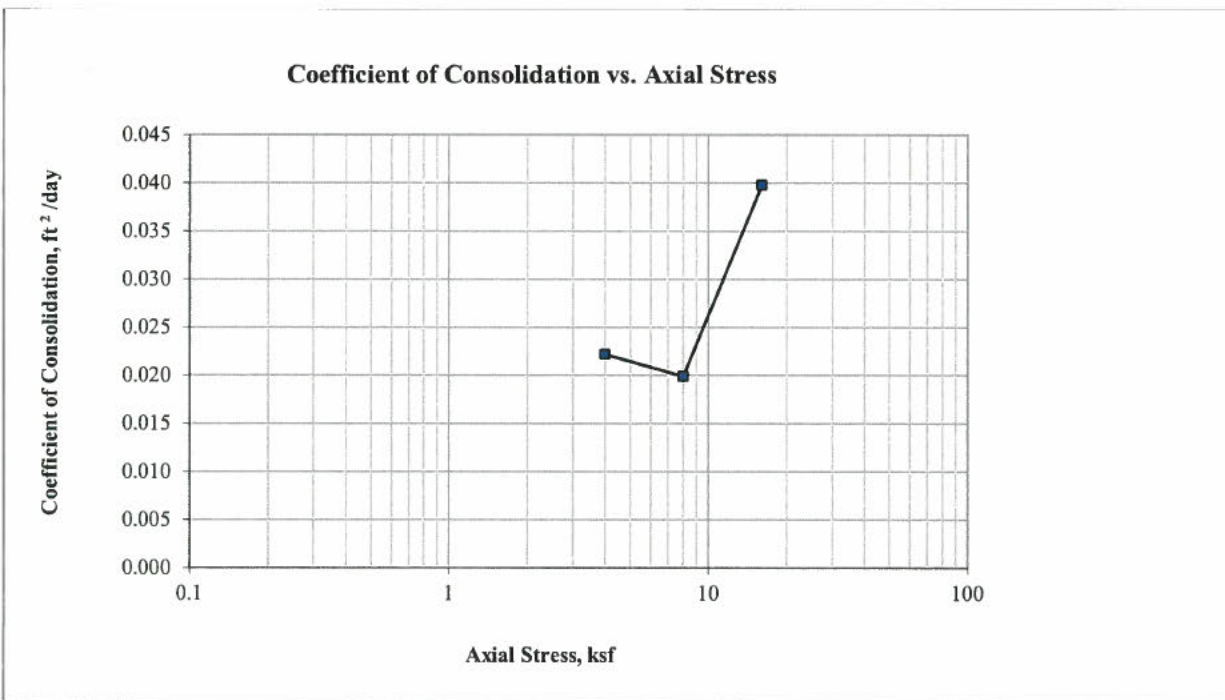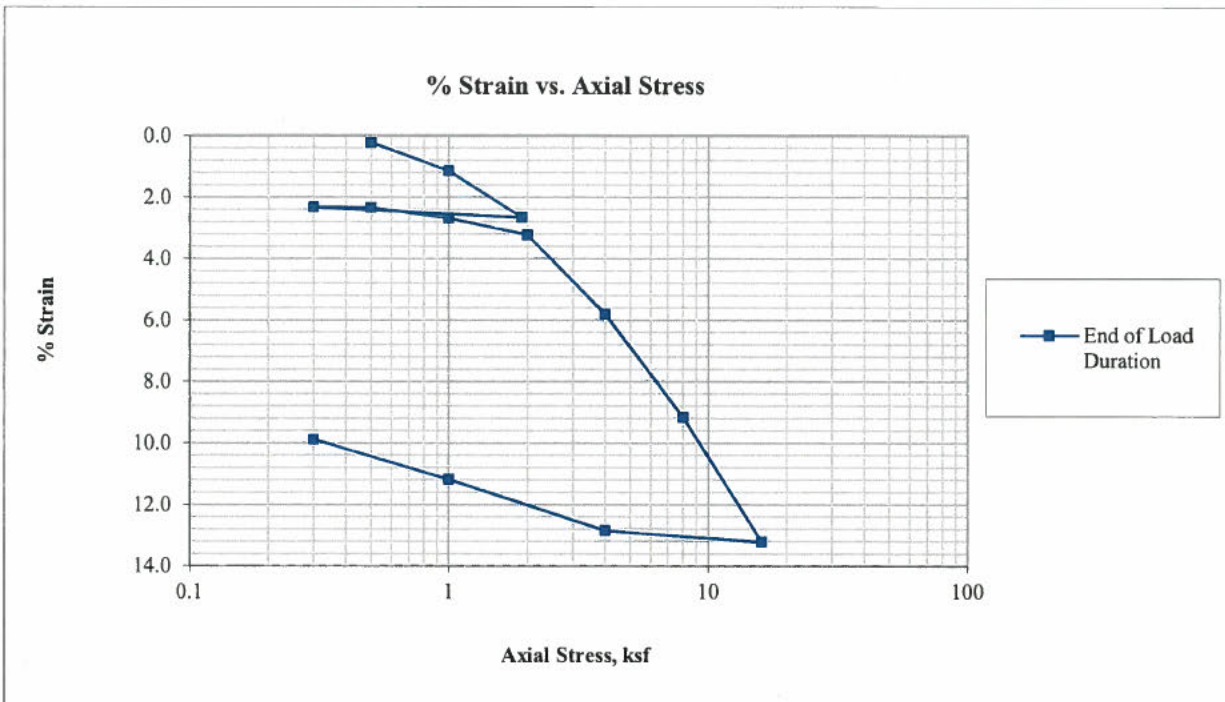




Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT CONSOLIDATION PLOTS			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: DA	Start Date: 9/4/2018	Job Number: 18103172	Figure: 2A

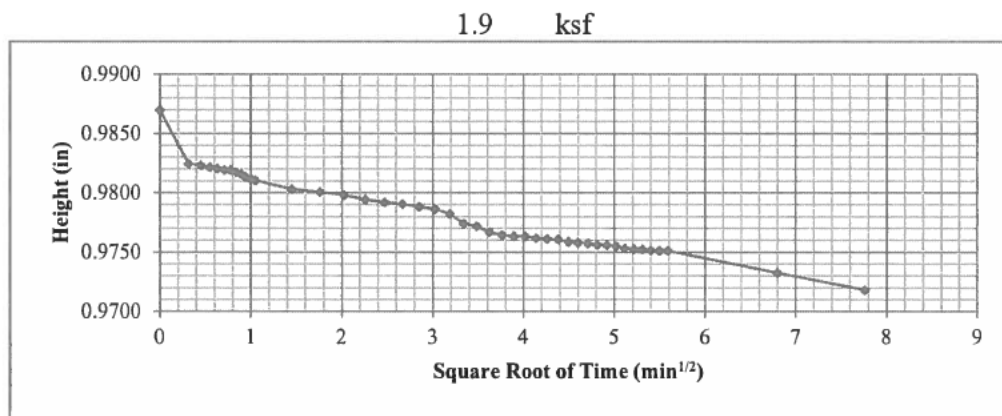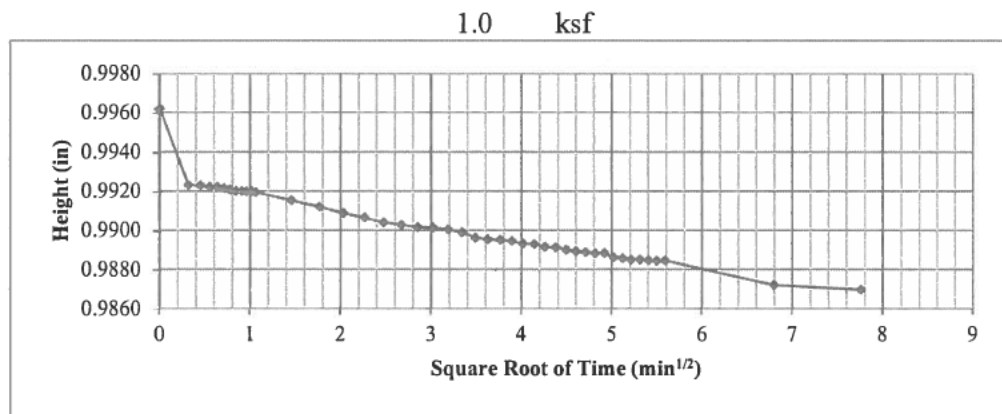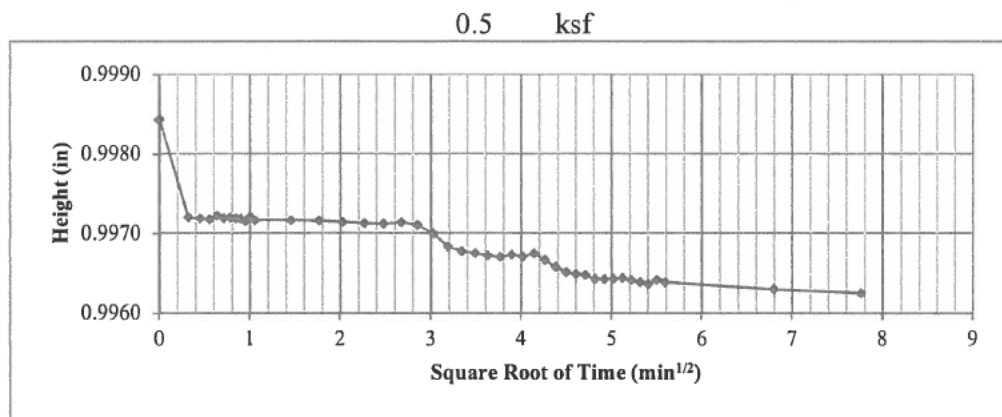




Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT TIME-DEFORMATION PLOTS (1)			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR					
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: 	Start Date: 9/4/2018	Job Number: 18103172	Figure: 3




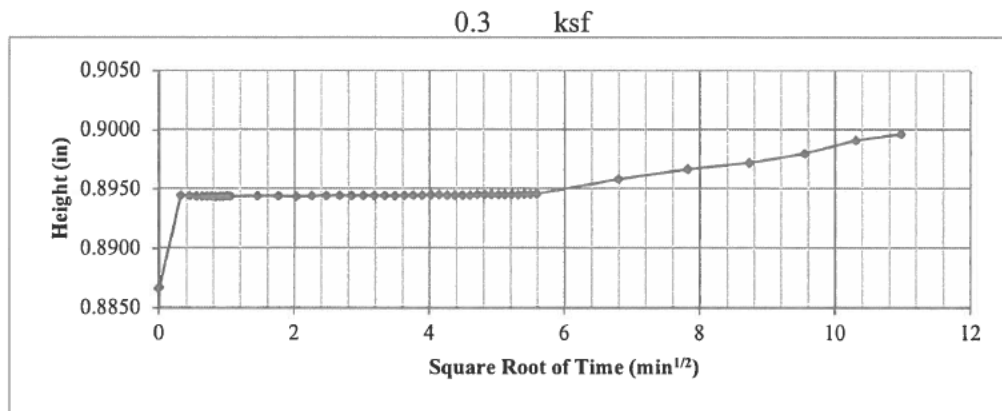
Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT TIME-DEFORMATION PLOTS (2)			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR					
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: 	Start Date: 9/4/2018	Job Number: 18103172	Figure: 4

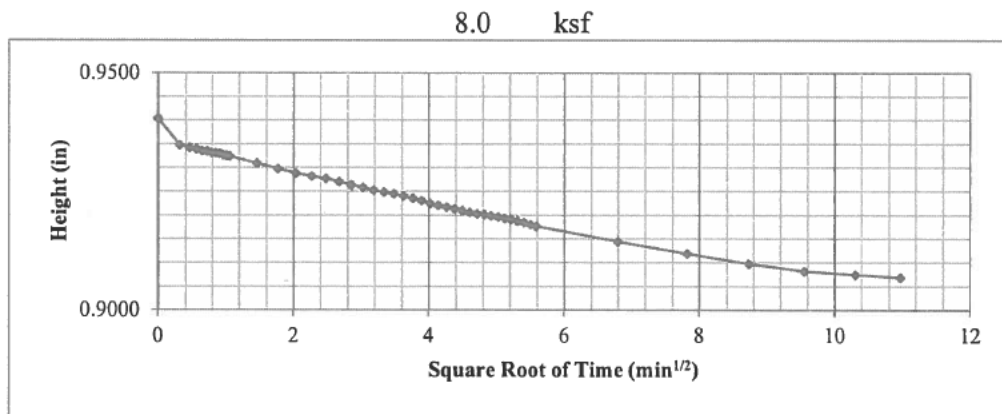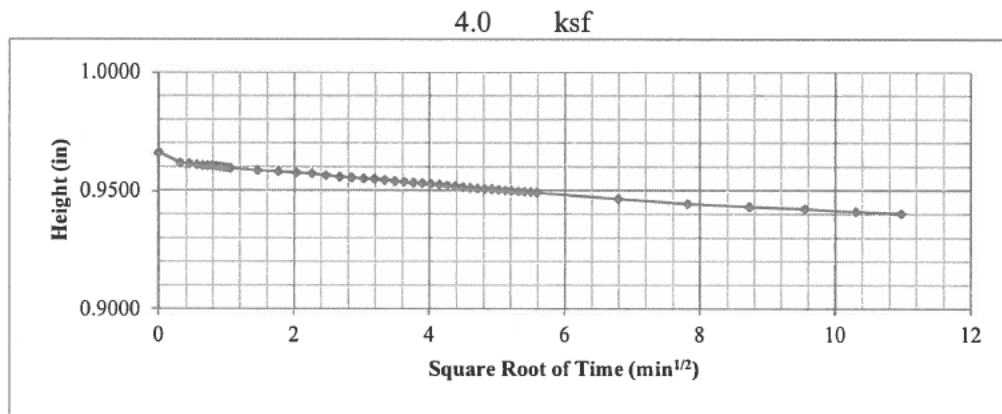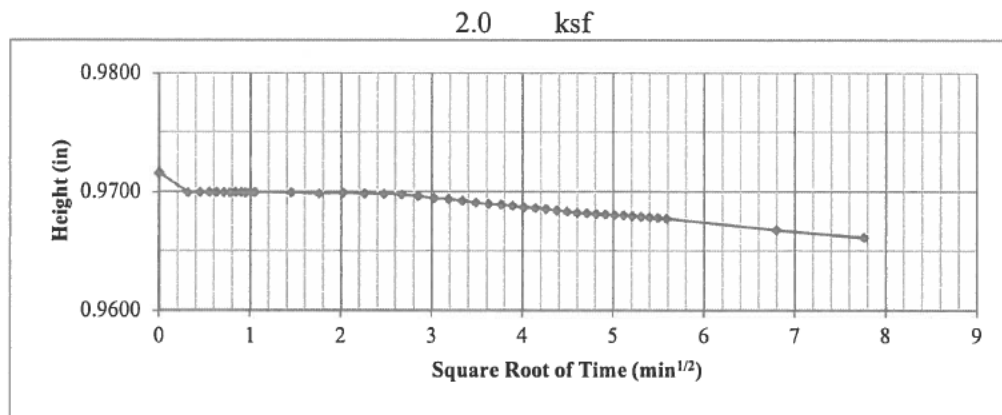


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT TIME-DEFORMATION PLOTS (3)				
Job Short Title: FTN/ENERGY INDEPENDENCE/AR						
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: 	Start Date: 9/4/2018	Job Number: 18103172	Figure: 5	

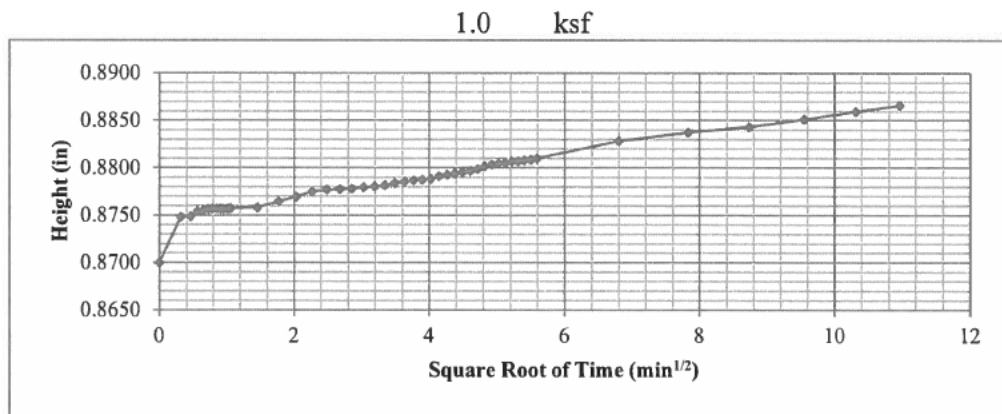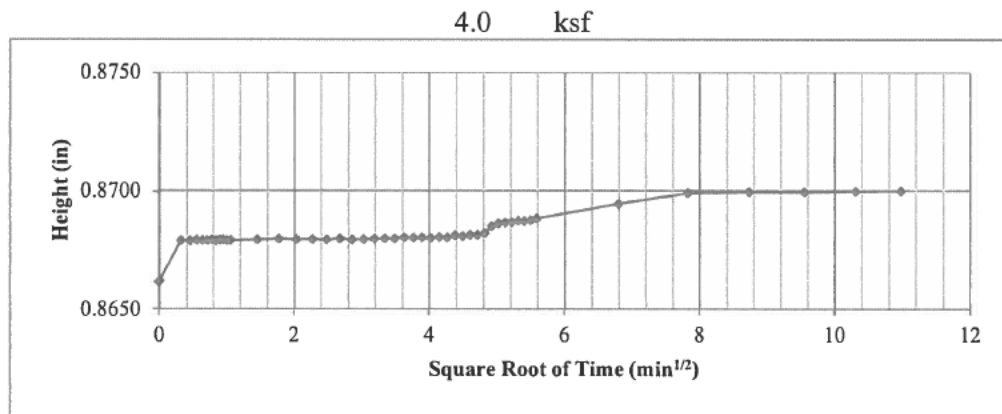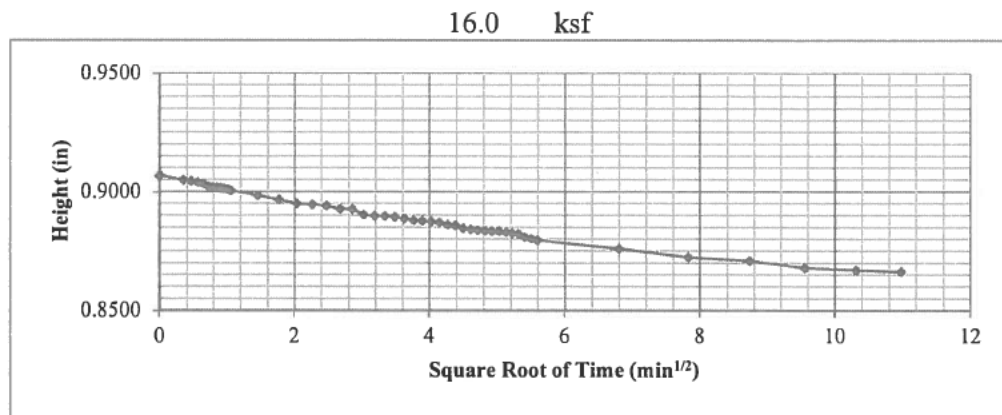

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT TIME-DEFORMATION PLOTS (4)			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR					
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: 	Start Date: 9/4/2018	Job Number: 18103172	Figure: 6



Golder Associates Inc. Atlanta, Georgia		Title: ASTM D2435 ONE-DIMENSIONAL CONSOLIDATION TEST REPORT TIME-DEFORMATION PLOTS (5)			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-4 UD 15.0-17.0'	Technician: PWM/FT	Reviewed: 	Start Date: 9/4/2018	Job Number: 18103172	Figure: 7

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENERGY INDEPENDENCE/AR

SAMPLE ID: B-4

Depth: 20.0-22.0'

TYPE: UD

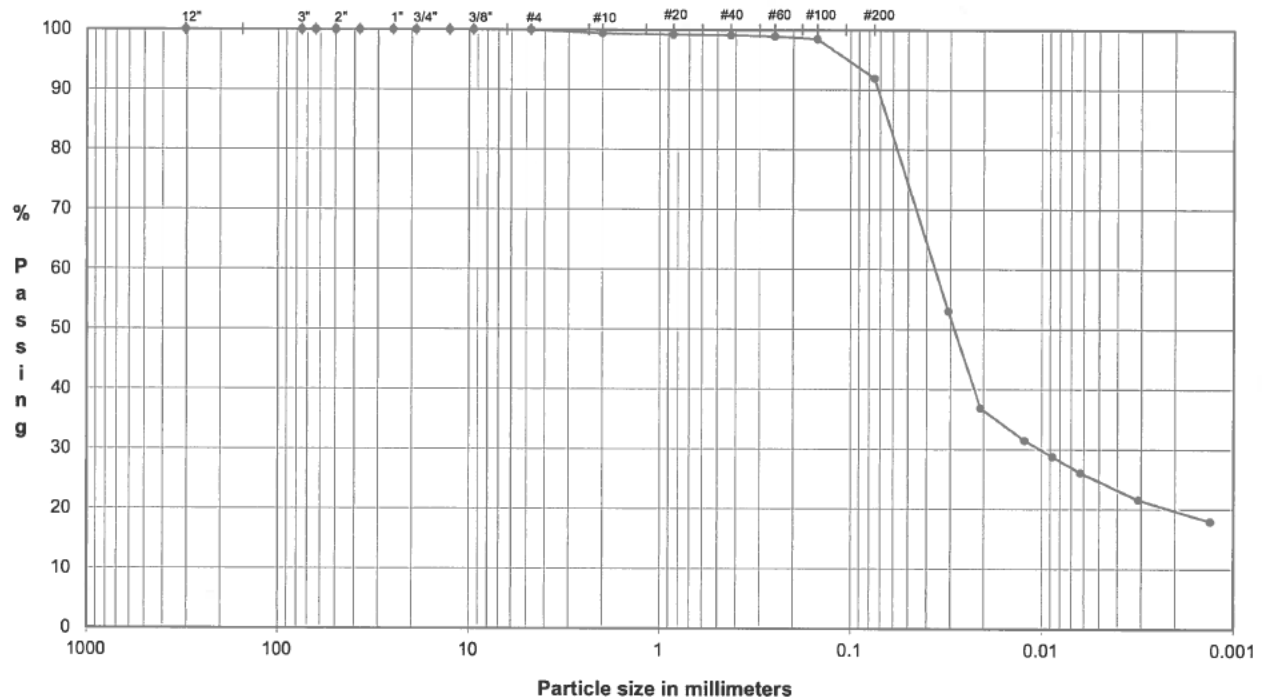

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.4	
#20	0.85	99.2	
#40	0.43	99.1	
#60	0.25	98.9	
#100	0.15	98.5	
#200	0.075	91.9	


U.S. Standard Sieves Sizes and Numbers

(mm)	% Finer	Classification	Percentage
0.031	53.1		
0.021	36.9		
0.012	31.5		
0.0088	28.8		
0.0063	26.1		
0.0031	21.6		
0.0013	18.0		

Hydrometer Analysis

DESCRIPTION: SILTY CLAY, some fine to coarse sand; yellowish brown and gray.

USCS: CL

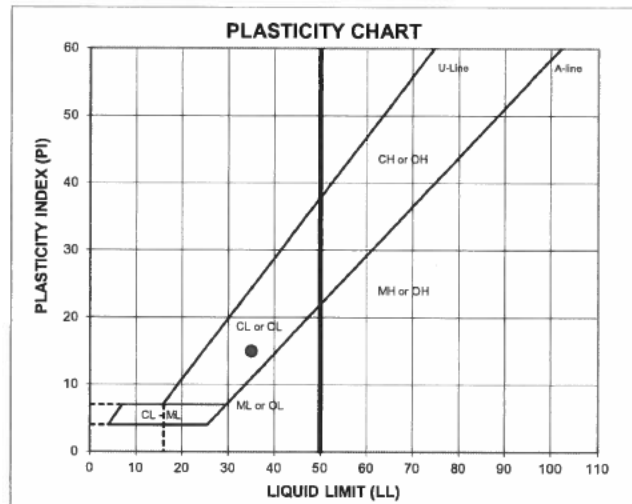ATTERBERG LIMITS
Method -B (Dry preparation)

ML	LL	PL	PI	LI
27.4	35	20	15	0.51

LL (oven-dried)
0.75 - ORGANIC (OL/OH)

TECH TB/HH
DATE 7/10/18
CHECK [Signature]
REVIEW [Signature]
APPROVE [Signature]

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE FTN/ENTERGY INDEPENDENCE/AR
PROJECT NUMBER 18103172
SAMPLE ID B-4 20.0-22.0'
SAMPLE TYPE UD

Board # 11
Flow Pump 2
Flow Pump Speed 6
Technician FT/PWM

COMMENTS

Sample Data, Initial

Height, inches	3.133	B-Value, f	0.99
Diameter, inches	2.818	Cell Pres.	88.0
Area, cm ²	40.24	Bot. Pres.	80.0
Volume, cm ³	320.21	Top Pres.	80.0
Mass, g	620.34	Tot. B.P.	80.0
Moisture Content, %	27.4	Head, max.	77.37
Dry Density, pcf	94.9	Head, min.	77.37
Spec. Gravity(assumed)	2.750	Max. Grad.	9.78
Volume Solids, cm ³	177.02	Min. Grad.	9.78
Volume Voids, cm ³	143.18		
Void Ratio	0.81		
Saturation, %	93.3%		

Sample Data, Final

Height, inches	3.114
Diameter, inches	2.787
Area, cm ²	39.36
Volume, cm ³	311.30
Mass, g	622.49
Moisture Content, %	27.87
Dry Density, pcf	97.58
Volume Solids, cm ³	177.02
Volume Voids, cm ³	134.28
Void Ratio	0.76
Saturation, %	100.0%

WATER CONTENTS

	Sample Initial	Sample Final
Wt Soil & Tare, i g	620.34	735.96
Wt Soil & Tare, f g	486.82	600.38
Wt Tare g	0.00	113.89
Wt Moisture Lost g	133.52	135.58
Wt Dry Soil g	486.82	486.49
Water Content %	27.43%	27.87%

DESCRIPTION

SILTY CLAY, some fine to coarse sand; yellowish brown and gray.

Flow Pump Rate 4.70E-04 cm³/sec

USCS CL

TIME FUNCTIONS, SECONDS								dP	Reading (psi)	Head (cm)	Gradient	Permeability (cm/sec)
DATE	DAY	HOUR	MIN	TEMP (°C)	dt (min)	dt,acc (min)	dt (sec)	dt,acc (sec)				
07/11/18	43292	12	0	22.6	0	0	0	0	1.10	77.37	9.78	1.1E-06
07/11/18	43292	12	5	22.6	5	5	300	300	1.10	77.37	9.78	1.1E-06
07/11/18	43292	12	10	22.6	5	10	300	600	1.10	77.37	9.78	1.1E-06
07/11/18	43292	12	15	22.6	5	15	300	900	1.10	77.37	9.78	1.1E-06 *
07/11/18	43292	12	20	22.6	5	20	300	1200	1.10	77.37	9.78	1.1E-06 *
07/11/18	43292	12	25	22.6	5	25	300	1500	1.10	77.37	9.78	1.1E-06 *
07/11/18	43292	12	30	22.6	5	30	300	1800	1.10	77.37	9.78	1.1E-06 *

TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** 1.1E-06 cm/sec **


DATE 7/11/18
CHECK
REVIEW
APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: B-5
 TYPE: UD

Depth: 3.0-5.0'

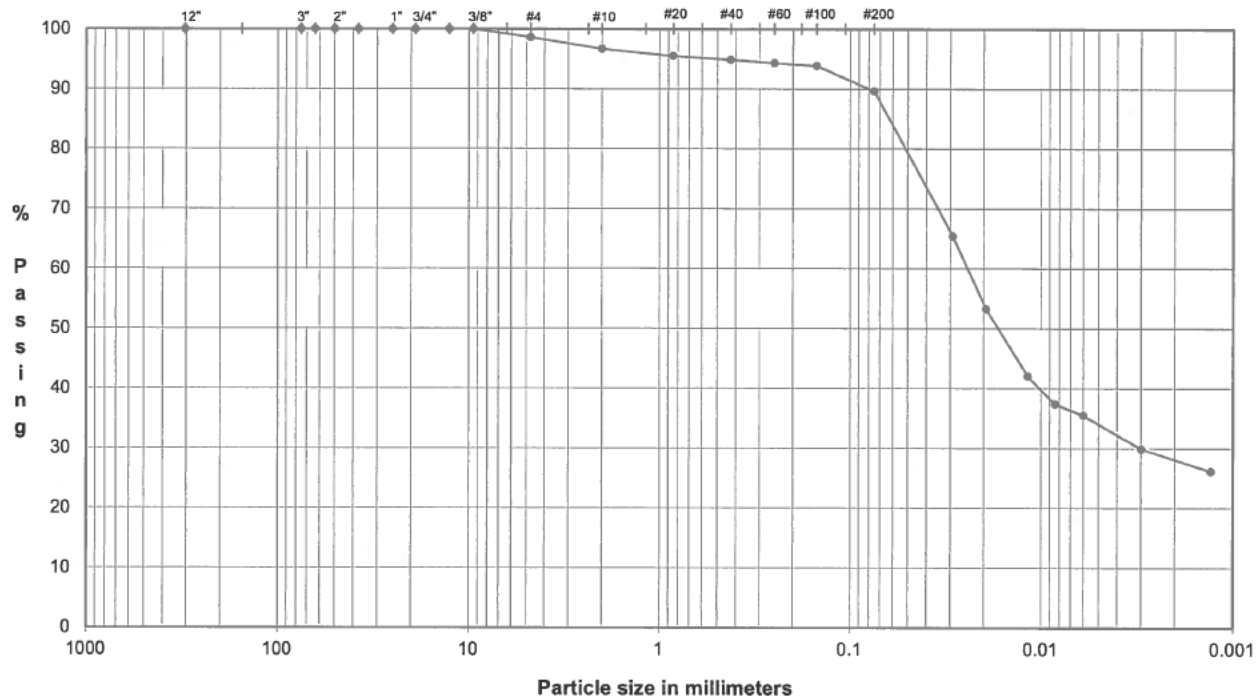

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	98.6	1.4
#10	2.00	96.7	1.9
#20	0.85	95.5	
#40	0.43	94.9	1.8
#60	0.25	94.3	
#100	0.15	93.9	
#200	0.075	89.6	5.3

Hydrometer Analysis

(mm)	% Finer		
0.029	65.4		
0.019	53.3		
0.012	42.1		
0.0084	37.4		
0.0060	35.5		
0.0030	29.9		
0.0013	26.2		

DESCRIPTION: SILTY CLAY, some fine to coarse sand, trace fine gravel; dark grayish brown.

USCS: CL

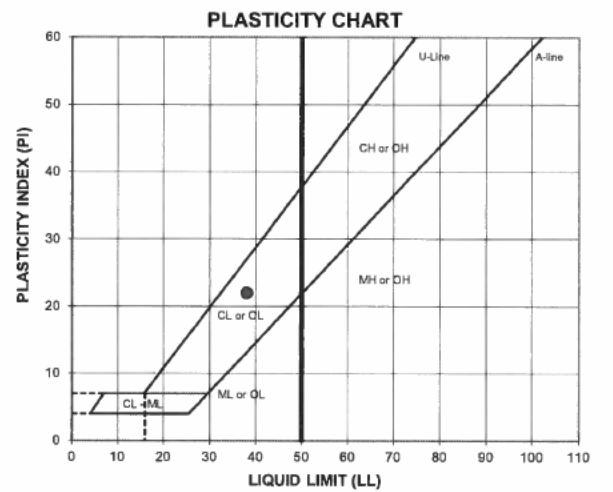

ATTERBERG LIMITS
 Method -B (Dry preparation)

ML	LL	PL	PI	LI
19.0	38	16	22	0.13

LL (oven-dried)
 0.75 ORGANIC (LO/OH)

TECH TB/HH
 DATE 6/18/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

Boring or Test Pit: **B-5**
Sample: **UD**
Depth: **3.0-5.0** ft
Point No.: **1**

Boring or Test Pit:
Sample:
Depth:
Point No.:

Boring or Test Pit: **B-5**
Sample: **UD**
Depth: **3.0-5.0** ft
Point No.:

Initial

Length = **6.067** in
Diameter = **2.859** in
Wet Mass = 2.898 lb
Area = 6.420 in²
Volume = 38.949 in³
Specific Gravity = **2.69** (ASTM D854)
Dry Mass of Solids = 2.426 lb
Moisture Content = 19.5%
Wet Unit Weight = 128.6 pcf
Dry Unit Weight = 107.6 pcf
Void Ratio = 0.56
Percent Saturation = 94%

Length = 6.048
Diameter = 2.878
Wet Mass =
Area =
Volume =
Specific Gravity =
Dry Mass of Solids =
Moisture Content =
Wet Unit Weight =
Dry Unit Weight =
Void Ratio =
Percent Saturation =

Length = 5.989
Diameter = 2.869
Wet Mass = 2.914
Area = 6.465
Volume = 38.717
Specific Gravity = 2.69
Dry Mass of Solids = 2.460
Moisture Content = 18.5%
Wet Unit Weight = 130.1
Dry Unit Weight = 109.8
Void Ratio = 0.53
Percent Saturation = 94%

After Consolidation

Length = 6.048 in
Diameter = 2.878 in
Area = 6.505
Volume = 39.345
Moisture Content =
Wet Unit Weight =
Dry Unit Weight =
Void Ratio =
Percent Saturation =

After Consolidation
Length = 5.912 in
Diameter = 2.911 in
Area = 6.655
Volume = 39.345
Moisture Content = 21.3%
Wet Unit Weight = 129.3
Dry Unit Weight = 106.5
Void Ratio = 0.57
Percent Saturation = 100%

After Consolidation

Length = 5.970 in
Diameter = 2.875 in
Area = 6.491 in² (Method B)
Volume = 38.753 in³
Moisture Content = 19.6%
Wet Unit Weight = 131.3 pcf
Dry Unit Weight = 109.7 pcf
Void Ratio = 0.53
Percent Saturation = 100%

B Parameter = **0.99**
Shear Rate = 0.090% /min.
t₅₀ = **0.5** min.
Strain at Failure = 1.8%

B Parameter = --
Shear Rate = 0.024% /min.
t₅₀ = **15.3** min.
Strain at Failure = 3.4%

B Parameter = **0.98**
Shear Rate = 0.015% /min.
t₅₀ = **5.8** min.
Strain at Failure = 2.4%

Cell Pressure = **74.0** psi
Back Pressure = **70.0** psi
Confining Pressure = 4.0 psi

Cell Pressure = **78.0** psi
Back Pressure = **70.0** psi
Confining Pressure = 8.0 psi

Cell Pressure = **82.0** psi
Back Pressure = **70.0** psi
Confining Pressure = 12.0 psi

Notes: Sample description: **(CL) SILTY CLAY, some fine to coarse sand, trace fine gravel; dark grayish brown.**
Atterberg limits: LL = **38** PL = **16** PI = **22** (ASTM D4318)
Percent finer: 3/4 in. = **100.0%** No. 4 = **99%** No. 200 = **90%** (ASTM D422, refer to separate report for gradation curve)
Specimen type: ☒ Intact ☐ Reconstituted
Moisture from: ☐ Cuttings ☒ Entire specimen
Saturation method: ☒ Wet ☐ Dry
Failure criterion: ☒ (σ₁/σ₃)_{max} ☐ (σ₁-σ₃)_{max} % strain
Membrane effect: ☒ Corrected ☐ Not Corrected

Golder Associates Inc.
Atlanta, Georgia

Title:

MODIFIED (Multi-Stage) - ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SAMPLE AND TEST DATA

Job Short Title:

FTN/ENERGY INDEPENDENCE/AR

Sample:

B-5 UD 3.0-5.0'

Technician:

FT/PWM

Check:

10/14

Reviewed:

gn

Approved:

Start Date:



6/22/2018

Job Number:



18103172

Figure:

1

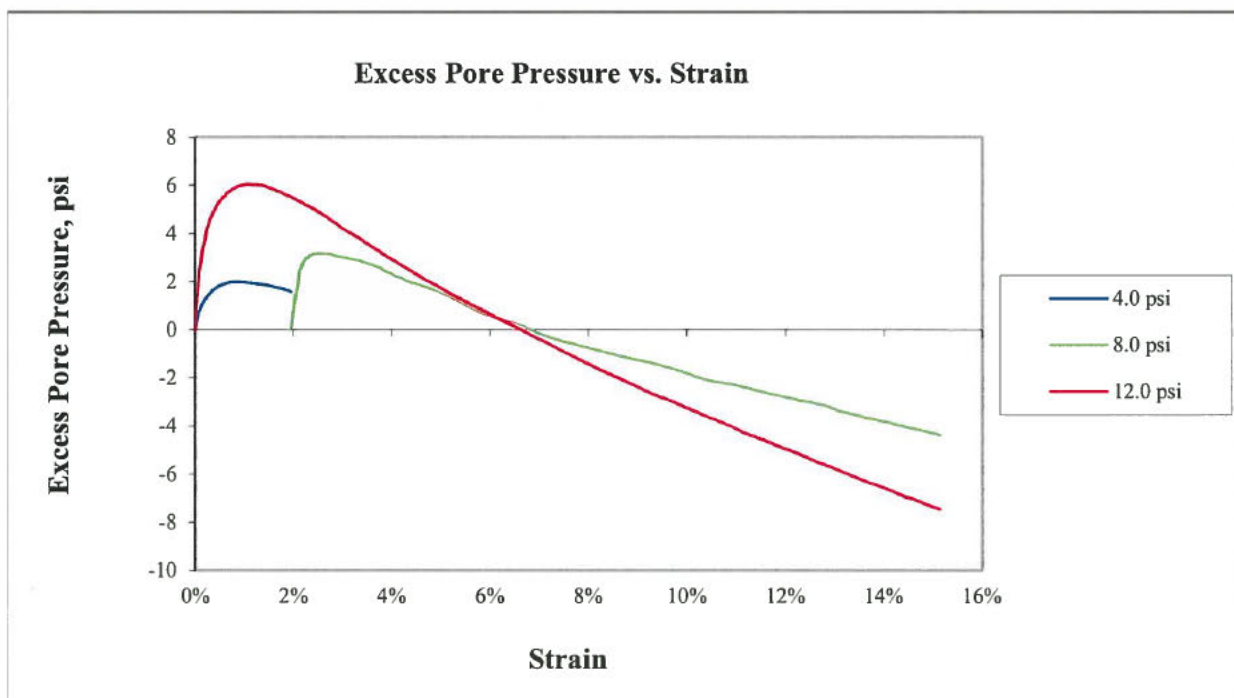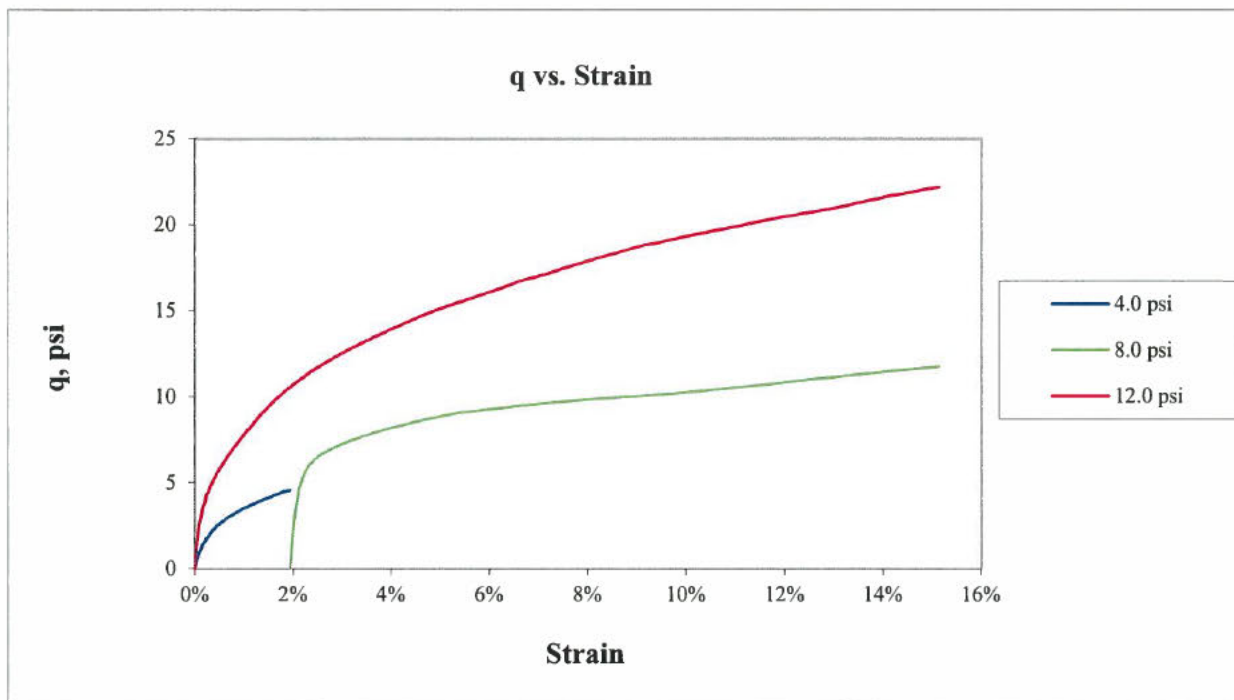


Golder Associates Inc. Atlanta, Georgia		Title: MODIFIED (Multi-Stage) - ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-5 UD 3.0-5.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/22/2018	Job Number: 18103172
					Figure: 2

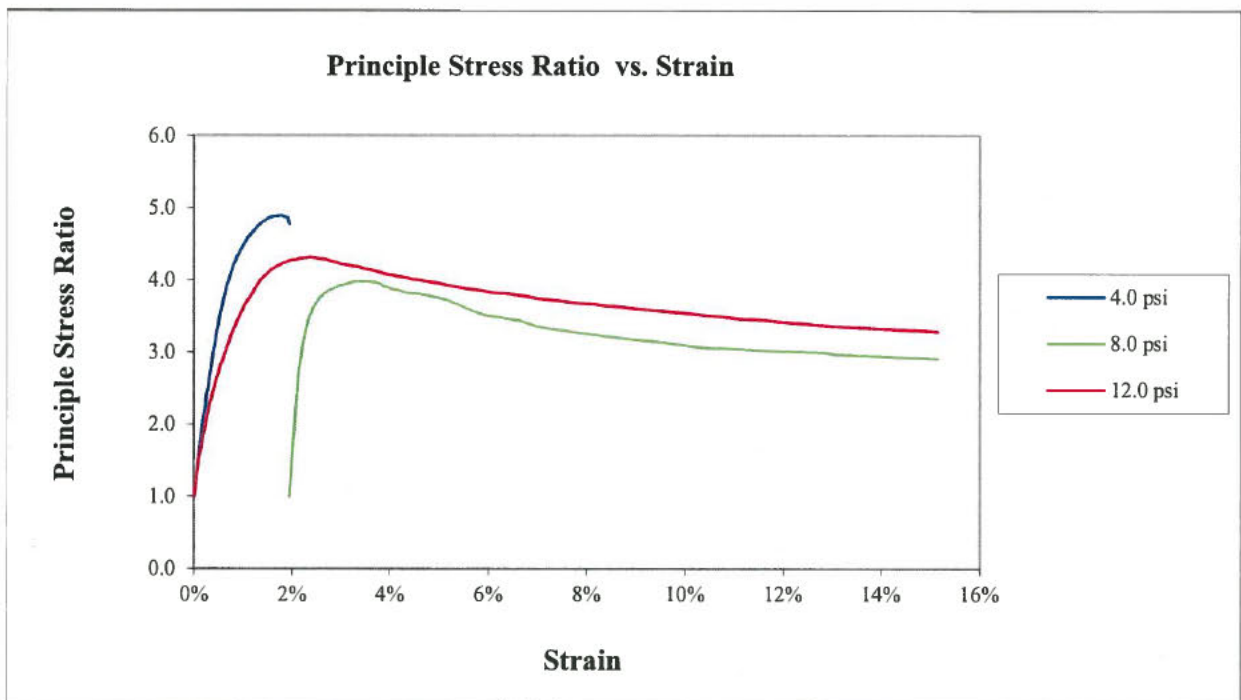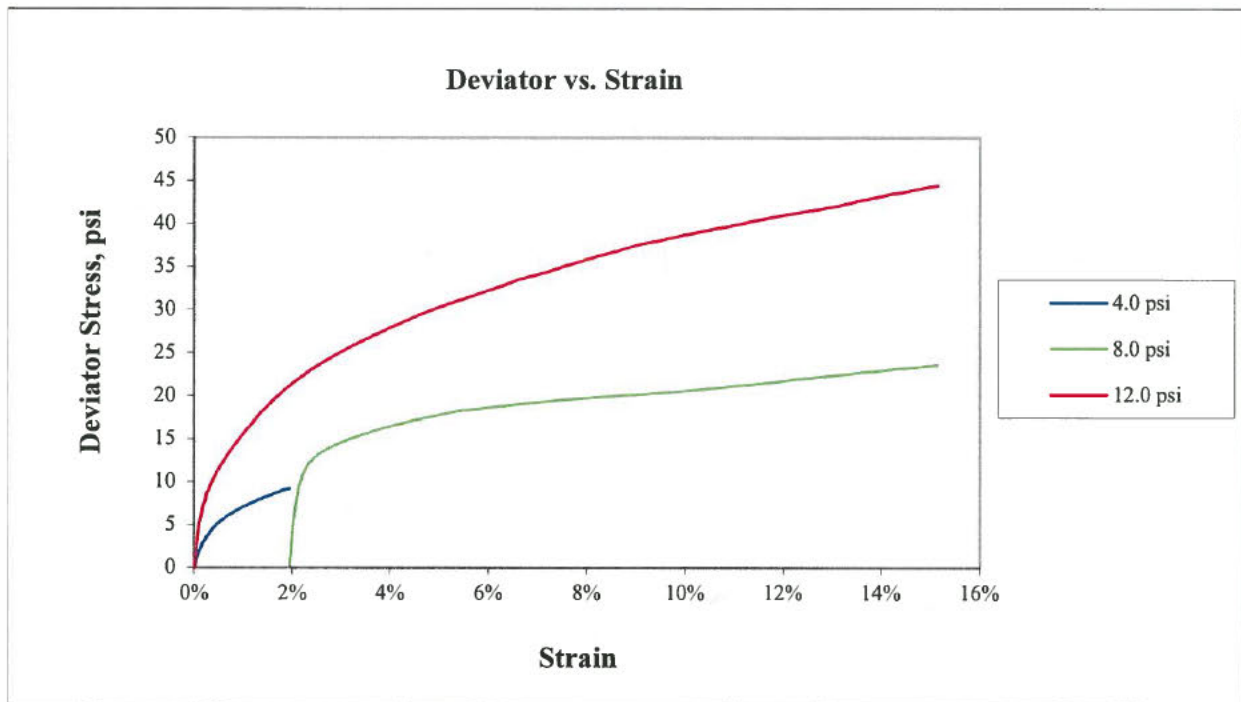

Golder Associates Inc. Atlanta, Georgia		Title: MODIFIED (Multi-Stage) - ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: B-5 UD 3.0-5.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/22/2018	Job Number: 18103172
				Figure: 3	

Stress Path (p'-q) Plot

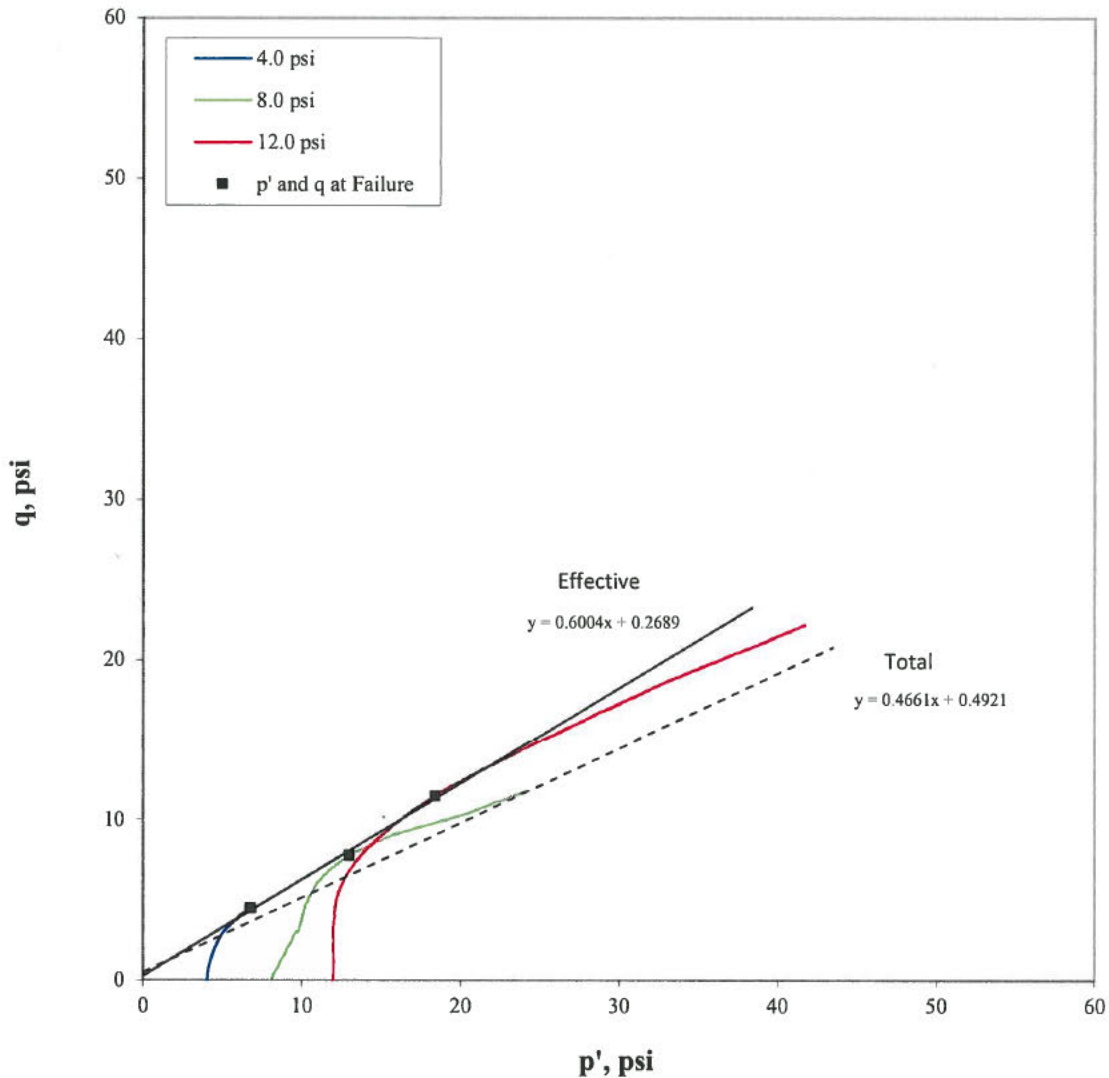


Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
4.0	8.5	6.8	4.5
8.0	15.8	13.0	7.8
12.0	23.5	18.4	11.5

Effective		
α'	31.0	degree
a'	0.3	psi
Total		
α	25.0	degree
a	0.5	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: MODIFIED (Multi-Stage) - ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT STRESS PATH PLOT				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-5 UD 3.0-5.0'		Technician: FT/PWM Check: 	Reviewed: Approved:	Start Date: 6/22/2018	Job Number: 18103172	Figure: 4

Mohr's Circle Diagram

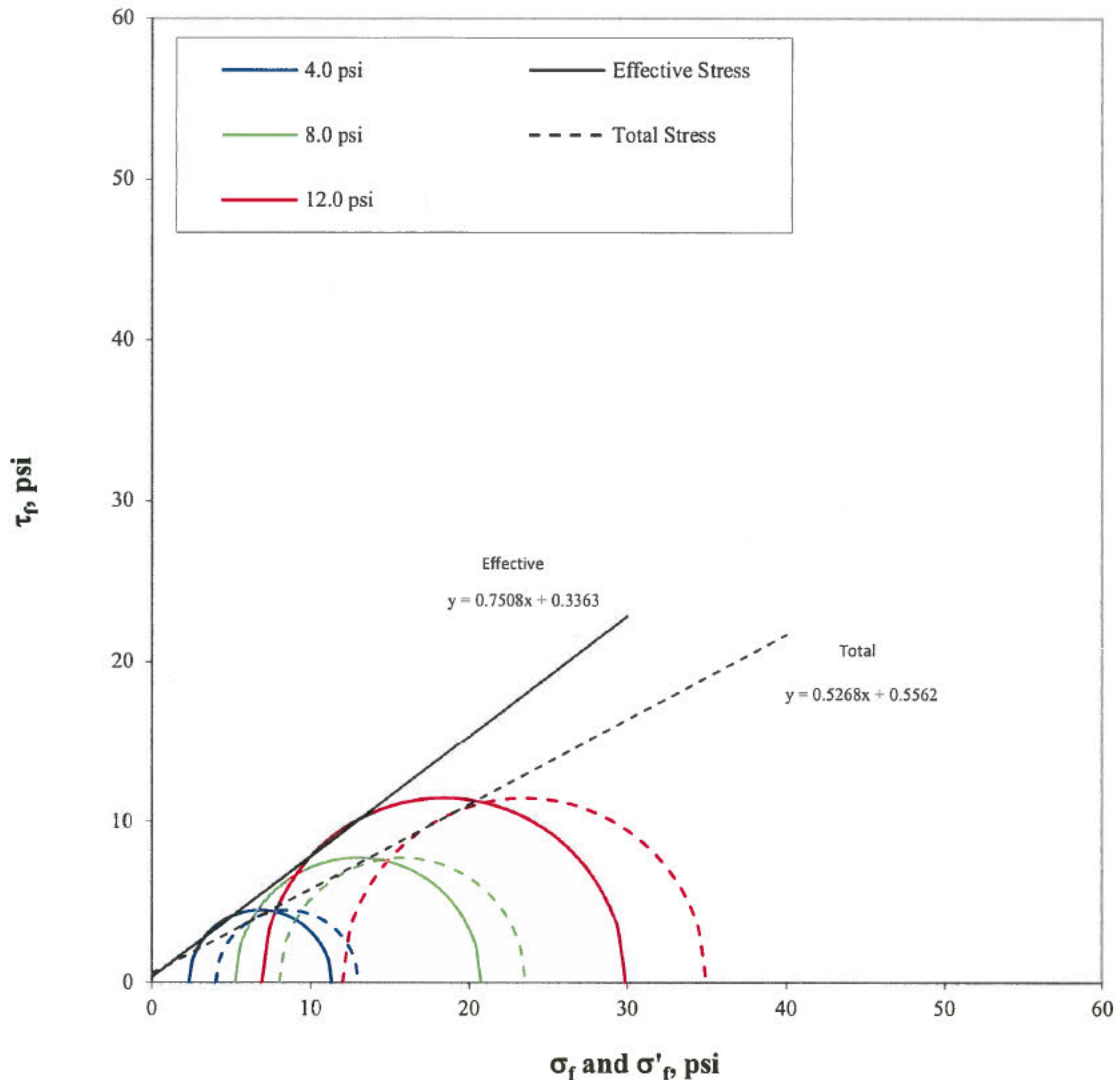

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
4.0	11.3	2.3	13.0	4.0
8.0	20.7	5.2	23.5	8.0
12.0	29.9	6.9	34.9	12.0

Effective
 $\phi' = 36.9$ degree
 $c' = 0.3$ psi

Total
 $\phi = 27.8$ degree
 $c = 0.6$ psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: MODIFIED (Multi-Stage) - ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT MOHR'S CIRCLE DIAGRAM				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: B-5 UD 3.0-5.0'		Technician: FT/PWM Check: 	Reviewed: Approved:	Start Date: 6/22/2018	Job Number: 18103172	Figure: 5

4 & 8 psi



12 psi



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:

FTN/ENTERGY INDEPENDENCE/AR

Title:

MODIFIED (Multi-Stage) - ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SPECIMEN PHOTOGRAPH - Two Specimen

Sample:

B-5 UD 3.0-5.0'

Technician:

FT/PWM

Check:

[Signature]

Reviewed:

[Signature]

Approved:

Start Date:

6/22/2018

Job Number:

18103172

Figure:

6


August-18

18103172


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/Entergy Independence/AR
SAMPLE ID: RP-4D
TYPE: Bag

DEPTH (ft): 38-39

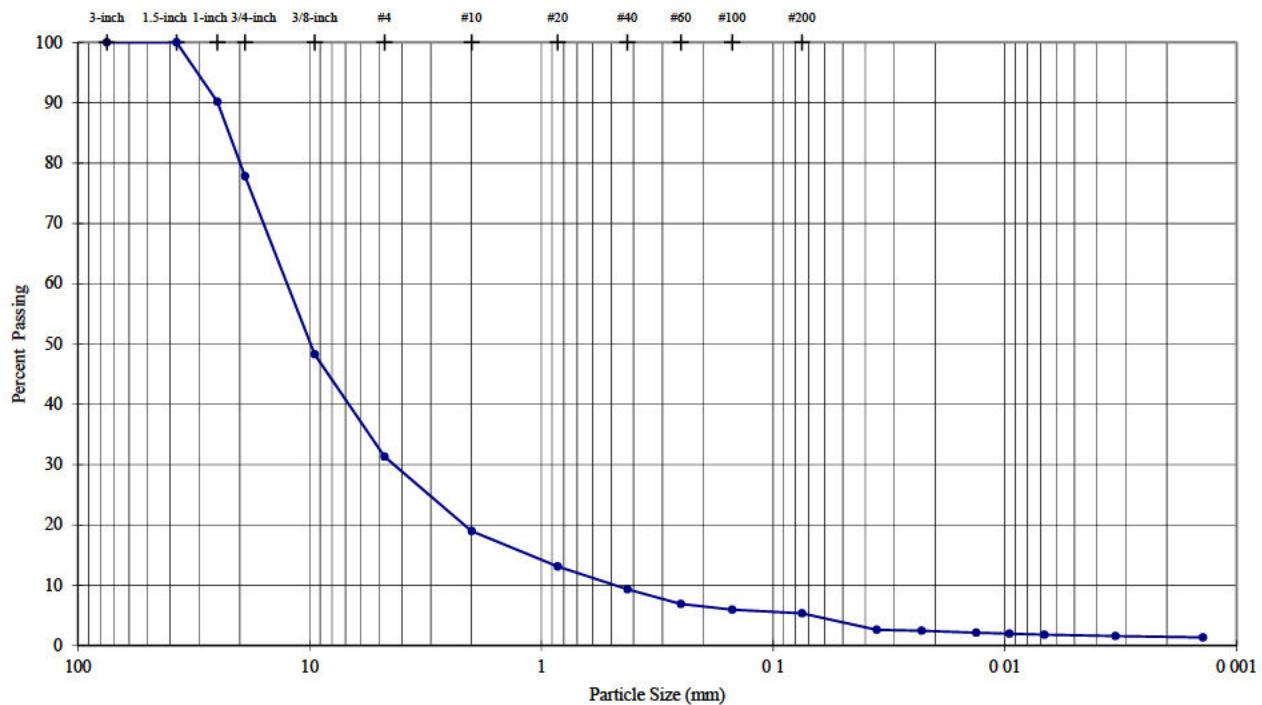

Sieve	Particle Size		Description	Percentage
	(mm)	% Passing		
3-inch	75.0	100.0	Coarse Gravel	22.17
1.5-inch	37.5	100.0		
1-inch	25.0	90.2		
3/4-inch	19.0	77.8	Fine Gravel	46.50
3/8-inch	9.5	48.3		
#4	4.75	31.3	Coarse Sand	12.34
#10	2.00	19.0		
#20	0.850	13.1	Medium Sand	9.66
#40	0.425	9.3		
#60	0.250	6.9	Fine Sand	3.98
#100	0.150	6.0		
#200	0.075	5.4	Silt or Clay Fines	5.36
Hydrometer Analysis	0.036	2.6		
	0.023	2.5		
	0.013	2.1		
	0.010	2.0		
	0.007	1.8		
	0.003	1.6		
	0.001	1.4		

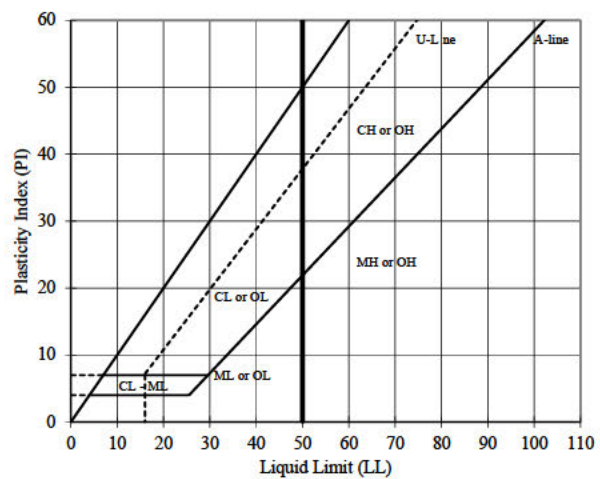

USCS Description (ASTM D 2487):

Poorly graded gravel with silt and sand, brown, moist

LL	PL	PI	SpG
NP	NP	NP	—

As-Received Moisture Content (%)

—

USCS Group Symbol

GP-GM

Notes: 0 g of particles up to 37.5 mm maximum size were removed from particle size analysis sample prior to testing
Particle size analysis sample mechanically dispersed using Stirring Apparatus A for about 1 minute
Sample prepared for Atterberg Limits testing by the dry method
Material retained on No. 40 sieve removed from Atterberg Limits sample by sieving
Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using mechanical device

TECH MB/AR
DATE 31-Jul-2018
REVIEW MB

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 38-39 ft.
 Point No.: 1

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 38-39 ft.
 Point No.: 2

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 38-39 ft.
 Point No.: 3

Initial		Initial		Initial	
Thickness =	1.188 in	Thickness =	1.183 in	Thickness =	1.189 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Wet Mass =	0.423 lb	Wet Mass =	0.423 lb	Wet Mass =	0.424 lb
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.83 in ³	Volume =	5.81 in ³	Volume =	5.84 in ³
Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)
Dry Mass of Solids =	0.404 lb	Dry Mass of Solids =	0.402 lb	Dry Mass of Solids =	0.403 lb
Moisture Content =	4.7%	Moisture Content =	5.2%	Moisture Content =	5.0%
Wet Unit Weight =	125.4 pcf	Wet Unit Weight =	125.9 pcf	Wet Unit Weight =	125.4 pcf
Dry Unit Weight =	119.7 pcf	Dry Unit Weight =	119.7 pcf	Dry Unit Weight =	119.4 pcf
Void Ratio =	0.41	Void Ratio =	0.41	Void Ratio =	0.41
Percent Saturation =	31%	Percent Saturation =	35%	Percent Saturation =	33%

Pre-Shear		Pre-Shear		Pre-Shear	
Thickness =	1.174 in	Thickness =	1.163 in	Thickness =	1.170 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.76 in ³	Volume =	5.71 in ³	Volume =	5.74 in ³
Moisture Content =	11.1%	Moisture Content =	11.2%	Moisture Content =	11.4%
Wet Unit Weight =	134.7 pcf	Wet Unit Weight =	135.4 pcf	Wet Unit Weight =	135.2 pcf
Dry Unit Weight =	121.2 pcf	Dry Unit Weight =	121.8 pcf	Dry Unit Weight =	121.4 pcf
Void Ratio =	0.39	Void Ratio =	0.38	Void Ratio =	0.39
Percent Saturation =	77%	Percent Saturation =	79%	Percent Saturation =	80%

Shear Rate = 0.0033 in/min
 Normal Stress = 4,752 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 9,504 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 14,256 psf


Notes:

USCS description (ASTM D2487): Poorly graded gravel with silt and sand, brown, moist
 Atterberg limits: LL = NP PL = NP PI = NP (ASTM D4318)
 Percent finer: 3/4 in. = 78% No. 4 = 31% No. 200 = 5% (ASTM D422, refer to separate report)
 Specimen type: ☐ Intact ☒ Reconstituted
 Inundation: At seating load
 Apparatus: 2.5 -inch nominal diameter box, GeoTac automated test system, GeoJac loading system
 Gravel retained on the #4 sieve removed from sample prior to testing
 Specimens were reconstituted at near estimated optimum moisture content using heavy compactive effort


Project Name: FTN/Entergy Independence/AR		ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SAMPLE AND TEST DATA				
Project Number: 18103172.01						
Sample ID: RP-4D @ 38 - 39 ft.		Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 1



Shear Stress vs. Relative Lateral Displacement

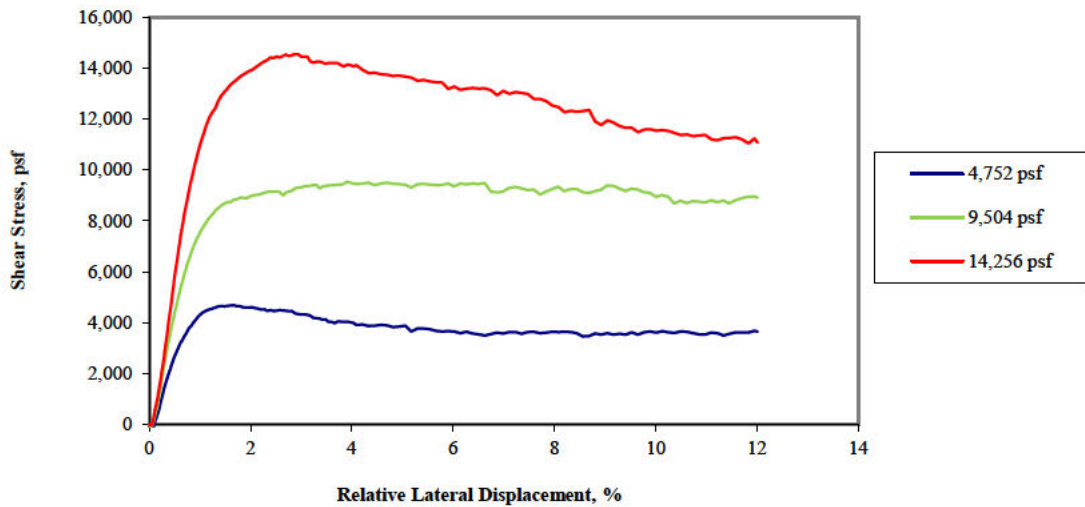

Normal Displacement vs. Relative Lateral Displacement

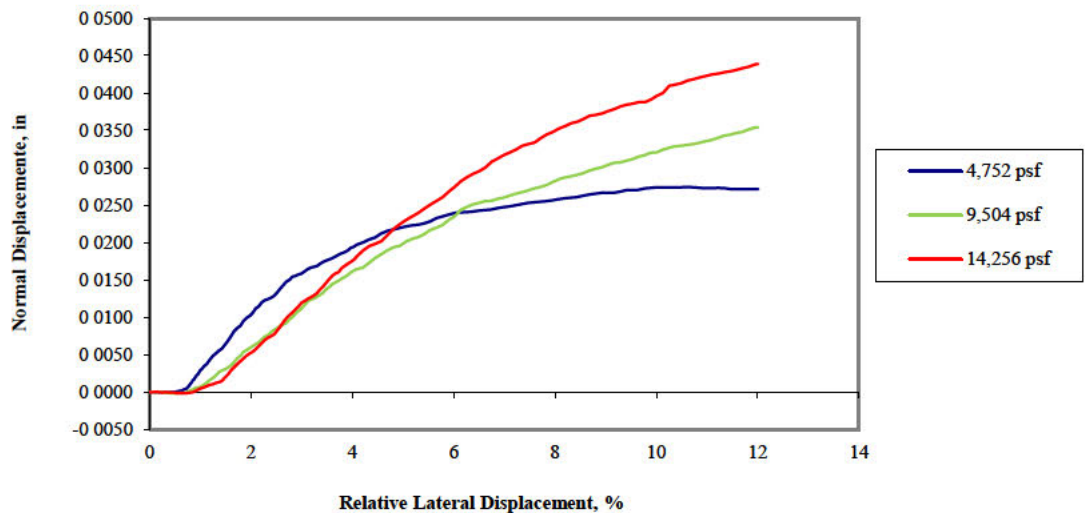

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

Sample ID:

RP-4D @ 38 - 39 ft.

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
SHEAR STRESS AND NORMAL DISPLACEMENT PLOTS

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

2



The figure consists of three vertically stacked graphs, each showing Normal Displacement (in) on the y-axis versus Square Root of Time ($\text{min}^{1/2}$) on the x-axis. The y-axis for all graphs ranges from 0.0000 to 0.0045 in increments of 0.0005. The x-axis for the top graph ranges from 0.0 to 8.0, while the bottom two range from 0.0 to 10.0.

- Top Graph (4,758 psf):** The displacement starts at 0.0000 and drops sharply to approximately 0.0032 at $\sqrt{t} = 0.5$. It then gradually decreases, reaching approximately 0.0042 at $\sqrt{t} = 8.0$.
- Middle Graph (9,505 psf):** The displacement starts at 0.0000 and drops sharply to approximately 0.0054 at $\sqrt{t} = 0.5$. It then gradually decreases, reaching approximately 0.0056 at $\sqrt{t} = 10.0$.
- Bottom Graph (14,261 psf):** The displacement starts at 0.0000 and drops sharply to approximately 0.0054 at $\sqrt{t} = 0.5$. It then gradually decreases, reaching approximately 0.0056 at $\sqrt{t} = 10.0$.

[illegible]

3

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
CONSOLIDATION DATA



GOLDER

Point No : 1
 Normal Stress = 4,752 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
-109	0.1	0.0000
528	0.2	0.0000
1,362	0.3	0.0000
2,054	0.4	0.0000
2,659	0.5	0.0000
3,053	0.6	0.0001
3,438	0.7	0.0003
3,790	0.8	0.0009
4,060	0.9	0.0020
4,261	1.0	0.0026
4,647	1.5	0.0063
4,596	2.0	0.0101
4,457	2.5	0.0129
4,331	3.0	0.0158
4,137	3.5	0.0176
4,019	4.0	0.0193
3,887	4.5	0.0206
3,854	4.9	0.0219
3,767	5.4	0.0225
3,665	5.9	0.0237
3,585	6.4	0.0241
3,581	7.0	0.0247
3,637	7.5	0.0253
3,650	8.0	0.0256
3,587	8.4	0.0261
3,538	8.9	0.0266
3,536	9.4	0.0270
3,659	9.9	0.0273

Point No : 2
 Normal Stress = 9,504 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
109	0.1	0.0000
1,011	0.2	0.0000
2,262	0.3	-0.0001
3,378	0.4	-0.0001
4,347	0.5	-0.0002
5,048	0.6	-0.0002
5,839	0.7	-0.0002
6,503	0.8	0.0002
7,088	0.9	0.0005
7,440	1.0	0.0006
8,687	1.5	0.0030
8,928	2.0	0.0059
9,150	2.5	0.0083
9,302	2.9	0.0109
9,371	3.5	0.0137
9,501	4.0	0.0160
9,400	4.5	0.0179
9,442	4.9	0.0195
9,451	5.4	0.0211
9,463	5.9	0.0230
9,465	6.4	0.0251
9,147	7.0	0.0260
9,205	7.5	0.0269
9,244	8.0	0.0281
9,245	8.4	0.0290
9,220	8.9	0.0301
9,173	9.4	0.0309
9,096	9.9	0.0320

Point No : 3
 Normal Stress = 14,256 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
213	0.1	0.0000
1,282	0.2	0.0000
2,623	0.3	0.0000
4,184	0.4	-0.0001
5,432	0.5	-0.0001
6,907	0.6	-0.0001
8,174	0.7	-0.0002
9,234	0.8	-0.0001
10,161	0.9	0.0001
10,809	1.0	0.0004
13,066	1.5	0.0019
13,883	2.0	0.0051
14,392	2.5	0.0077
14,532	2.9	0.0115
14,159	3.5	0.0146
14,114	4.0	0.0174
13,813	4.5	0.0198
13,693	4.9	0.0224
13,522	5.4	0.0245
13,180	5.9	0.0268
13,213	6.4	0.0292
13,091	7.0	0.0317
12,969	7.5	0.0331
12,517	8.0	0.0348
12,284	8.4	0.0361
11,758	8.9	0.0372
11,647	9.4	0.0384
11,595	9.9	0.0391

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
 SHEAR DATA

Sample ID:

RP-4D @ 38 - 39 ft.

Technician:

MAB

Checked:

PRH

Reviewed:


MK

Date:

15-Aug-2018

Figure:

4

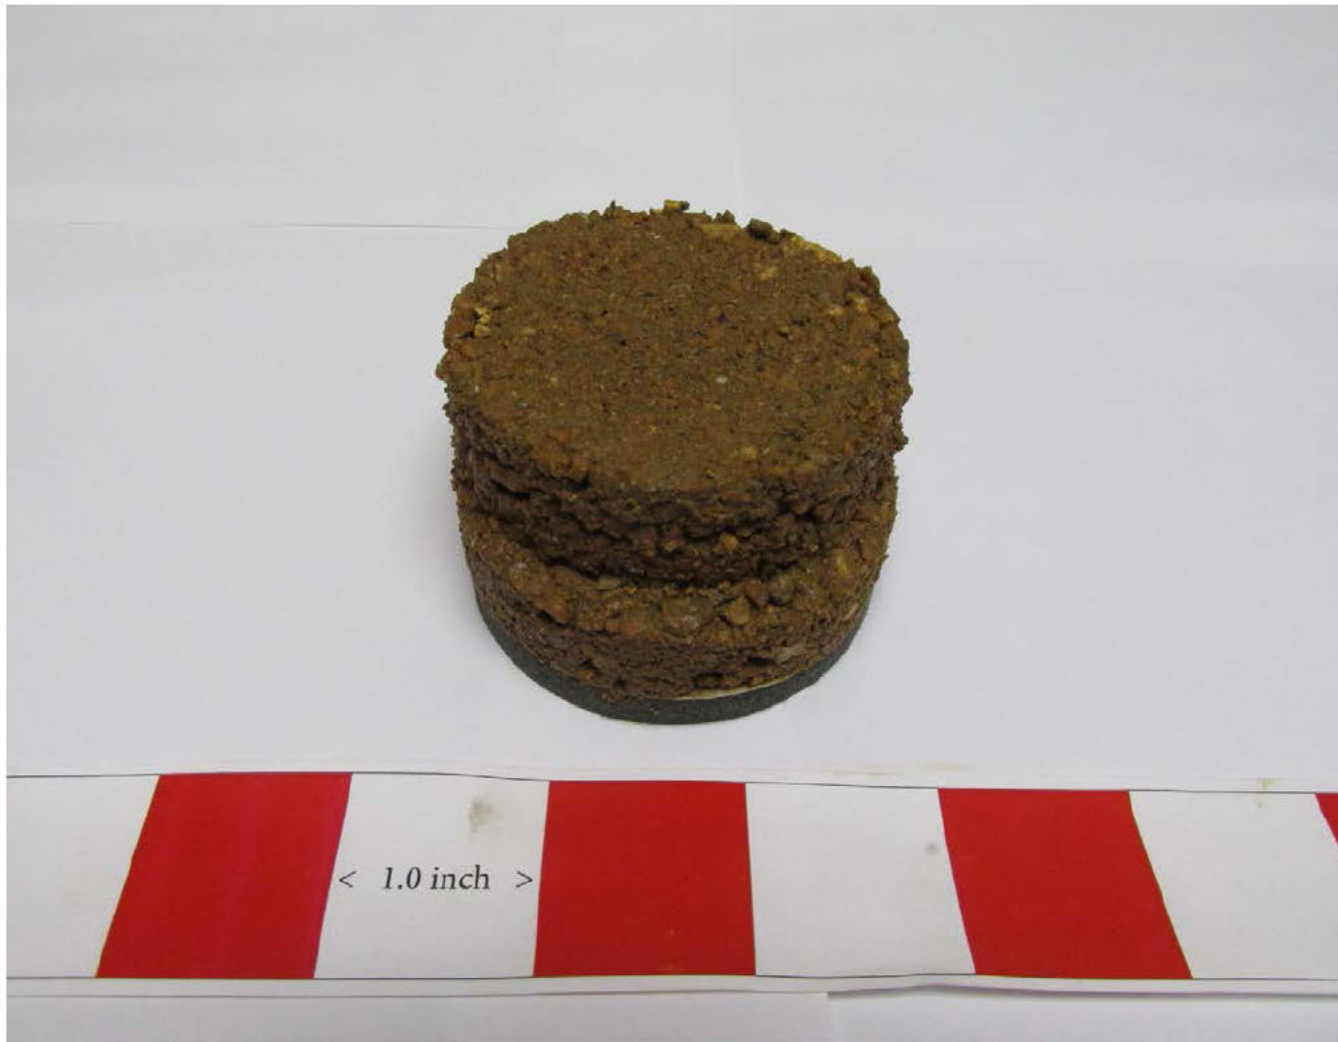

Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-4D @ 38 - 39 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 5



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 9,504 psf				
Project Number: 18103172.01					
Sample ID: RP-4D @ 38 - 39 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 6



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-4D @ 38 - 39 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 7


August-18

18103172


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/Entergy Independence/AR
SAMPLE ID: RP-4D
TYPE: Bag

DEPTH (ft): 64.5-67.4

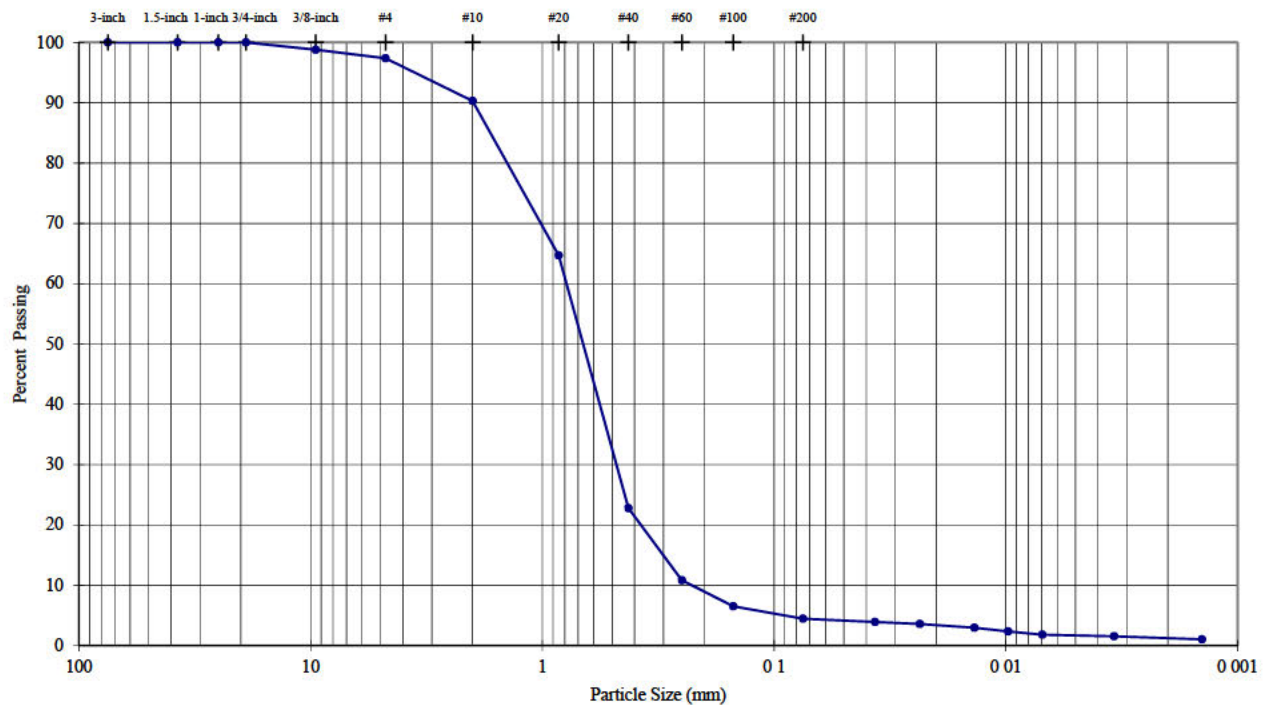

Sieve	Particle Size		Description	Percentage
	(mm)	% Passing		
3-inch	75.0	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
3/8-inch	9.5	98.8	Fine Gravel	2.62
#4	4.75	97.4		
#10	2.00	90.3	Coarse Sand	7.07
#20	0.850	64.7		
#40	0.425	22.8		
#60	0.250	10.8	Fine Sand	18.33
#100	0.150	6.5		
#200	0.075	4.5		
	0.037	3.9	Silt or Clay Fines	4.47
	0.023	3.6		
	0.014	3.0		
	0.010	2.4		
	0.007	1.8		
	0.003	1.6		
	0.001	1.0		

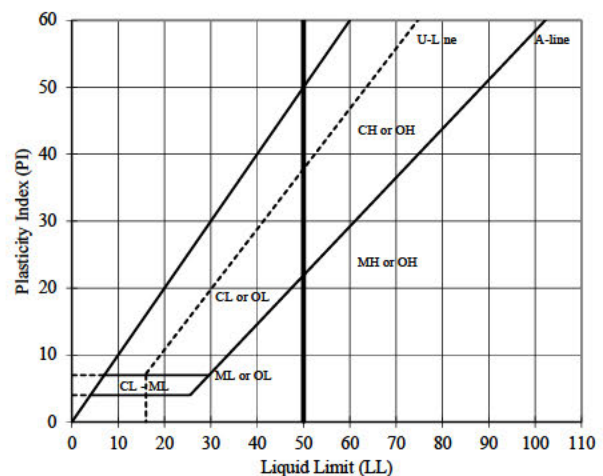

USCS Description (ASTM D 2487):

Poorly graded sand, reddish yellow, moist

LL	PL	PI	SpG
NP	NP	NP	—

As-Received Moisture Content (%)

—

USCS Group Symbol

SP

Notes: 0 g of particles up to 19.0 mm maximum size were removed from particle size analysis sample prior to testing
Particle size analysis sample mechanically dispersed using Stirring Apparatus A for about 1 minute
Sample prepared for Atterberg Limits testing by the dry method
Material retained on No. 40 sieve removed from Atterberg Limits sample by sieving
Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using mechanical device

TECH	AR
DATE	31-Jul-2018
REVIEW	MB

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 64.5-67.4 ft.
 Point No.: 1

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 64.5-67.4 ft.
 Point No.: 2

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 64.5-67.4 ft.
 Point No.: 3

Initial		Initial		Initial	
Thickness =	1.187 in	Thickness =	1.193 in	Thickness =	1.189 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Wet Mass =	0.394 lb	Wet Mass =	0.396 lb	Wet Mass =	0.395 lb
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.83 in ³	Volume =	5.86 in ³	Volume =	5.84 in ³
Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)
Dry Mass of Solids =	0.379 lb	Dry Mass of Solids =	0.381 lb	Dry Mass of Solids =	0.381 lb
Moisture Content =	3.8%	Moisture Content =	3.8%	Moisture Content =	3.8%
Wet Unit Weight =	116.8 pcf	Wet Unit Weight =	116.7 pcf	Wet Unit Weight =	117.0 pcf
Dry Unit Weight =	112.5 pcf	Dry Unit Weight =	112.5 pcf	Dry Unit Weight =	112.7 pcf
Void Ratio =	0.50	Void Ratio =	0.50	Void Ratio =	0.49
Percent Saturation =	21%	Percent Saturation =	21%	Percent Saturation =	21%

Pre-Shear		Pre-Shear		Pre-Shear	
Thickness =	1.165 in	Thickness =	1.168 in	Thickness =	1.161 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.72 in ³	Volume =	5.73 in ³	Volume =	5.70 in ³
Moisture Content =	13.4%	Moisture Content =	13.9%	Moisture Content =	13.0%
Wet Unit Weight =	130.0 pcf	Wet Unit Weight =	130.8 pcf	Wet Unit Weight =	130.5 pcf
Dry Unit Weight =	114.6 pcf	Dry Unit Weight =	114.9 pcf	Dry Unit Weight =	115.5 pcf
Void Ratio =	0.47	Void Ratio =	0.46	Void Ratio =	0.46
Percent Saturation =	77%	Percent Saturation =	81%	Percent Saturation =	77%

Shear Rate = 0.0033 in/min
 Normal Stress = 8,208 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 16,416 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 24,624 psf


Notes:

USCS description (ASTM D2487): Poorly graded sand, reddish yellow, moist
 Atterberg limits: LL = NP PL = NP PI = NP (ASTM D4318)
 Percent finer: 3/4 in. = 100% No. 4 = 97% No. 200 = 5% (ASTM D422, refer to separate report)
 Specimen type: ☐ Intact ☒ Reconstituted
 Inundation: At seating load
 Apparatus: 2.5 -inch nominal diameter box, GeoTac automated test system, GeoJac loading system
 Gravel retained on the #4 sieve removed from sample prior to testing
 Specimens were reconstituted at near estimated optimum moisture content using heavy compactive effort
 No photo available for Point 3 specimen


Project Name: FTN/Entergy Independence/AR		ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SAMPLE AND TEST DATA				
Project Number: 18103172.01						
Sample ID: RP-4D @ 64.5 - 67.4 ft.		Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 1



Shear Stress vs. Relative Lateral Displacement

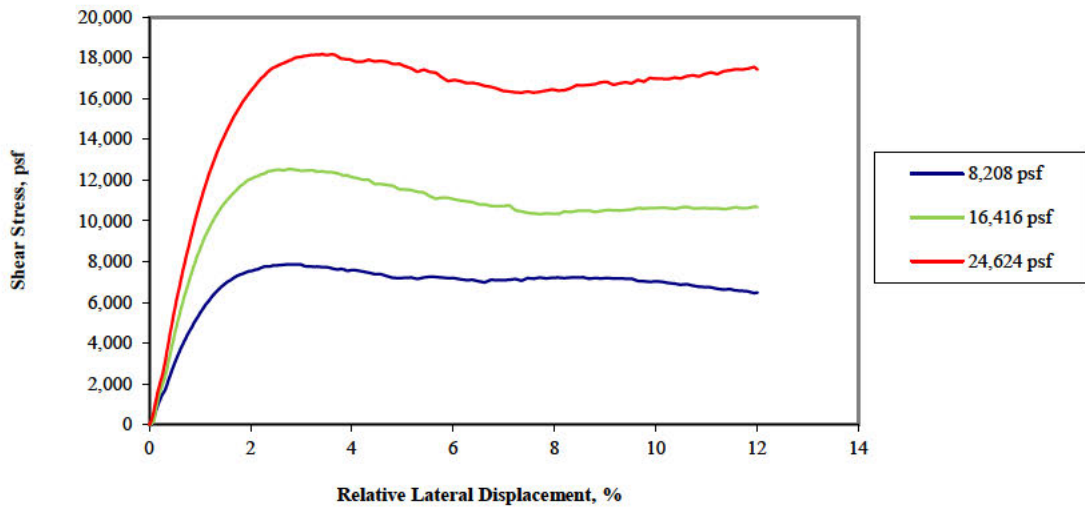

Normal Displacement vs. Relative Lateral Displacement

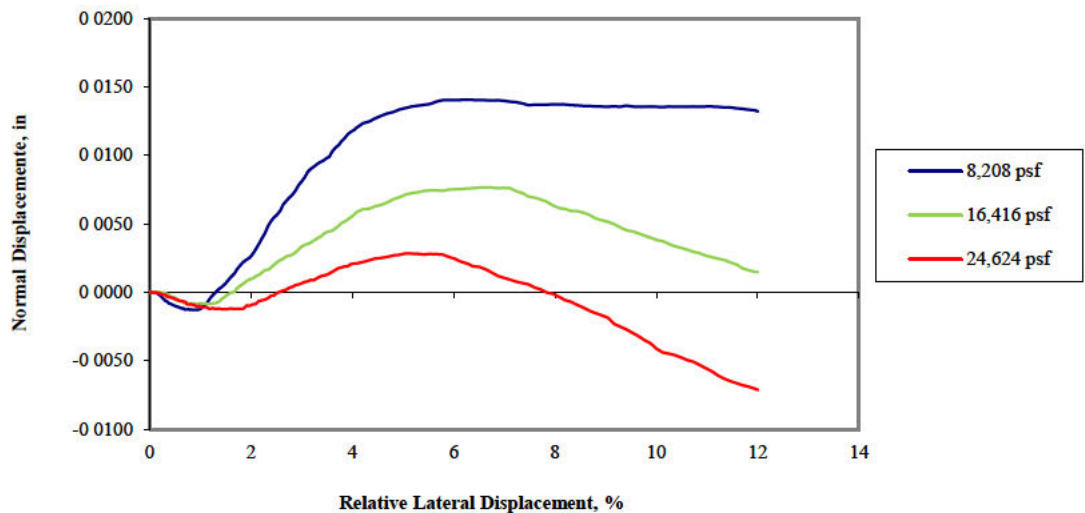

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

Sample ID:

RP-4D @ 64.5 - 67.4 ft.

ASTM D3080
CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
SHEAR STRESS AND NORMAL DISPLACEMENT PLOTS

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

2



The figure consists of three vertically stacked graphs, each showing Normal Displacement (in) on the y-axis versus Square Root of Time ($\text{min}^{1/2}$) on the x-axis. The y-axis for all graphs ranges from 0.0000 to 0.0080 in increments of 0.0001. The x-axis for the top graph ranges from 0.0 to 10.0, for the middle graph from 0.0 to 40.0, and for the bottom graph from 0.0 to 30.0.

Top Graph: 8,210 psf

The data points (blue diamonds) show a rapid initial drop in displacement from 0.0000 at $t=0$ to approximately 0.0060 at $t=1.0$. The displacement then gradually decreases, reaching a steady state of approximately 0.0068 in after $t=10.0$.

Middle Graph: 16,415 psf

The data points (green diamonds) show a rapid initial drop in displacement from 0.0000 at $t=0$ to approximately 0.0068 at $t=1.0$. The displacement then gradually decreases, reaching a steady state of approximately 0.0075 in after $t=40.0$.

Bottom Graph: 24,627 psf

The data points (red diamonds) show a rapid initial drop in displacement from 0.0000 at $t=0$ to approximately 0.0068 at $t=1.0$. The displacement then gradually decreases, reaching a steady state of approximately 0.0078 in after $t=30.0$.

[illegible]

3

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
CONSOLIDATION DATA



GOLDER

Point No : 1
 Normal Stress = 8,208 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
235	0 1	0 0000
1,048	0 2	-0 0002
1,596	0 3	-0 0006
2,277	0 4	-0 0008
2,995	0 5	-0 0010
3,504	0 6	-0 0011
4,059	0 7	-0 0012
4,568	0 8	-0 0013
5,034	0 9	-0 0013
5,372	1 0	-0 0012
6,891	1 5	0 0006
7,534	2 0	0 0025
7,808	2 5	0 0055
7,856	2 9	0 0078
7,727	3 5	0 0098
7,577	4 0	0 0117
7,389	4 5	0 0127
7,195	4 9	0 0133
7,225	5 4	0 0137
7,193	5 9	0 0140
7,107	6 4	0 0140
7,095	7 0	0 0140
7,194	7 5	0 0137
7,205	8 0	0 0137
7,221	8 4	0 0136
7,177	8 9	0 0136
7,164	9 4	0 0136
7,012	9 9	0 0136

Point No : 2
 Normal Stress = 16,416 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
120	0 1	0 0000
1,364	0 2	0 0000
2,154	0 3	0 0000
3,224	0 4	-0 0002
4,151	0 5	-0 0004
5,243	0 6	-0 0006
6,229	0 7	-0 0008
7,078	0 8	-0 0008
7,890	0 9	-0 0009
8,468	1 0	-0 0009
10,865	1 5	-0 0003
12,034	2 0	0 0009
12,460	2 5	0 0020
12,481	2 9	0 0031
12,401	3 5	0 0044
12,165	4 0	0 0054
11,796	4 5	0 0063
11,553	4 9	0 0069
11,397	5 4	0 0074
11,123	5 9	0 0075
10,912	6 4	0 0076
10,722	7 0	0 0076
10,392	7 5	0 0070
10,349	8 0	0 0063
10,486	8 4	0 0059
10,486	8 9	0 0053
10,526	9 4	0 0045
10,627	9 9	0 0040

Point No : 3
 Normal Stress = 24,624 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
528	0 1	0 0000
1,739	0 2	-0 0001
2,741	0 3	-0 0002
4,173	0 4	-0 0004
5,576	0 5	-0 0005
6,576	0 6	-0 0006
7,756	0 7	-0 0007
8,859	0 8	-0 0009
9,893	0 9	-0 0010
10,663	1 0	-0 0010
14,181	1 5	-0 0012
16,255	2 0	-0 0010
17,511	2 5	-0 0002
18,047	3 0	0 0006
18,120	3 5	0 0013
17,917	4 0	0 0020
17,815	4 5	0 0025
17,699	4 9	0 0027
17,421	5 4	0 0028
16,854	5 9	0 0026
16,772	6 4	0 0019
16,376	7 0	0 0010
16,339	7 5	0 0006
16,436	8 0	-0 0001
16,652	8 4	-0 0009
16,792	8 9	-0 0017
16,796	9 4	-0 0027
17,001	9 9	-0 0037

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
 SHEAR DATA

Sample ID:

RP-4D @ 64.5 - 67.4 ft.

Technician:

MAB

Checked:

PRH

Reviewed:


MK

Date:

15-Aug-2018

Figure:

4

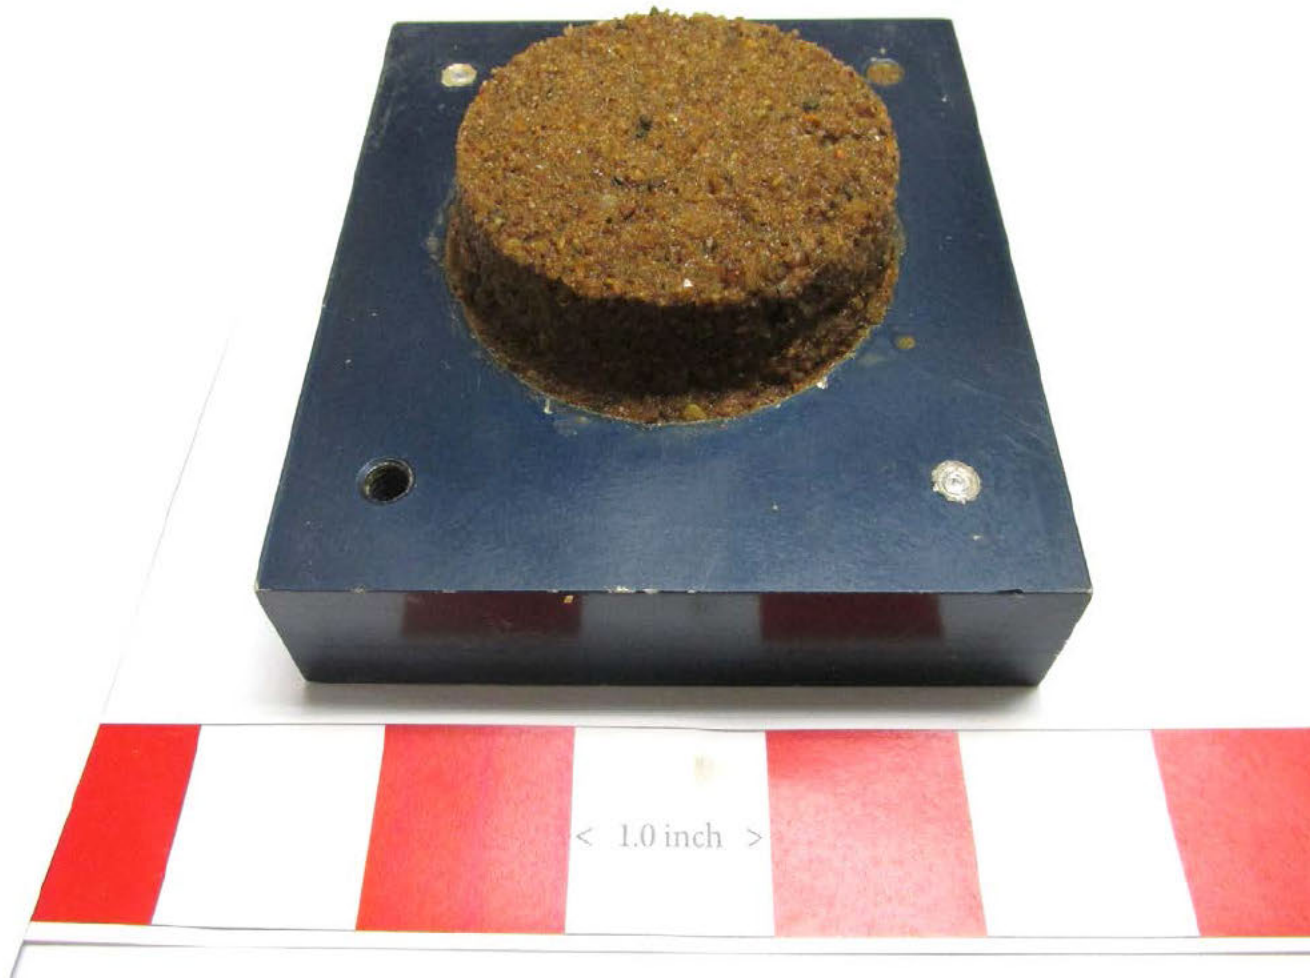

Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 8,208 psf				
Project Number: 18103172.01					
Sample ID: RP-4D @ 64.5 - 67.4 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 5



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-4D @ 64.5 - 67.4 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 6


August-18

18103172


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/Entergy Independence/AR
SAMPLE ID: RP-4D
TYPE: Bag

DEPTH (ft): 76.2-78

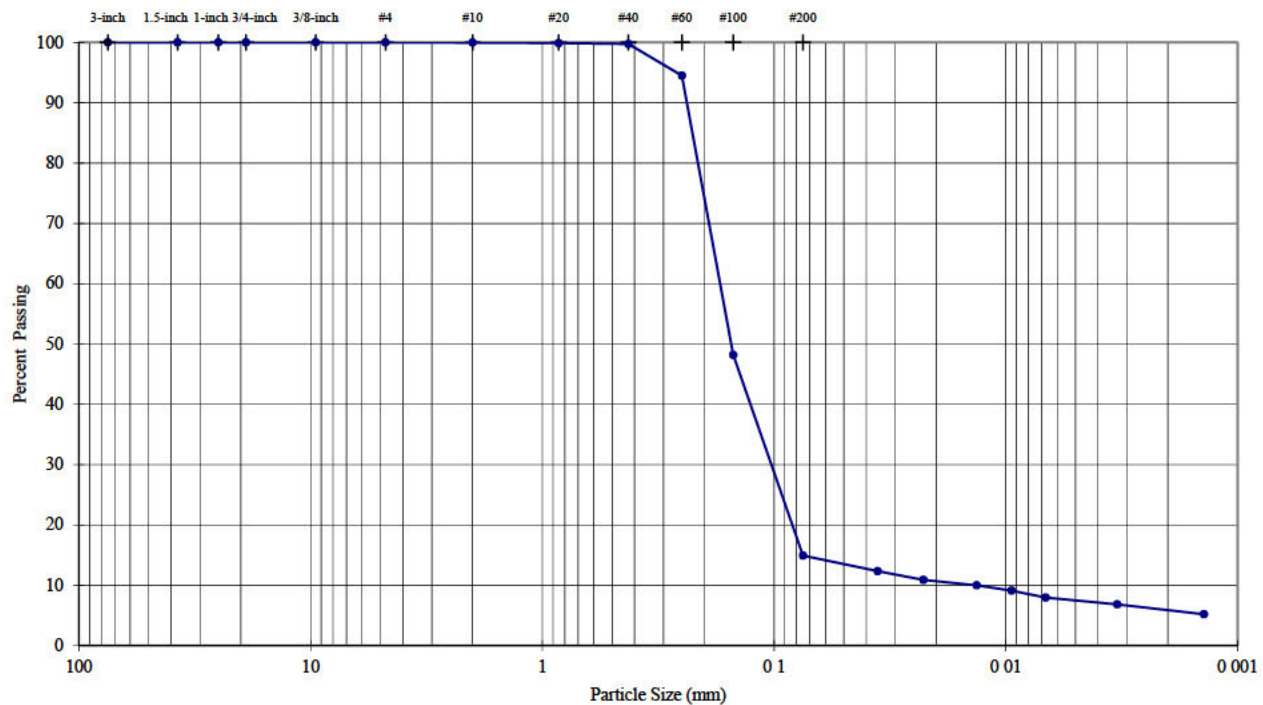

Sieve Analysis (Initial Separation on No. 4 Sieve)	Sieve	Particle Size (mm)	% Passing	Description	Percentage
	3-inch	75.0	100.0		
	1.5-inch	37.5	100.0	Coarse Gravel	0.00
	1-inch	25.0	100.0		
	3/4-inch	19.0	100.0		
	3/8-inch	9.5	100.0	Fine Gravel	0.00
	#4	4.75	100.0		
	#10	2.00	100.0	Coarse Sand	0.02
	#20	0.850	99.9	Medium Sand	0.24
	#40	0.425	99.7		
	#60	0.250	94.5	Fine Sand	84.82
	#100	0.150	48.2		
	#200	0.075	14.9		
Hydrometer Analysis		0.036	12.3	Silt or Clay Fines	14.92
		0.023	10.9		
		0.013	10.0		
		0.009	9.1		
		0.007	8.0		
		0.003	6.8		
		0.001	5.2		

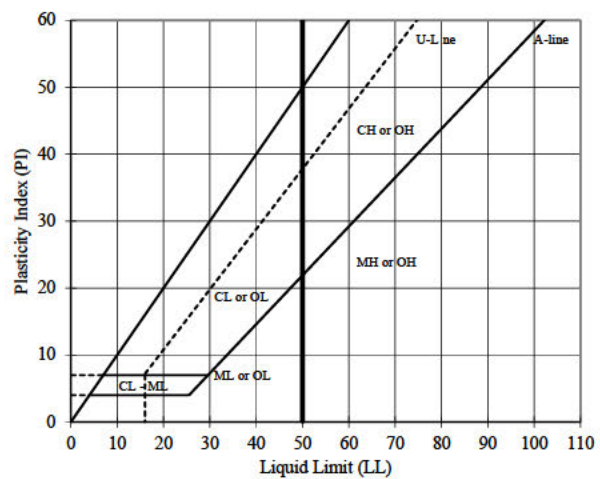

USCS Description (ASTM D 2487):

Silty sand, dark grayish brown, moist

LL	PL	PI	SpG
NP	NP	NP	—

As-Received Moisture Content (%)

—

USCS Group Symbol

SM

Notes: 0 g of particles up to 4.75 mm maximum size were removed from particle size analysis sample prior to testing
Particle size analysis sample mechanically dispersed using Stirring Apparatus A for about 1 minute
Sample prepared for Atterberg Limits testing by the dry method
Material retained on No. 40 sieve removed from Atterberg Limits sample by sieving
Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using mechanical device

TECH	AR
DATE	31-Jul-2018
REVIEW	MB

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 76.2-78 ft.
 Point No.: 1

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 76.2-78 ft.
 Point No.: 2

Boring or Test Pit: --
 Sample: RP-4D
 Depth: 76.2-78 ft.
 Point No.: 3

Initial		Initial		Initial	
Thickness =	1.187 in	Thickness =	1.191 in	Thickness =	1.188 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Wet Mass =	0.394 lb	Wet Mass =	0.393 lb	Wet Mass =	0.394 lb
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.83 in ³	Volume =	5.85 in ³	Volume =	5.83 in ³
Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)
Dry Mass of Solids =	0.362 lb	Dry Mass of Solids =	0.361 lb	Dry Mass of Solids =	0.362 lb
Moisture Content =	8.7%	Moisture Content =	8.9%	Moisture Content =	9.1%
Wet Unit Weight =	116.7 pcf	Wet Unit Weight =	116.2 pcf	Wet Unit Weight =	116.9 pcf
Dry Unit Weight =	107.4 pcf	Dry Unit Weight =	106.7 pcf	Dry Unit Weight =	107.1 pcf
Void Ratio =	0.57	Void Ratio =	0.58	Void Ratio =	0.57
Percent Saturation =	41%	Percent Saturation =	42%	Percent Saturation =	43%

Pre-Shear		Pre-Shear		Pre-Shear	
Thickness =	1.168 in	Thickness =	1.158 in	Thickness =	1.162 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.73 in ³	Volume =	5.68 in ³	Volume =	5.71 in ³
Moisture Content =	19.9%	Moisture Content =	20.3%	Moisture Content =	19.6%
Wet Unit Weight =	130.8 pcf	Wet Unit Weight =	132.1 pcf	Wet Unit Weight =	131.0 pcf
Dry Unit Weight =	109.1 pcf	Dry Unit Weight =	109.8 pcf	Dry Unit Weight =	109.5 pcf
Void Ratio =	0.54	Void Ratio =	0.53	Void Ratio =	0.54
Percent Saturation =	99%	Percent Saturation =	103%	Percent Saturation =	99%

Shear Rate = 0.0033 in/min	Shear Rate = 0.0033 in/min	Shear Rate = 0.0033 in/min
Normal Stress = 9,360 psf	Normal Stress = 18,720 psf	Normal Stress = 28,080 psf


Notes:

USCS description (ASTM D2487): Silty sand, dark grayish brown, moist
 Atterberg limits: LL = NP PL = NP PI = NP (ASTM D4318)
 Percent finer: 3/4 in. = 100% No. 4 = 100% No. 200 = 15% (ASTM D422, refer to separate report)
 Specimen type: ☐ Intact ☒ Reconstituted
 Inundation: At seating load
 Apparatus: 2.5 -inch nominal diameter box, GeoTac automated test system, GeoJac loading system
 Gravel retained on the #4 sieve removed from sample prior to testing
 Specimens were reconstituted at near estimated optimum moisture content using heavy compactive effort


Project Name: FTN/Entergy Independence/AR		ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SAMPLE AND TEST DATA			
Project Number: 18103172.01					
Sample ID: RP-4D @ 76.2 - 78 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 1



Shear Stress vs. Relative Lateral Displacement

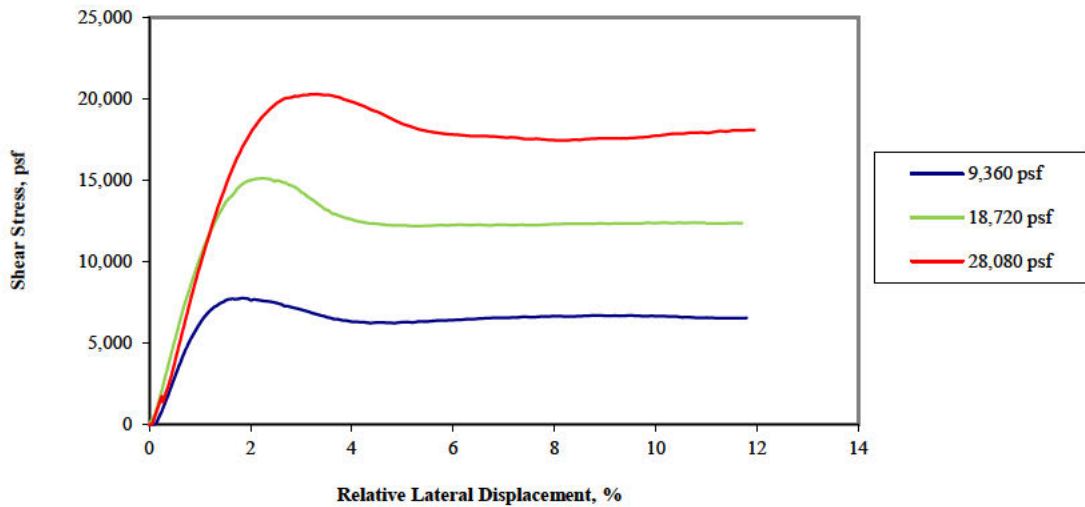

Normal Displacement vs. Relative Lateral Displacement

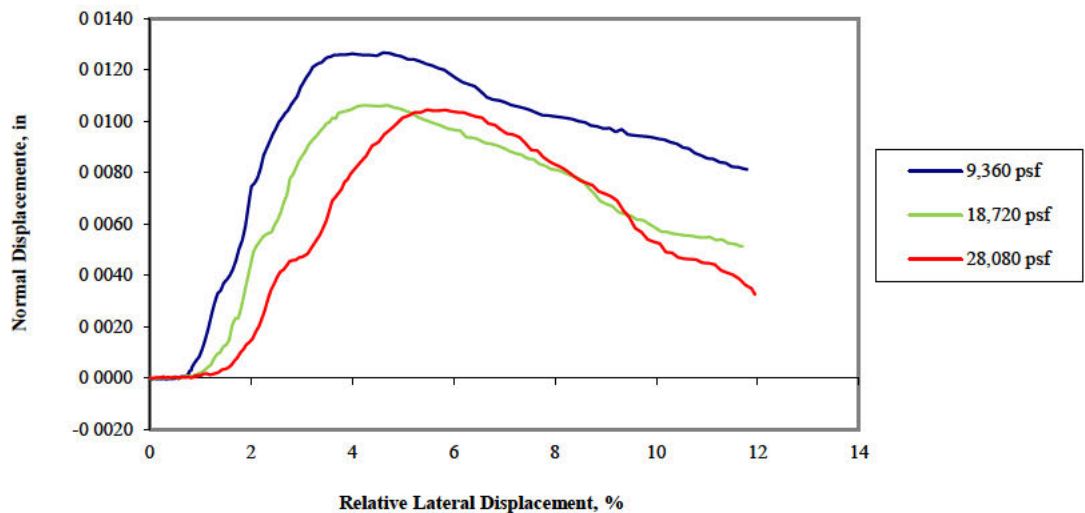

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

Sample ID:

RP-4D @ 76.2 - 78 ft.

ASTM D3080
CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
SHEAR STRESS AND NORMAL DISPLACEMENT PLOTS

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

2



The figure consists of three vertically stacked graphs, each showing Normal Displacement (in) on the y-axis versus Square Root of Time ($\text{min}^{1/2}$) on the x-axis. The y-axis for all graphs ranges from 0.0000 to 0.0070 (top graph) or 0.0100 (middle and bottom graphs) in increments of 0.0010. The x-axis for the top graph ranges from 0.0 to 8.0, the middle graph from 0.0 to 40.0, and the bottom graph from 0.0 to 30.0.

- Top Graph (9,360 psf):** The curve starts at (0, 0) and drops sharply to a displacement of approximately 0.0055 at $\sqrt{t} = 0.5$, then levels off to a constant displacement of about 0.0060 for $\sqrt{t} > 2.0$.
- Middle Graph (18,720 psf):** The curve starts at (0, 0) and drops sharply to a displacement of approximately 0.0075 at $\sqrt{t} = 0.5$, then levels off to a constant displacement of about 0.0080 for $\sqrt{t} > 2.0$.
- Bottom Graph (28,083 psf):** The curve starts at (0, 0) and drops sharply to a displacement of approximately 0.0075 at $\sqrt{t} = 0.5$, then levels off to a constant displacement of about 0.0075 for $\sqrt{t} > 2.0$.

Normal Stress, psf	Normal Displacement, in	Load Duration, min
Point No 1		
101	-0 0001	5
2,161	0 0092	3
4,322	0 0037	3
9,360	0 0062	48
Point No 2		
112	0 0001	3
4,325	0 0195	90
8,640	0 0052	90
18,720	0 0085	1,440
Point No 3		
99	-0 0006	38
3,598	0 0088	90
7,202	0 0041	90
14,394	0 0056	90
28,083	0 0078	649

3

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
CONSOLIDATION DATA



Point No : 1
 Normal Stress = 9,360 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
30	0 1	0 0000
423	0 2	0 0000
1,164	0 3	0 0000
2,012	0 4	0 0000
2,707	0 5	0 0000
3,574	0 6	0 0000
4,388	0 7	0 0000
5,083	0 8	0 0003
5,448	0 9	0 0005
6,087	1 0	0 0008
7,523	1 5	0 0037
7,726	1 9	0 0067
7,490	2 5	0 0097
7,070	3 0	0 0113
6,649	3 5	0 0124
6,383	3 9	0 0126
6,260	4 5	0 0125
6,275	5 0	0 0125
6,324	5 5	0 0122
6,407	5 9	0 0118
6,478	6 4	0 0113
6,547	6 9	0 0108
6,617	7 4	0 0105
6,649	8 0	0 0102
6,653	8 5	0 0100
6,691	9 0	0 0097
6,695	9 4	0 0095
6,667	9 9	0 0094

Point No : 2
 Normal Stress = 18,720 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
491	0 1	0 0000
1,303	0 2	0 0000
2,502	0 3	0 0000
3,695	0 4	0 0000
4,892	0 5	0 0000
6,098	0 6	0 0000
7,215	0 7	0 0000
8,222	0 8	0 0001
8,796	0 8	0 0001
9,913	1 0	0 0002
13,285	1 4	0 0012
14,980	2 0	0 0043
14,916	2 5	0 0060
14,419	2 9	0 0084
13,177	3 5	0 0099
12,604	4 0	0 0104
12,336	4 4	0 0106
12,226	4 9	0 0105
12,189	5 4	0 0101
12,222	5 9	0 0097
12,252	6 5	0 0093
12,266	7 0	0 0090
12,240	7 5	0 0085
12,287	7 9	0 0081
12,330	8 4	0 0078
12,349	8 9	0 0069
12,347	9 5	0 0063
12,353	10 0	0 0058

Point No : 3
 Normal Stress = 28,080 psf
 Shear Rate = 0 0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
223	0 1	0 0000
1,186	0 2	0 0000
1,584	0 3	0 0000
2,554	0 4	0 0000
3,507	0 5	0 0000
4,809	0 6	0 0000
6,072	0 7	0 0001
7,358	0 8	0 0000
8,582	0 9	0 0001
9,512	1 0	0 0001
14,438	1 5	0 0003
17,731	2 0	0 0014
19,548	2 5	0 0037
20,126	2 9	0 0047
20,217	3 5	0 0061
19,831	4 0	0 0080
19,296	4 4	0 0090
18,451	5 0	0 0101
18,006	5 5	0 0104
17,791	6 0	0 0104
17,711	6 4	0 0102
17,640	6 9	0 0097
17,504	7 4	0 0091
17,453	7 9	0 0084
17,463	8 5	0 0077
17,546	9 0	0 0072
17,570	9 5	0 0063
17,701	9 9	0 0053

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
 SHEAR DATA

Sample ID:

RP-4D @ 76.2 - 78 ft.

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

4



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 9,360 psf				
Project Number: 18103172.01					
Sample ID: RP-4D @ 76.2 - 78 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 5



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-4D @ 76.2 - 78 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	SPECIMEN PHOTOGRAPH - 18,720 psf Figure: 6



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-4D @ 76.2 - 78 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	SPECIMEN PHOTOGRAPH - 28,080 psf Figure: 7


August-18

18103172

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/Entergy Independence/AR
SAMPLE ID: RP-5
TYPE: Bag


DEPTH (ft): 27-28

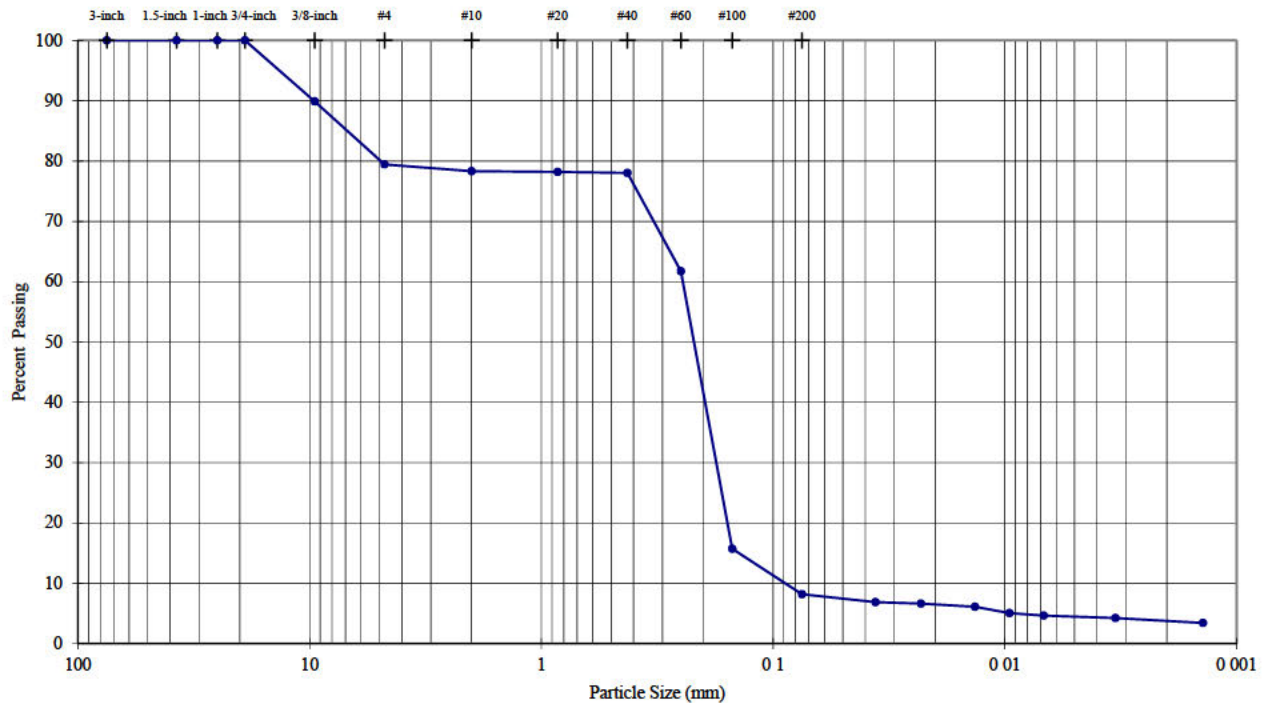

Sieve Analysis (Initial Separation on No. 4 Sieve)	Sieve	Particle Size (mm)	% Passing	Description	Percentage
	3-inch	75.0	100.0		
	1.5-inch	37.5	100.0	Coarse Gravel	0.00
	1-inch	25.0	100.0		
	3/4-inch	19.0	100.0		
	3/8-inch	9.5	89.9	Fine Gravel	20.56
	#4	4.75	79.4		
	#10	2.00	78.3	Coarse Sand	1.12
	#20	0.850	78.2	Medium Sand	0.29
	#40	0.425	78.0		
	#60	0.250	61.7		
Hydrometer Analysis	#100	0.150	15.7	Fine Sand	69.84
	#200	0.075	8.2		
		0.036	6.9		
		0.023	6.6		
		0.013	6.1		
		0.010	5.1		
		0.007	4.7		
		0.003	4.2		
		0.001	3.4		

USCS Description (ASTM D 2487):

Poorly graded sand with silt and gravel, dark yellowish brown, moist

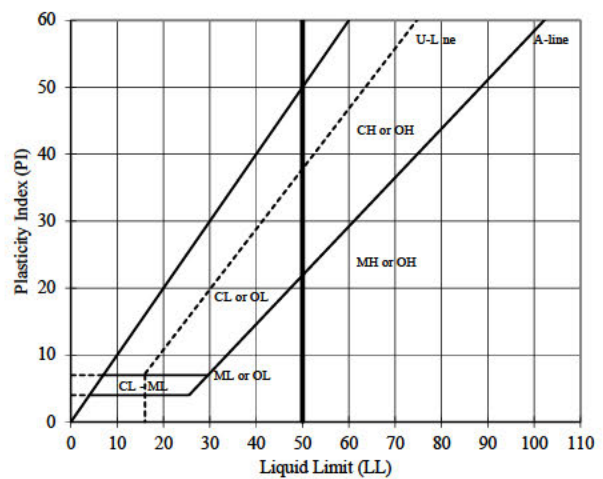

LL	PL	PI	SpG
NP	NP	NP	—

As-Received Moisture Content (%)

—

USCS Group Symbol

SP-SM

Notes: 0 g of particles up to 19.0 mm maximum size were removed from particle size analysis sample prior to testing
Particle size analysis sample mechanically dispersed using Stirring Apparatus A for about 1 minute
Sample prepared for Atterberg Limits testing by the dry method
Material retained on No. 40 sieve removed from Atterberg Limits sample by sieving
Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using mechanical device

TECH	TE/AR
DATE	1-Aug-2018
REVIEW	MB

Boring or Test Pit: --
 Sample: RP-5
 Depth: 27-28 ft.
 Point No.: 1

Boring or Test Pit: --
 Sample: RP-5
 Depth: 27-28 ft.
 Point No.: 2

Boring or Test Pit: --
 Sample: RP-5
 Depth: 27-28 ft.
 Point No.: 3

Initial	Initial	Initial
Thickness = 1.169 in	Thickness = 1.170 in	Thickness = 1.185 in
Diameter = 2.50 in	Diameter = 2.50 in	Diameter = 2.50 in
Wet Mass = 0.390 lb	Wet Mass = 0.390 lb	Wet Mass = 0.395 lb
Area = 4.91 in ²	Area = 4.91 in ²	Area = 4.91 in ²
Volume = 5.74 in ³	Volume = 5.74 in ³	Volume = 5.82 in ³
Specific Gravity = 2.70 (Assumed)	Specific Gravity = 2.70 (Assumed)	Specific Gravity = 2.70 (Assumed)
Dry Mass of Solids = 0.369 lb	Dry Mass of Solids = 0.369 lb	Dry Mass of Solids = 0.373 lb
Moisture Content = 5.6%	Moisture Content = 5.7%	Moisture Content = 5.7%
Wet Unit Weight = 117.4 pcf	Wet Unit Weight = 117.3 pcf	Wet Unit Weight = 117.2 pcf
Dry Unit Weight = 111.1 pcf	Dry Unit Weight = 111.0 pcf	Dry Unit Weight = 110.9 pcf
Void Ratio = 0.51	Void Ratio = 0.52	Void Ratio = 0.52
Percent Saturation = 29%	Percent Saturation = 30%	Percent Saturation = 30%

Pre-Shear	Pre-Shear	Pre-Shear
Thickness = 1.156 in	Thickness = 1.155 in	Thickness = 1.172 in
Diameter = 2.50 in	Diameter = 2.50 in	Diameter = 2.50 in
Area = 4.91 in ²	Area = 4.91 in ²	Area = 4.91 in ²
Volume = 5.68 in ³	Volume = 5.67 in ³	Volume = 5.75 in ³
Moisture Content = 16.7%	Moisture Content = 17.9%	Moisture Content = 16.9%
Wet Unit Weight = 131.1 pcf	Wet Unit Weight = 132.5 pcf	Wet Unit Weight = 131.1 pcf
Dry Unit Weight = 112.4 pcf	Dry Unit Weight = 112.4 pcf	Dry Unit Weight = 112.2 pcf
Void Ratio = 0.50	Void Ratio = 0.50	Void Ratio = 0.50
Percent Saturation = 91%	Percent Saturation = 97%	Percent Saturation = 91%

Shear Rate = 0.0033 in/min
 Normal Stress = 3,312 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 6,624 psf

Shear Rate = 0.0033 in/min
 Normal Stress = 9,936 psf


Notes:

USCS description (ASTM D2487): Poorly graded sand with silt and gravel, dark yellowish brown, moist
 Atterberg limits: LL = NP PL = NP PI = NP (ASTM D4318)
 Percent finer: 3/4 in. = 100% No. 4 = 79% No. 200 = 8% (ASTM D422, refer to separate report)
 Specimen type: ☐ Intact ☒ Reconstituted
 Inundation: At seating load
 Apparatus: 2.5 -inch nominal diameter box, GeoTac automated test system, GeoJac loading system
 Gravel retained on the #4 sieve removed from sample prior to testing
 Specimens were reconstituted at near estimated optimum moisture content using heavy compactive effort


Project Name:	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SAMPLE AND TEST DATA				
FTN/Energy Independence/AR					
Project Number:	18103172.01				
Sample ID:					
RP-5 @ 27 - 28 ft.	Technician:	Checked:	Reviewed:	Date:	Figure:
	MAB	PRH	MK	15-Aug-2018	1



Shear Stress vs. Relative Lateral Displacement

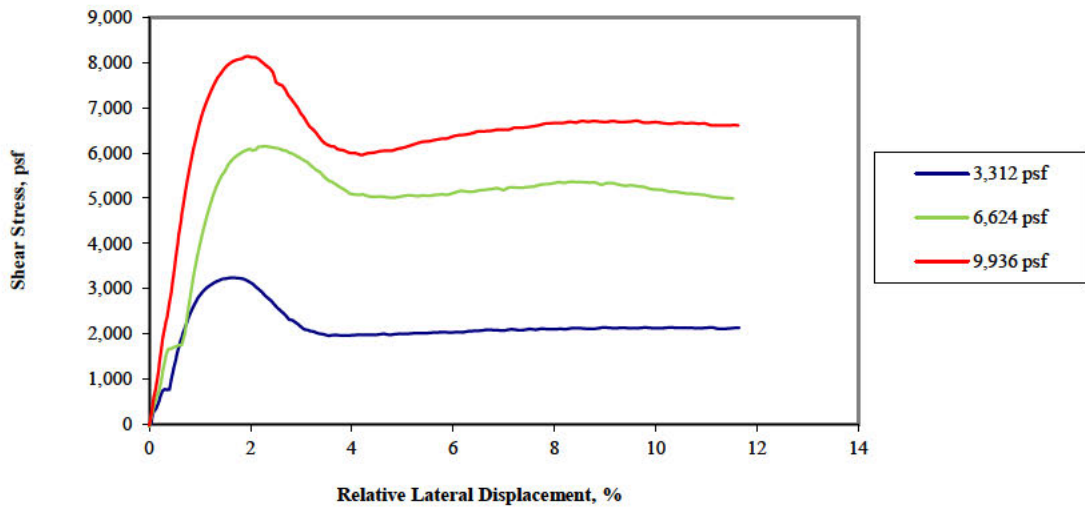

Normal Displacement vs. Relative Lateral Displacement

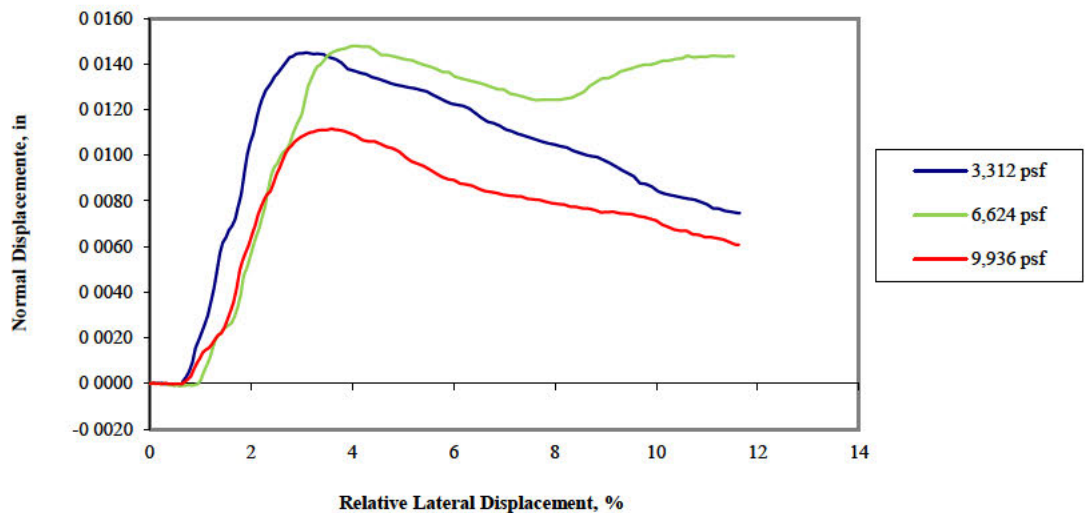

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

Sample ID:

RP-5 @ 27 - 28 ft.

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
SHEAR STRESS AND NORMAL DISPLACEMENT PLOTS

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

2



The figure consists of three vertically stacked graphs, each showing Normal Displacement (in) on the y-axis versus Square Root of Time ($\text{min}^{1/2}$) on the x-axis. The y-axis for all graphs ranges from 0.0000 to 0.0040 in increments of 0.0005. The x-axis for the top graph ranges from 0.0 to 20.0, for the middle graph from 0.0 to 14.0, and for the bottom graph from 0.0 to 8.0.

- Top Graph (3,314 psf):** The data series is a blue line with diamond markers. It starts at (0, 0.0000) and drops sharply to approximately 0.0025 in at $\text{min}^{1/2} = 1.0$. The displacement then gradually increases to about 0.0035 in at $\text{min}^{1/2} = 15.0$.
- Middle Graph (6,627 psf):** The data series is a green line with diamond markers. It starts at (0, 0.0000) and drops sharply to approximately 0.0025 in at $\text{min}^{1/2} = 1.0$. The displacement then gradually increases to about 0.0045 in at $\text{min}^{1/2} = 14.0$.
- Bottom Graph (9,936 psf):** The data series is a red line with diamond markers. It starts at (0, 0.0000) and drops sharply to approximately 0.0035 in at $\text{min}^{1/2} = 1.0$. The displacement then gradually increases to about 0.0040 in at $\text{min}^{1/2} = 7.0$.

[illegible]

3

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
CONSOLIDATION DATA



GOLDER

Point No : 1
 Normal Stress = 3,312 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
275	0.1	0.0000
468	0.2	0.0000
762	0.3	0.0000
777	0.4	0.0000
1,226	0.5	-0.0001
1,704	0.6	-0.0001
2,007	0.7	0.0001
2,381	0.8	0.0005
2,541	0.8	0.0009
2,803	1.0	0.0019
3,216	1.4	0.0062
3,144	2.0	0.0106
2,654	2.5	0.0135
2,211	2.9	0.0145
1,981	3.5	0.0143
1,969	3.9	0.0138
1,983	4.4	0.0134
2,007	5.0	0.0130
2,022	5.5	0.0128
2,035	6.0	0.0123
2,073	6.4	0.0118
2,083	6.9	0.0113
2,090	7.4	0.0109
2,111	8.0	0.0105
2,137	8.5	0.0101
2,144	9.0	0.0098
2,134	9.4	0.0092
2,137	9.9	0.0086

Point No : 2
 Normal Stress = 6,624 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
364	0.1	0.0000
729	0.2	0.0000
1,303	0.3	0.0000
1,676	0.4	-0.0001
1,699	0.5	-0.0001
1,752	0.6	-0.0001
1,768	0.6	-0.0001
2,501	0.8	-0.0001
3,335	0.9	-0.0001
3,701	0.9	0.0000
5,593	1.5	0.0025
6,086	2.0	0.0055
6,113	2.5	0.0095
5,907	2.9	0.0115
5,435	3.5	0.0143
5,093	4.0	0.0148
5,028	4.5	0.0146
5,033	4.9	0.0143
5,062	5.4	0.0140
5,074	5.9	0.0136
5,141	6.4	0.0132
5,178	7.0	0.0129
5,244	7.5	0.0125
5,322	8.0	0.0124
5,356	8.4	0.0126
5,293	8.9	0.0134
5,272	9.4	0.0137
5,202	9.9	0.0140

Point No : 3
 Normal Stress = 9,936 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
540	0.1	0.0000
1,224	0.2	0.0000
2,053	0.3	0.0000
2,658	0.4	0.0000
3,286	0.5	0.0000
4,183	0.6	0.0000
4,971	0.7	0.0001
5,360	0.8	0.0002
6,084	0.9	0.0006
6,641	1.0	0.0011
7,848	1.5	0.0025
8,131	2.0	0.0061
7,772	2.4	0.0088
6,877	3.0	0.0108
6,206	3.5	0.0111
5,996	4.0	0.0110
6,001	4.4	0.0106
6,094	4.9	0.0102
6,243	5.4	0.0095
6,317	5.9	0.0089
6,472	6.5	0.0085
6,513	7.0	0.0083
6,563	7.5	0.0081
6,652	7.9	0.0079
6,668	8.4	0.0077
6,685	8.9	0.0075
6,677	9.4	0.0074
6,677	10.0	0.0071

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
 SHEAR DATA

Sample ID:

RP-5 @ 27 - 28 ft.

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

4



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 3,312 psf				
Project Number: 18103172.01					
Sample ID: RP-5 @ 27 - 28 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 5



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 6,624 psf				
Project Number: 18103172.01					
Sample ID: RP-5 @ 27 - 28 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 6




Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 9,936 psf				
Project Number: 18103172.01					
Sample ID: RP-5 @ 27 - 28 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 7

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-6
 TYPE: Bag

Depth: 30.0-33.0'

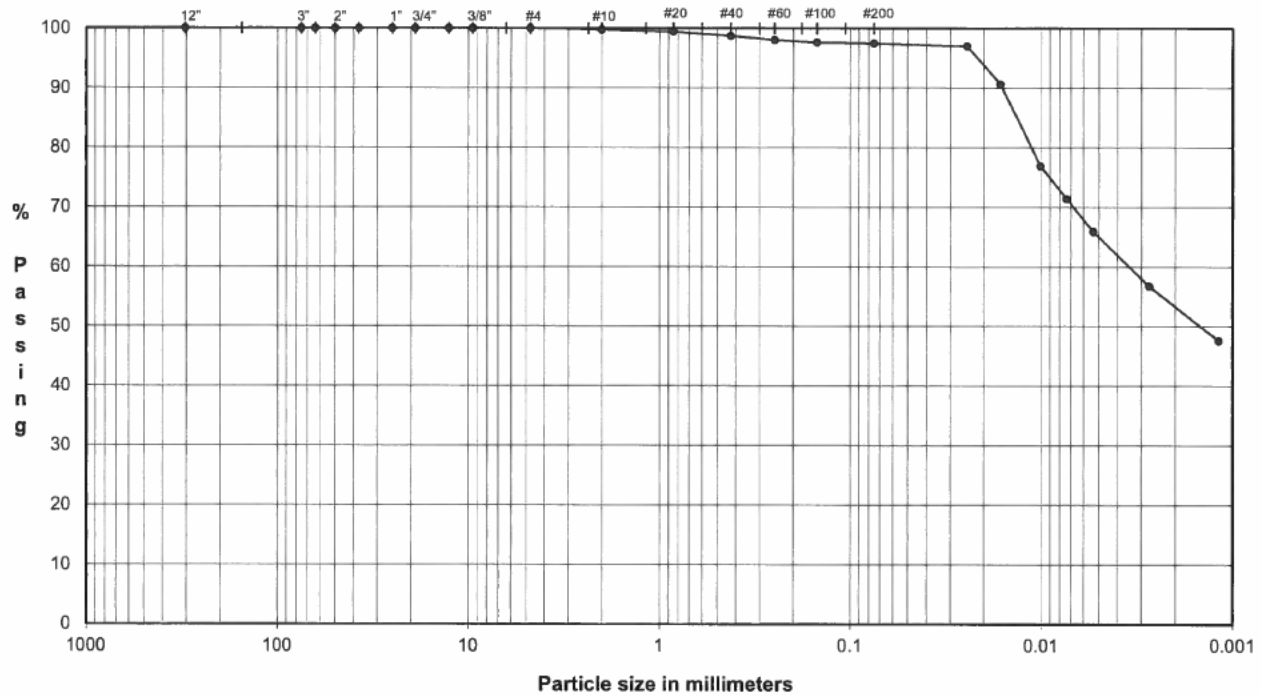

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES


U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.7	
#20	0.85	99.5	
#40	0.43	98.7	
#60	0.25	98.0	
#100	0.15	97.7	
#200	0.075	97.5	

(mm)	% Finer		
0.025	97.0		
0.016	90.6		
0.010	76.9		
0.0074	71.4		
0.0053	65.9		
0.0027	56.7		
0.0012	47.6		

DESCRIPTION: CLAY, trace fine to coarse sand; gray.

USCS: CH

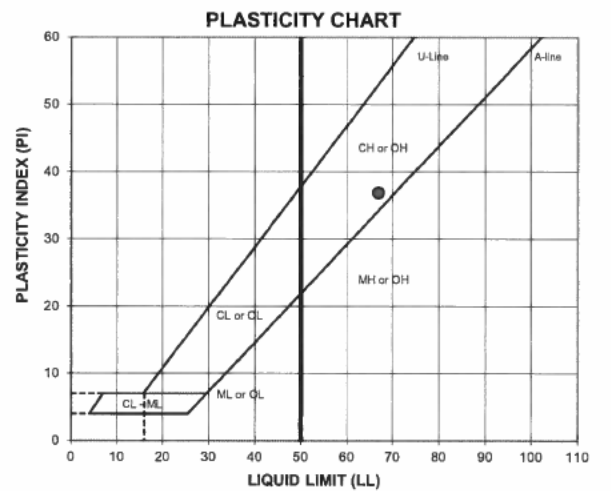

ATTERBERG LIMITS

Method -B (Dry preparation)

M _L	LL	PL	PI	LI
46.5	67	30	37	0.45

LL (oven-dried)
 < 0.75 = ORGANIC (OL/OH)


TECH TJ/HH/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-7
 TYPE: Bag

Depth: 36.0-38.0'

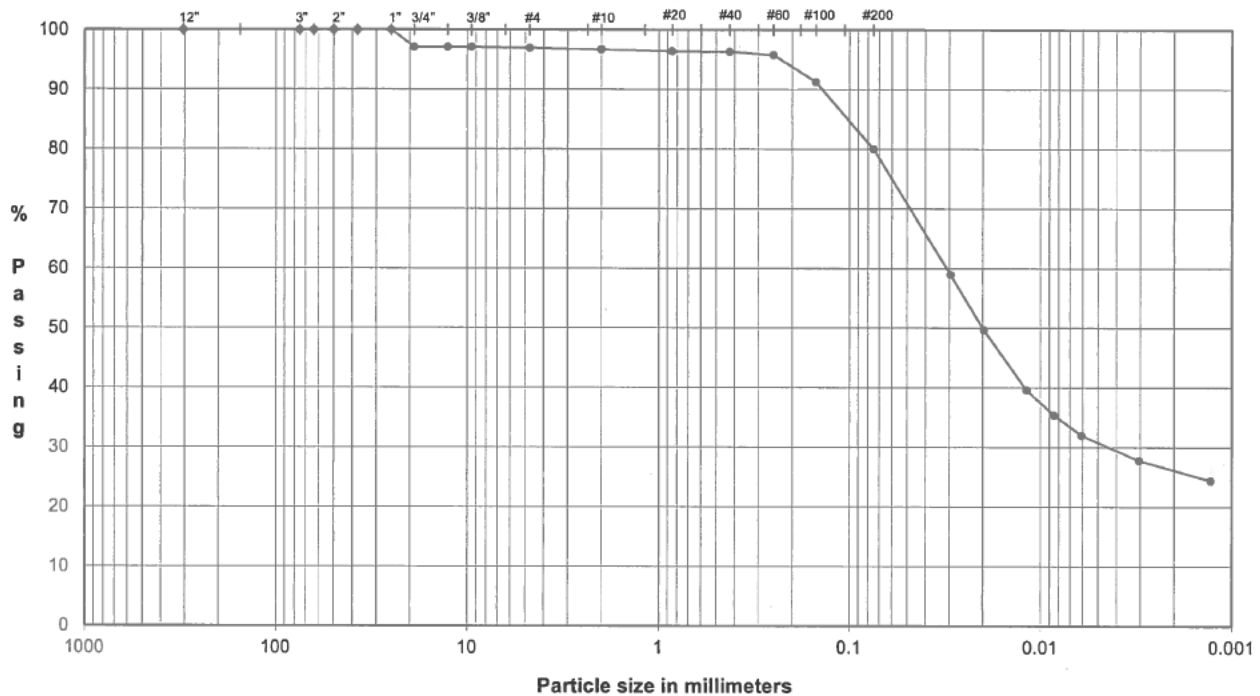

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES


U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	Cobbles
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	97.1	Coarse Gravel
0.50"	12.7	97.1	
0.375"	9.5	97.1	
#4	4.8	96.9	Fine Gravel
#10	2.00	96.7	Coarse Sand
#20	0.85	96.4	
#40	0.43	96.3	Medium Sand
#60	0.25	95.8	
#100	0.15	91.3	
#200	0.075	80.0	Fine Sand

(mm)	% Finer	Classification	Percentage
0.030	58.9		
0.020	49.7		
0.012	39.6		
0.0085	35.4	Fines	
0.0061	32.0	Silt or Clay	
0.0030	27.8		
0.0013	24.4		

DESCRIPTION: sandy SILTY CLAY, fine to coarse, trace fine to coarse gravel; grayish brown.

USCS: CL

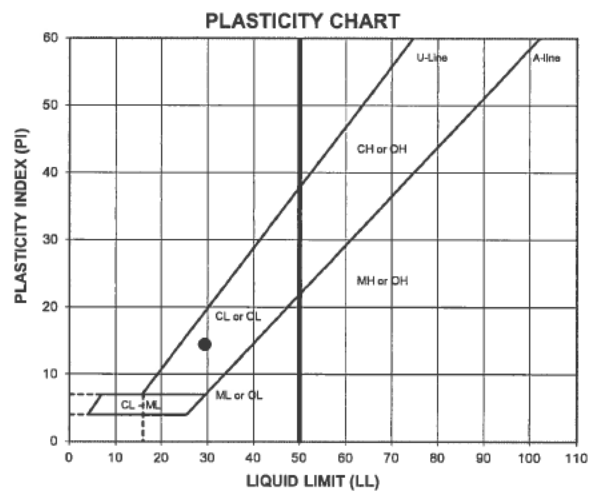

ATTERBERG LIMITS

Method -B (Dry preparation)

M _r	LL	PL	PI	LI
23.2	29	15	14	0.56

LL (oven-dried)
 < 0.75 - ORGANIC (LO/OH)

TECH TJ/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENERGY INDEPENDENCE/AR

SAMPLE ID: RP-8

Depth: 8.0-10.0'

TYPE: UD

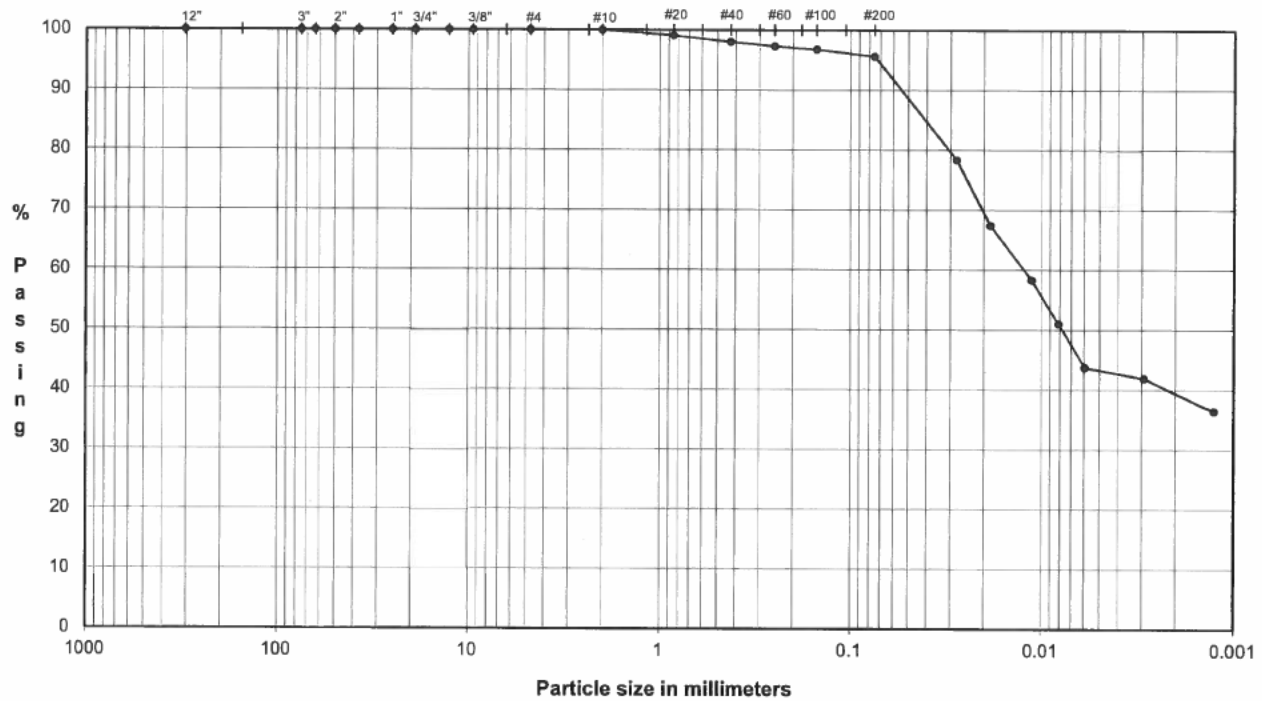

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	100.0	
#20	0.85	99.1	
#40	0.43	98.0	
#60	0.25	97.3	
#100	0.15	96.8	
#200	0.075	95.6	

Hydrometer Analysis

(mm)	% Finer		
0.028	78.3		
0.019	67.4		
0.011	58.3		
0.0082	51.0		
0.0059	43.7		
0.0029	41.9		
0.0013	36.4		

DESCRIPTION: SILTY CLAY, trace fine to coarse sand; dark yellowish brown.

USCS: CL

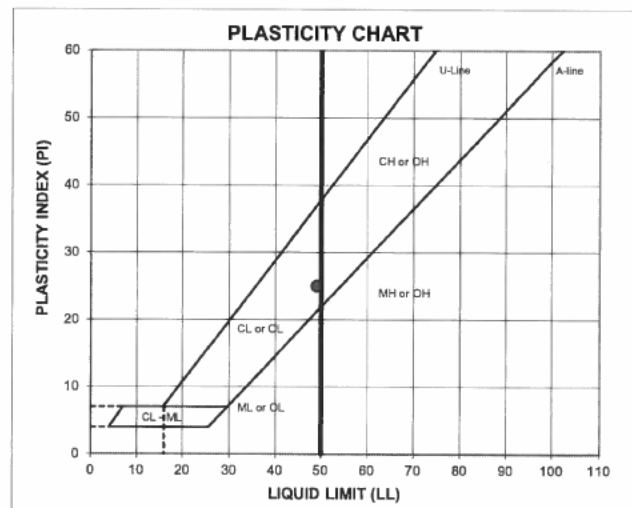

ATTERBERG LIMITS

Method -B (Dry preparation)

M _p	LL	PL	PI	LI
24.6	49	24	25	0.04

LL (oven-dried)
< 0.75 - ORGANIC (OL/OH)

TECH TJ/HEH
DATE 6/6/18
CHECK [Signature]
REVIEW [Signature]
APPROVE [Signature]

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE	FTN/ENTERGY INDEPENDENCE/AR	
PROJECT NUMBER	18103172	
SAMPLE ID	RP-8	8.0-10.0'
SAMPLE TYPE	UD	

Board #	5
Flow Pump	2
Flow Pump Speed	10
Technician	FT

COMMENTS	
----------	--

Sample Data, Initial

Height, inches	3.000	B-Value, f	0.99
Diameter, inches	2.877	Cell Pres.	88.0
Area, cm ²	41.94	Bot. Pres.	80.0
Volume, cm ³	319.59	Top Pres.	80.0
Mass, g	628.15	Tot. B.P.	80.0
Moisture Content, %	24.58	Head, max.	116.06
Dry Density, pcf	98.45	Head, min.	116.06
Spec. Gravity (assumed)	2.750	Max. Grad.	15.23
Volume Solids, cm ³	183.36	Min. Grad.	15.23
Volume Voids, cm ³	136.23		
Void Ratio	0.74		
Saturation, %	91.0%		

Sample Data, Final

Height, inches	3.001
Diameter, inches	2.885
Area, cm ²	42.17
Volume, cm ³	321.48
Mass, g	639.30
Moisture Content, %	26.79
Dry Density, pcf	97.87
Volume Solids, cm ³	183.36
Volume Voids, cm ³	138.12
Void Ratio	0.75
Saturation, %	97.8%

	Sample Initial	Sample Final
Wt Soil & Tare, i	628.15	721.53
Wt Soil & Tare, f	504.23	586.48
Wt Tare	0.00	82.33
Wt Moisture Lost	123.92	135.05
Wt Dry Soil	504.23	504.15
Water Content	24.58%	26.79%

DESCRIPTION

SILTY CLAY, trace fine to coarse sand; dark yellowish brown.

Flow Pump Rate **2.25E-05** cm³/sec

USCS **CL**

TIME FUNCTIONS, SECONDS								dP	Reading	Head	Gradient	Permeability
DATE	DAY	HOUR	MIN	TEMP	dt	dt,acc	dt	dt,acc				
				(°C)	(min)	(min)	(sec)	(sec)	(psi)	(cm)		(cm/sec)
06/08/18	43259	14	0	21.4	0	0	0	0	1.65	116.06	15.23	3.4E-08
06/08/18	43259	14	5	21.4	5	5	300	300	1.65	116.06	15.23	3.4E-08
06/08/18	43259	14	10	21.4	5	10	300	600	1.65	116.06	15.23	3.4E-08
06/08/18	43259	14	15	21.4	5	15	300	900	1.65	116.06	15.23	3.4E-08 *
06/08/18	43259	14	20	21.4	5	20	300	1200	1.65	116.06	15.23	3.4E-08 *
06/08/18	43259	14	25	21.4	5	25	300	1500	1.65	116.06	15.23	3.4E-08 *
06/08/18	43259	14	30	21.4	5	30	300	1800	1.65	116.06	15.23	3.4E-08 *

*TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** **3.4E-08** cm/sec **


DATE 6/8/18
 CHECK *[Signature]*
 REVIEW *[Signature]*
 APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-8D
 TYPE: Bag

Depth: 27.0-30.0'

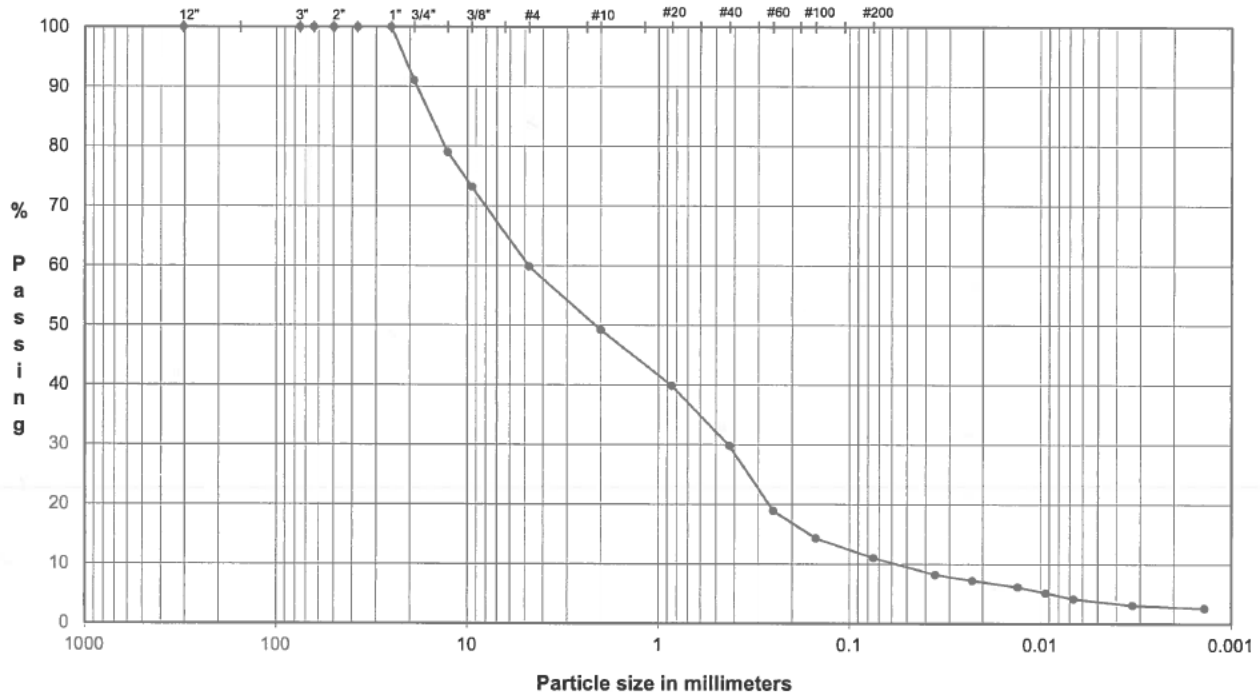

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	91.0	Coarse Gravel
0.50"	12.7	79.0	
0.375"	9.5	73.2	
#4	4.8	59.8	Fine Gravel
#10	2.00	49.2	Coarse Sand
#20	0.85	39.8	
#40	0.43	29.7	Medium Sand
#60	0.25	18.9	
#100	0.15	14.3	
#200	0.075	11.0	Fine Sand

Hydrometer Analysis

(mm)	% Finer		
0.036	8.2		
0.023	7.2		
0.013	6.2		
0.0094	5.1		
0.0067	4.1		
0.0033	3.1		
0.0014	2.6		

DESCRIPTION: SAND and GRAVEL, fine to coarse, fine to coarse gravel; yellowish brown.

USCS: SP-SM

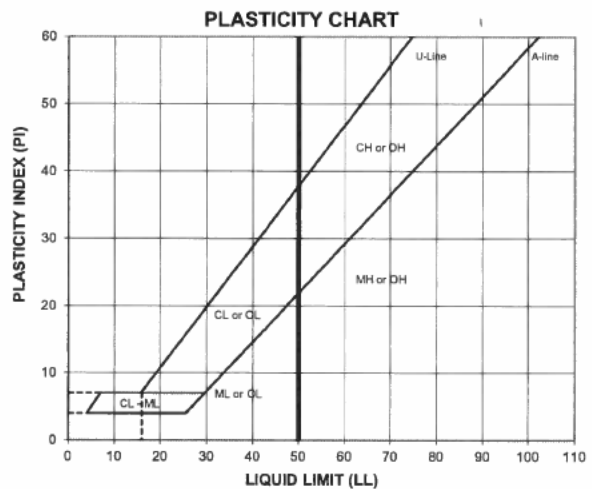

ATTERBERG LIMITS

Method -B (Dry preparation)

M _L	LL	PL	PI	LI
10.2	NP	NP	NP	NP

LL (oven-dried)
 0.75 ORGANIC (OL/OH)


TECH TJ/BA/HH
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-8D
 TYPE: Bag

Depth: 42.0-50.0'

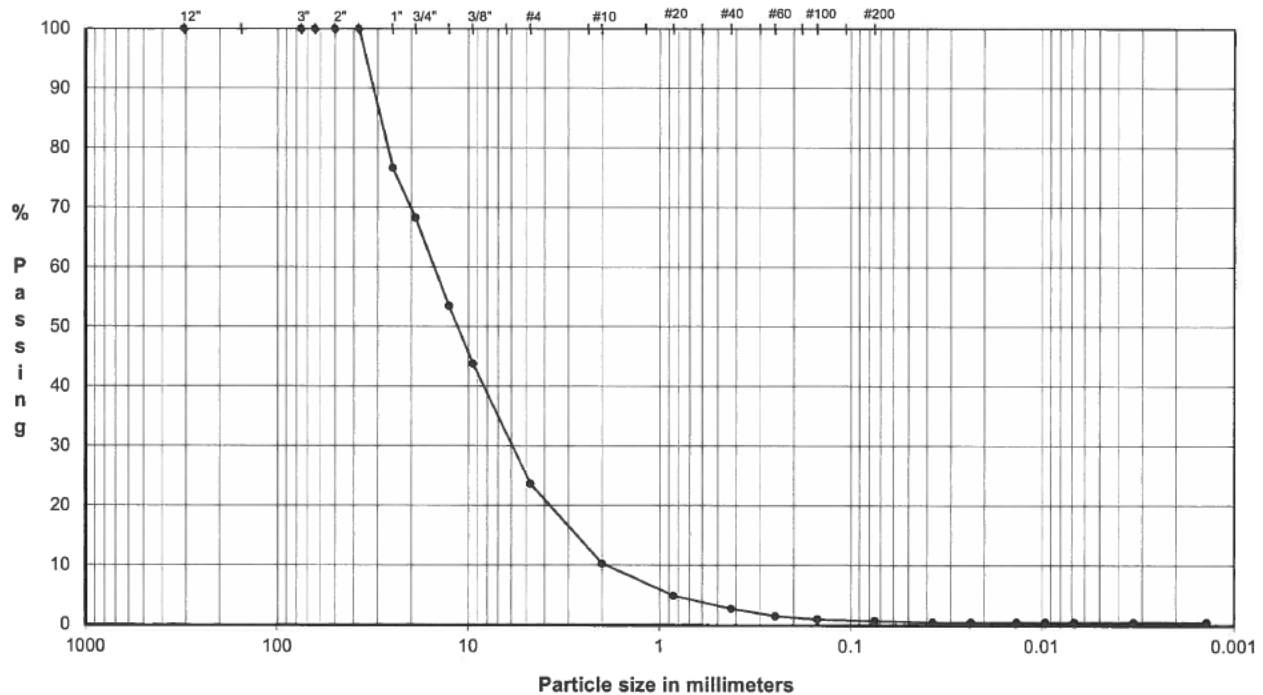

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	Cobbles
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	76.6	
0.75"	19.0	68.2	Coarse Gravel
0.50"	12.7	53.5	
0.375"	9.5	43.8	
#4	4.8	23.6	Fine Gravel
#10	2.00	10.3	Coarse Sand
#20	0.85	4.8	
#40	0.43	2.6	Medium Sand
#60	0.25	1.5	
#100	0.15	0.9	
#200	0.075	0.6	Fine Sand

Hydrometer Analysis

(mm)	% Finer		
0.037	0.4		
0.024	0.4		
0.014	0.4		
0.0096	0.4		
0.0068	0.4		
0.0033	0.4		
0.0014	0.4		

DESCRIPTION: sandy GRAVEL, fine to coarse, fine to coarse sand, trace fines; dark yellowish brown.

USCS: GW

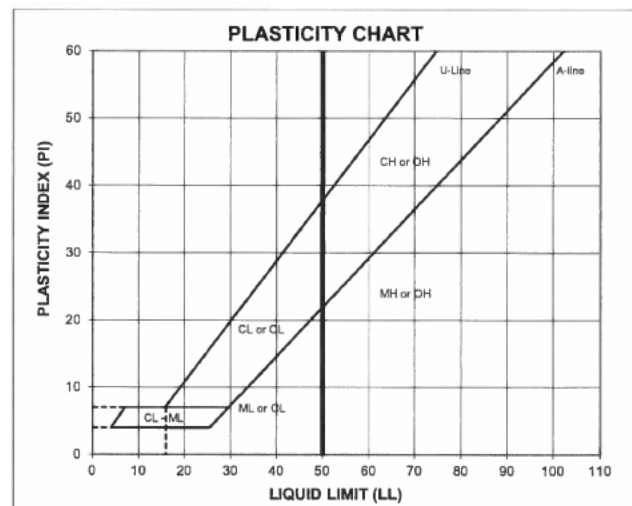

ATTERBERG LIMITS

Method -B (Dry preparation)

M _p	LL	PL	PI	L _i
3.9	NP	NP	NP	NP

LL (oven-dried)
 < 0.75 - ORGANIC (OL/OH)

TECH TJ/HH/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

NOTE: Insufficient sample received to perform in accordance with ASTM Standards


August-18

18103172


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/Entergy Independence/AR
SAMPLE ID: RP-8D
TYPE: Bag

DEPTH (ft): 53-60

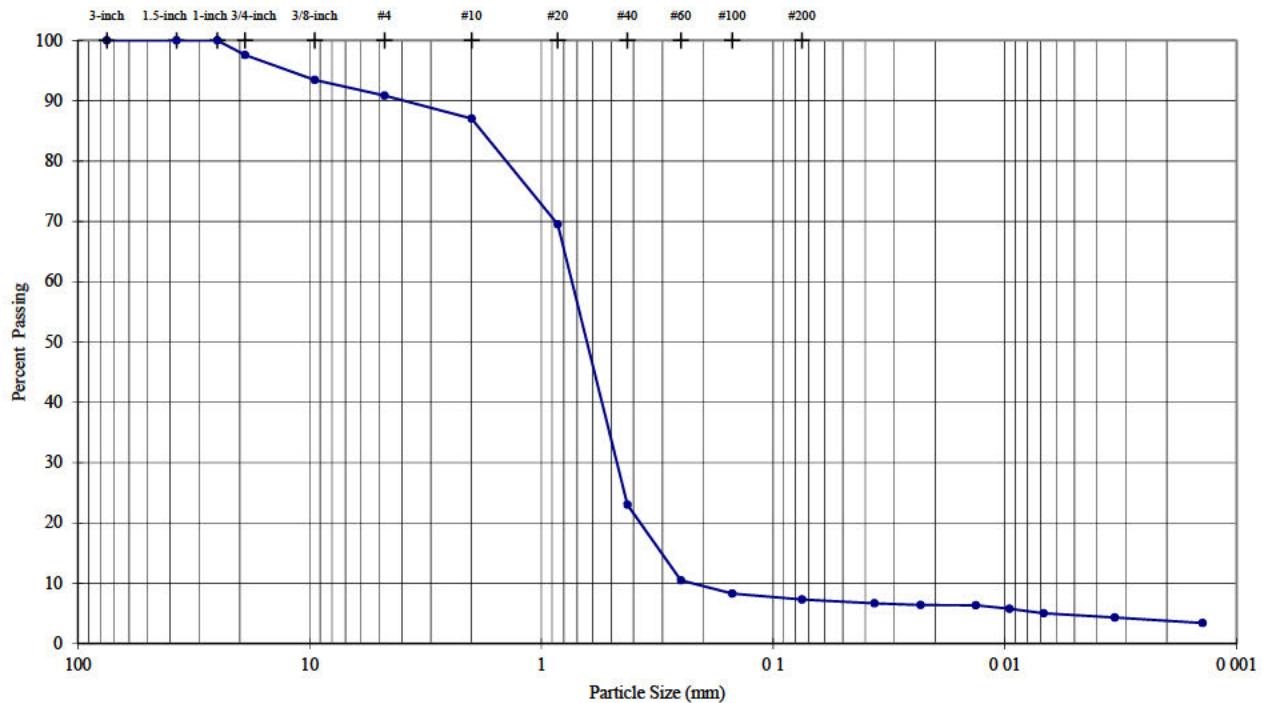

Sieve	Particle Size		Description	Percentage
	(mm)	% Passing		
3-inch	75.0	100.0	Coarse Gravel	2.42
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	97.6	Fine Gravel	6.74
3/8-inch	9.5	93.5		
#4	4.75	90.8	Coarse Sand	3.80
#10	2.00	87.0		
#20	0.850	69.5		
#40	0.425	23.0	Medium Sand	64.02
#60	0.250	10.5		
#100	0.150	8.3		
#200	0.075	7.3	Fine Sand	15.71
	0.037	6.7		
	0.023	6.4		
	0.013	6.4	Silt or Clay Fines	7.31
	0.010	5.8		
	0.007	5.0		
	0.003	4.3		
	0.001	3.4		

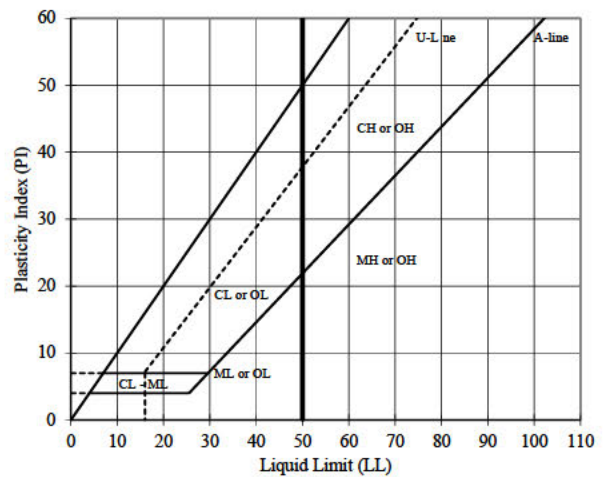

USCS Description (ASTM D 2487):

Poorly graded sand with silt, brownish yellow, moist

LL	PL	PI	SpG
NP	NP	NP	—

As-Received Moisture Content (%)

—

USCS Group Symbol

SP-SM

Notes: 0 g of particles up to 25.0 mm maximum size were removed from particle size analysis sample prior to testing
Particle size analysis sample mechanically dispersed using Stirring Apparatus A for about 1 minute
Sample prepared for Atterberg Limits testing by the dry method
Material retained on No. 40 sieve removed from Atterberg Limits sample by sieving
Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using mechanical device

TECH	AR
DATE	1-Aug-2018
REVIEW	MB

Boring or Test Pit: --
 Sample: RP-8D
 Depth: 53-60 ft.
 Point No.: 1

Boring or Test Pit: --
 Sample: RP-8D
 Depth: 53-60 ft.
 Point No.: 2

Boring or Test Pit: --
 Sample: RP-8D
 Depth: 53-60 ft.
 Point No.: 3

Initial		Initial		Initial	
Thickness =	1.191 in	Thickness =	1.189 in	Thickness =	1.186 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Wet Mass =	0.410 lb	Wet Mass =	0.409 lb	Wet Mass =	0.409 lb
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.85 in ³	Volume =	5.84 in ³	Volume =	5.82 in ³
Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)	Specific Gravity =	2.70 (Assumed)
Dry Mass of Solids =	0.395 lb	Dry Mass of Solids =	0.394 lb	Dry Mass of Solids =	0.394 lb
Moisture Content =	3.7%	Moisture Content =	3.9%	Moisture Content =	3.8%
Wet Unit Weight =	121.2 pcf	Wet Unit Weight =	121.2 pcf	Wet Unit Weight =	121.3 pcf
Dry Unit Weight =	116.9 pcf	Dry Unit Weight =	116.6 pcf	Dry Unit Weight =	116.9 pcf
Void Ratio =	0.44	Void Ratio =	0.44	Void Ratio =	0.44
Percent Saturation =	23%	Percent Saturation =	24%	Percent Saturation =	23%

Pre-Shear		Pre-Shear		Pre-Shear	
Thickness =	1.173 in	Thickness =	1.170 in	Thickness =	1.162 in
Diameter =	2.50 in	Diameter =	2.50 in	Diameter =	2.50 in
Area =	4.91 in ²	Area =	4.91 in ²	Area =	4.91 in ²
Volume =	5.76 in ³	Volume =	5.74 in ³	Volume =	5.71 in ³
Moisture Content =	12.9%	Moisture Content =	12.0%	Moisture Content =	12.9%
Wet Unit Weight =	134.0 pcf	Wet Unit Weight =	132.8 pcf	Wet Unit Weight =	134.6 pcf
Dry Unit Weight =	118.7 pcf	Dry Unit Weight =	118.5 pcf	Dry Unit Weight =	119.3 pcf
Void Ratio =	0.42	Void Ratio =	0.42	Void Ratio =	0.41
Percent Saturation =	83%	Percent Saturation =	77%	Percent Saturation =	85%

Shear Rate = 0.0033 in/min	Shear Rate = 0.0033 in/min	Shear Rate = 0.0033 in/min
Normal Stress = 7,200 psf	Normal Stress = 14,400 psf	Normal Stress = 21,600 psf

Notes:

USCS description (ASTM D2487): Poorly graded sand with silt, brownish yellow, moist

Atterberg limits: LL = NP PL = NP PI = NP (ASTM D4318)

Percent finer: 3/4 in. = 98% No. 4 = 91% No. 200 = 7% (ASTM D422, refer to separate report)

Specimen type: ☐ Intact ☒ Reconstituted

Inundation: At seating load

Apparatus: 2.5 -inch nominal diameter box, GeoTac automated test system, GeoJac loading system


Gravel retained on the #4 sieve removed from sample prior to testing

Specimens were reconstituted at near estimated optimum moisture content using heavy compactive effort


Project Name: FTN/Entergy Independence/AR		ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SAMPLE AND TEST DATA				
Project Number: 18103172.01						
Sample ID: RP-8D @ 53 - 60 ft.		Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 1



Shear Stress vs. Relative Lateral Displacement

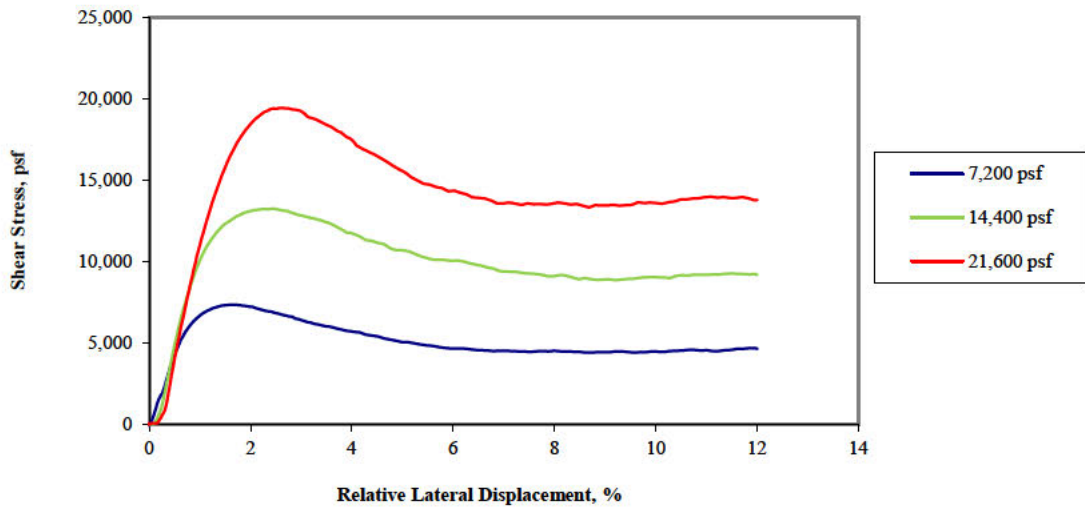

Normal Displacement vs. Relative Lateral Displacement

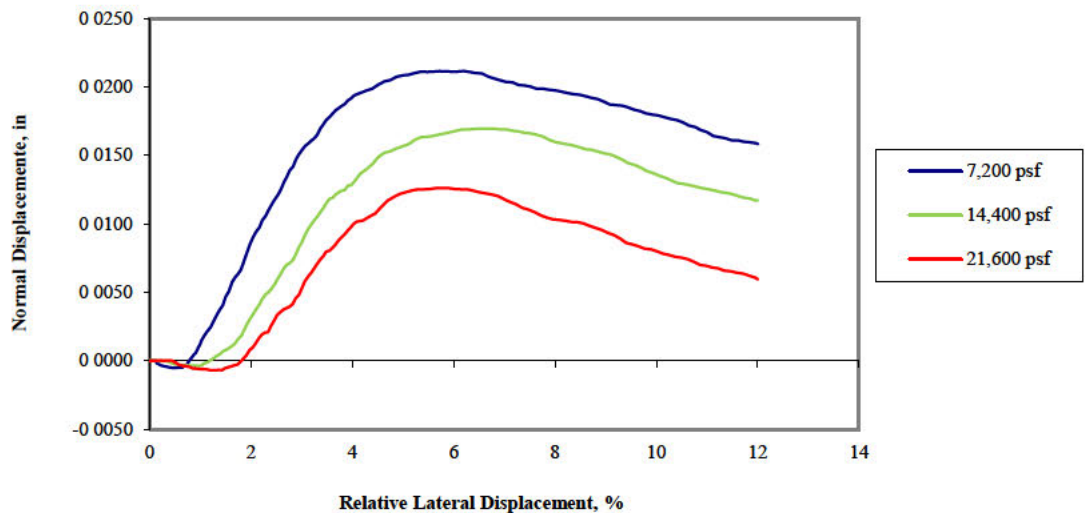

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

Sample ID:

RP-8D @ 53 - 60 ft.

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
SHEAR STRESS AND NORMAL DISPLACEMENT PLOTS

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

2



The figure consists of three vertically stacked graphs, each showing the relationship between Normal Displacement (in) on the y-axis and the Square Root of Time ($\text{min}^{1/2}$) on the x-axis. The y-axis for all graphs ranges from 0.0000 to 0.0100 in increments of 0.0001. The x-axis for the top graph ranges from 0 to 70, while the bottom two range from 0 to 100.

- Top Graph (7,215 psf):** The displacement starts at 0.0000 at time 0, drops sharply to approximately 0.0088 by $\sqrt{t} = 1$, and then gradually increases to about 0.0090 by $\sqrt{t} = 65$.
- Middle Graph (14,396 psf):** The displacement starts at 0.0000 at time 0, drops sharply to approximately 0.0058 by $\sqrt{t} = 1$, and then gradually increases to about 0.0055 by $\sqrt{t} = 90$.
- Bottom Graph (21,599 psf):** The displacement starts at 0.0000 at time 0, drops sharply to approximately 0.0080 by $\sqrt{t} = 1$, and then gradually increases to about 0.0088 by $\sqrt{t} = 90$.

In all three cases, the displacement initially decreases rapidly and then levels off or slightly increases over time, with the final displacement being higher for higher load intensities.

[illegible]

3

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
CONSOLIDATION DATA



GOLDER

Point No : 1
 Normal Stress = 7,200 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
638	0.1	0.0000
1,592	0.2	-0.0003
2,291	0.3	-0.0004
3,332	0.4	-0.0005
4,079	0.5	-0.0005
4,860	0.6	-0.0005
5,505	0.7	-0.0004
5,980	0.8	0.0000
6,346	0.9	0.0005
6,636	1.0	0.0011
7,316	1.4	0.0041
7,238	2.0	0.0086
6,871	2.5	0.0118
6,480	2.9	0.0151
6,037	3.5	0.0176
5,729	4.0	0.0192
5,469	4.4	0.0199
5,059	5.0	0.0208
4,870	5.5	0.0211
4,666	6.0	0.0211
4,589	6.4	0.0210
4,538	6.9	0.0205
4,493	7.4	0.0201
4,530	8.0	0.0197
4,477	8.5	0.0194
4,438	9.0	0.0189
4,470	9.4	0.0185
4,491	9.9	0.0180

Point No : 2
 Normal Stress = 14,400 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
60	0.1	0.0000
683	0.2	0.0000
1,540	0.3	0.0000
3,330	0.4	-0.0001
4,533	0.5	-0.0002
5,943	0.6	-0.0003
7,154	0.7	-0.0004
8,196	0.8	-0.0004
9,104	0.9	-0.0003
9,939	1.0	-0.0004
12,176	1.4	0.0007
13,085	2.0	0.0031
13,247	2.5	0.0056
12,865	2.9	0.0083
12,418	3.5	0.0115
11,763	4.0	0.0128
11,264	4.4	0.0143
10,710	5.0	0.0156
10,229	5.5	0.0163
10,043	6.0	0.0167
9,819	6.4	0.0169
9,417	6.9	0.0169
9,284	7.4	0.0166
9,115	8.0	0.0160
8,924	8.5	0.0156
8,893	9.0	0.0151
8,929	9.4	0.0144
9,053	9.9	0.0137

Point No : 3
 Normal Stress = 21,600 psf
 Shear Rate = 0.0033 in/min

Shear Stress	Relative Lateral Displacement	Normal Displacement
psf	%	in
100	0.1	0.0000
177	0.2	0.0000
771	0.3	0.0000
2,172	0.4	0.0000
3,625	0.5	-0.0001
5,295	0.6	-0.0003
6,825	0.7	-0.0004
8,301	0.8	-0.0005
9,731	0.9	-0.0005
10,784	1.0	-0.0006
15,681	1.5	-0.0005
18,319	2.0	0.0008
19,377	2.5	0.0029
19,284	2.9	0.0048
18,414	3.5	0.0080
17,547	4.0	0.0097
16,563	4.5	0.0107
15,651	4.9	0.0122
14,773	5.4	0.0125
14,313	5.9	0.0126
13,941	6.4	0.0124
13,567	7.0	0.0118
13,561	7.5	0.0110
13,548	8.0	0.0103
13,536	8.4	0.0101
13,451	8.9	0.0095
13,462	9.4	0.0086
13,618	9.9	0.0081

Project Name:

FTN/Entergy Independence/AR

Project Number:

18103172.01

ASTM D3080

CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT
 SHEAR DATA

Sample ID:

RP-8D @ 53 - 60 ft.

Technician:

MAB

Checked:

PRH

Reviewed:

MK

Date:

15-Aug-2018

Figure:

4



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT SPECIMEN PHOTOGRAPH - 7,200 psf				
Project Number: 18103172.01					
Sample ID: RP-8D @ 53 - 60 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 5



Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-8D @ 53 - 60 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 6




Project Name: FTN/Entergy Independence/AR	ASTM D3080 CONSOLIDATED DRAINED DIRECT SHEAR TEST REPORT				
Project Number: 18103172.01					
Sample ID: RP-8D @ 53 - 60 ft.	Technician: MAB	Checked: PRH	Reviewed: MK	Date: 15-Aug-2018	Figure: 7

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-8D
 TYPE: Bag

Depth: 68.0-70.0'

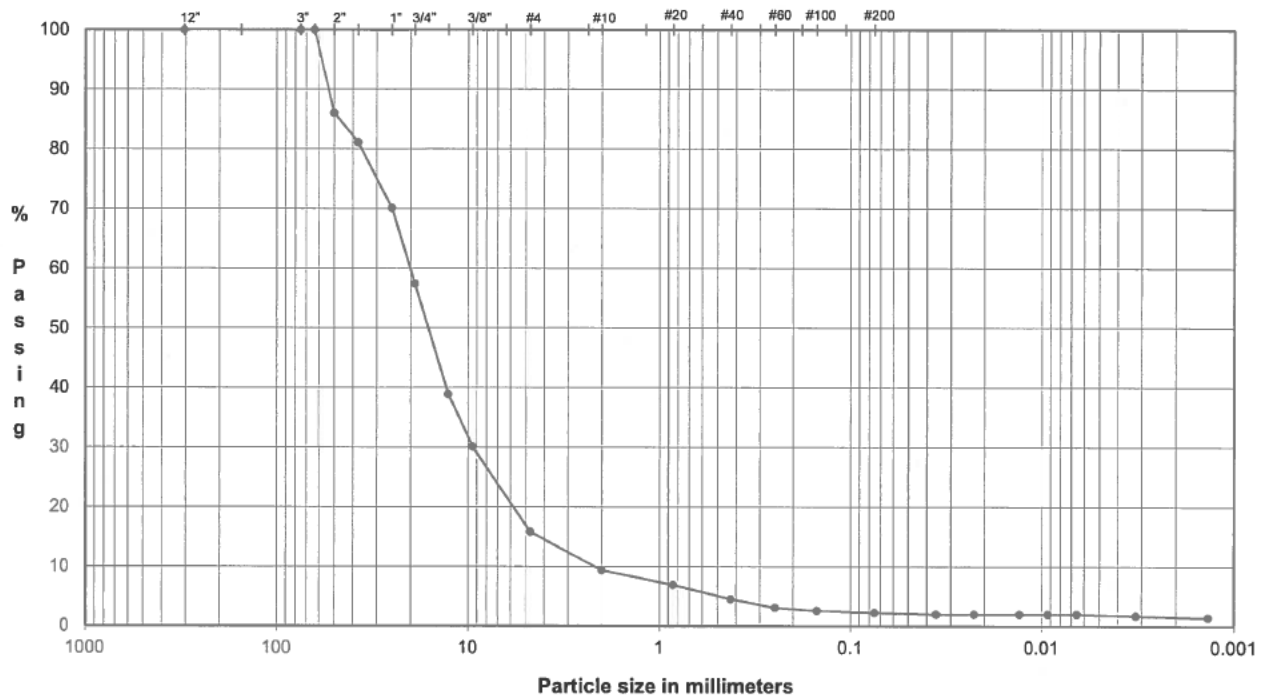

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	86.0	
1.5"	37.5	81.1	
1.0"	25.0	70.1	
0.75"	19.0	57.4	Coarse Gravel
0.50"	12.7	38.9	
0.375"	9.5	30.1	
#4	4.8	15.8	Fine Gravel
#10	2.00	9.4	Coarse Sand
#20	0.85	6.9	
#40	0.43	4.5	Medium Sand
#60	0.25	3.1	
#100	0.15	2.6	
#200	0.075	2.3	Fine Sand

Hydrometer Analysis

(mm)	% Finer	Classification	Percentage
0.036	2.0		
0.023	2.0		
0.013	2.0		
0.0093	2.0	Fines	
0.0066	2.0	Silt or Clay	
0.0032	1.7		
0.0014	1.4		

DESCRIPTION: sandy GRAVEL, fine to coarse, fine to coarse sand, trace fines; brown.

USCS: GW

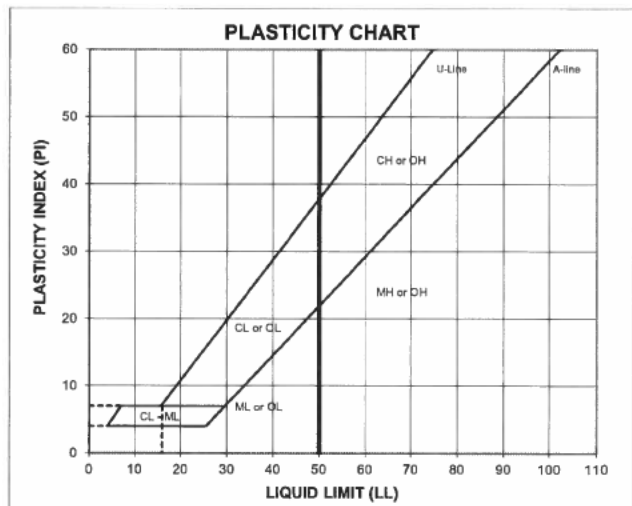

ATTERBERG LIMITS

Method -B (Dry preparation)

N _c	LL	PL	PI	LI
7.2	-	-	-	-

LL (oven-dried)
 < 0.75 ORGANIC (LO/OH)


TECH TJ/HH/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

NOTE: Insufficient sample received to perform in accordance with ASTM Standards

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **FTN/ENTERGY INDEPENDENCE/AR**
SAMPLE ID: **RP-9**
TYPE: **Bag**

Depth: **24.0-26.0'**

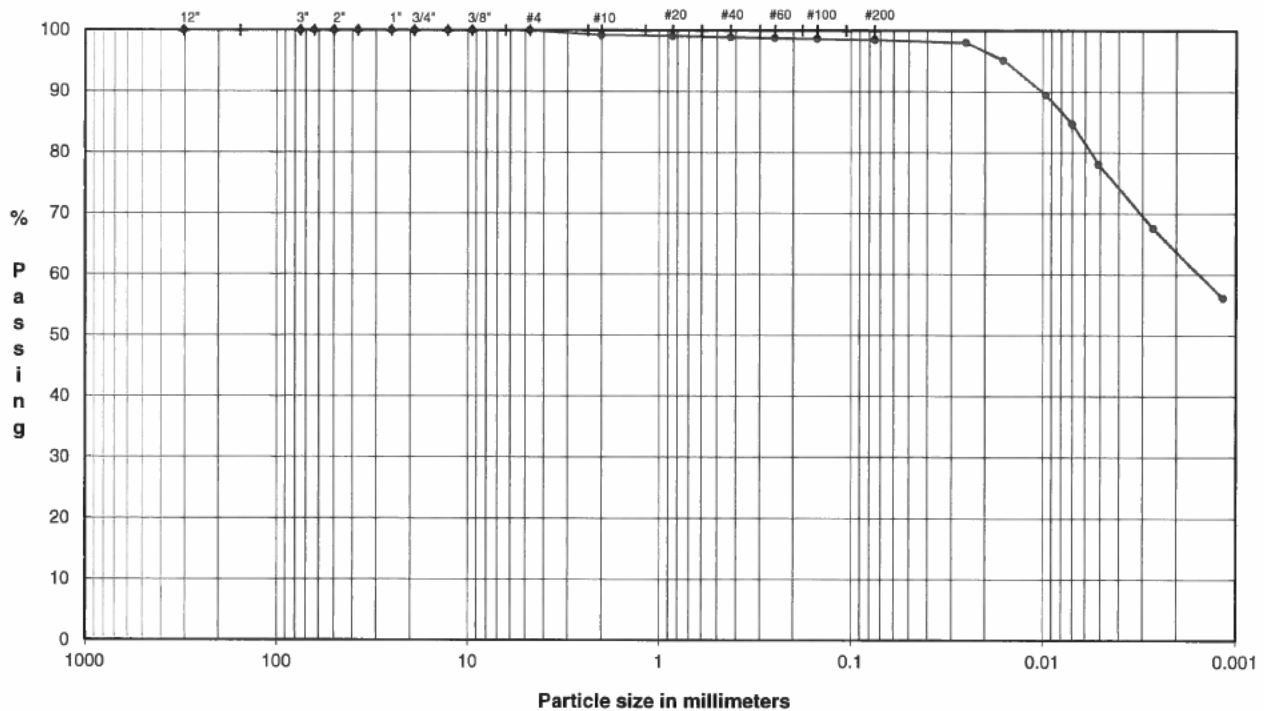

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.2	
#20	0.85	99.1	
#40	0.43	98.9	
#60	0.25	98.7	
#100	0.15	98.6	
#200	0.075	98.4	

Hydrometer Analysis

(mm)	% Finer		
0.025	98.0		
0.016	95.2		
0.010	89.5		
0.0070	84.7		
0.0051	78.0		
0.0026	67.6		
0.0012	56.1		

DESCRIPTION: **CLAY, trace fine to coarse sand; dark yellowish brown.**

USCS: **CH**

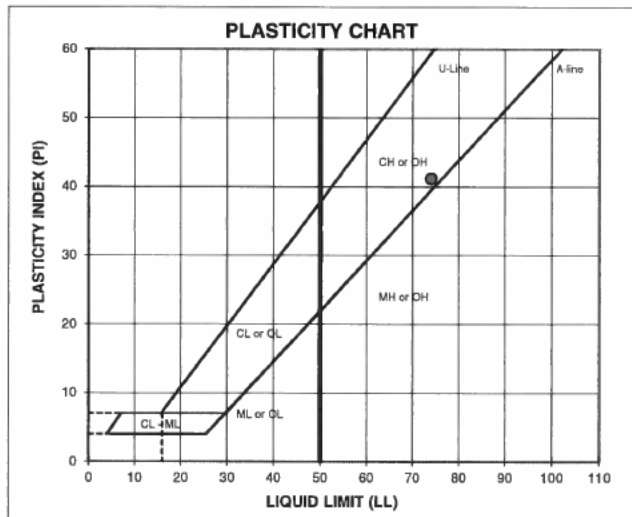

ATTERBERG LIMITS Method -B (Dry preparation)

M _L	LL	PL	PI	LI
37.5	74	33	41	0.10

LL (oven-dried)

< 0.75 = ORGANIC (OL/OH)

TECH **TJ/HH/BA**

DATE **7/30/18**

CHECK **[Signature]**


REVIEW **[Signature]**

APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
SAMPLE ID: RP-9
TYPE: Bag


Depth: 45.0-46.0'

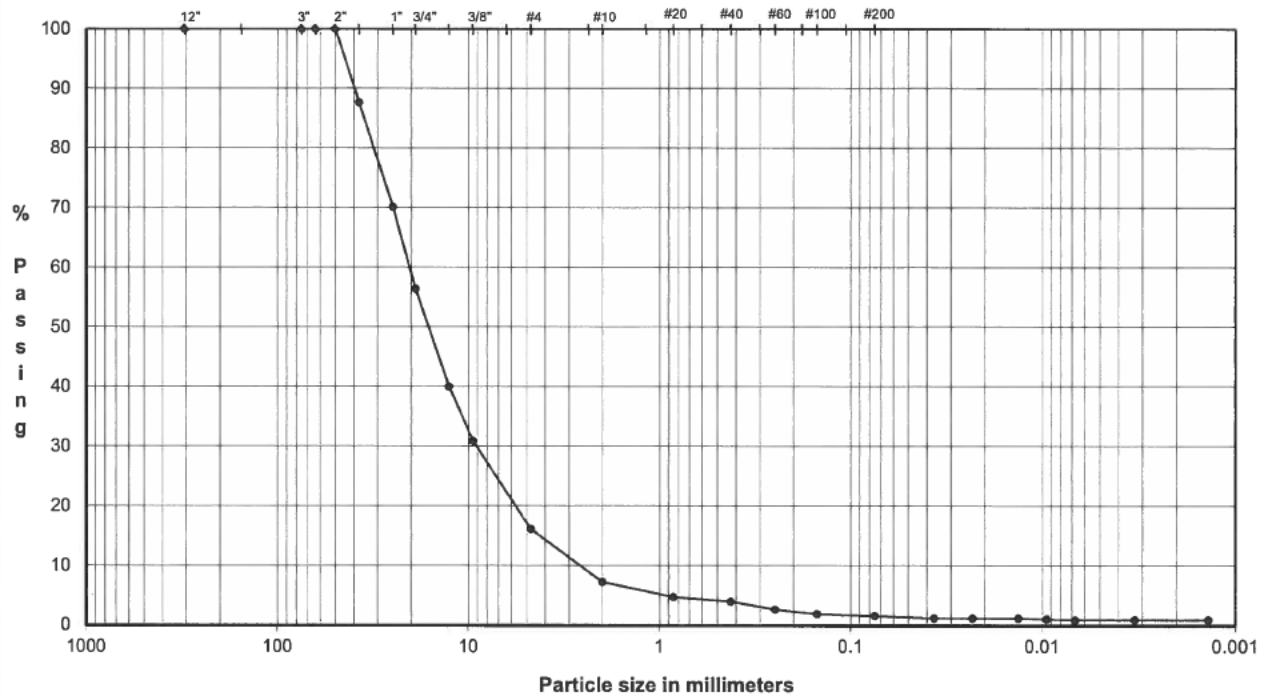

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	87.6	
1.0"	25.0	70.1	
0.75"	19.0	56.4	Coarse Gravel
0.50"	12.7	39.9	
0.375"	9.5	30.8	
#4	4.8	16.0	Fine Gravel
#10	2.00	7.2	Coarse Sand
#20	0.85	4.7	
#40	0.43	3.9	Medium Sand
#60	0.25	2.6	
#100	0.15	1.8	
#200	0.075	1.5	Fine Sand

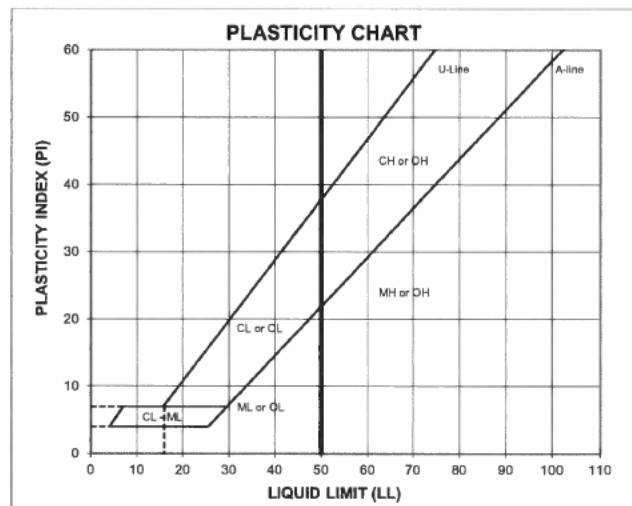

Hydrometer Analysis

(mm)	% Finer		
0.037	1.1		
0.023	1.1		
0.013	1.1		
0.0095	1.0		
0.0067	0.8		
0.0033	0.8		
0.0014	0.8		

DESCRIPTION: sandy GRAVEL; fine to coarse, fine to coarse sand, trace fines; dark yellowish brown.

USCS: GW

ATTERBERG LIMITS Method -B (Dry preparation)

M _L	LL	PL	PI	LI
7.8	NP	NP	NP	NP

LL (oven-dried)
≤ 0.75 = ORGANIC (LO/OH)

TECH TJ/HH/BA
DATE 7/30/18
CHECK [Signature]
REVIEW [Signature]
APPROVE [Signature]


NOTE: Insufficient sample received to perform in accordance with ASTM Standards

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-10
 TYPE: Bag

Depth: 24.0-25.0'

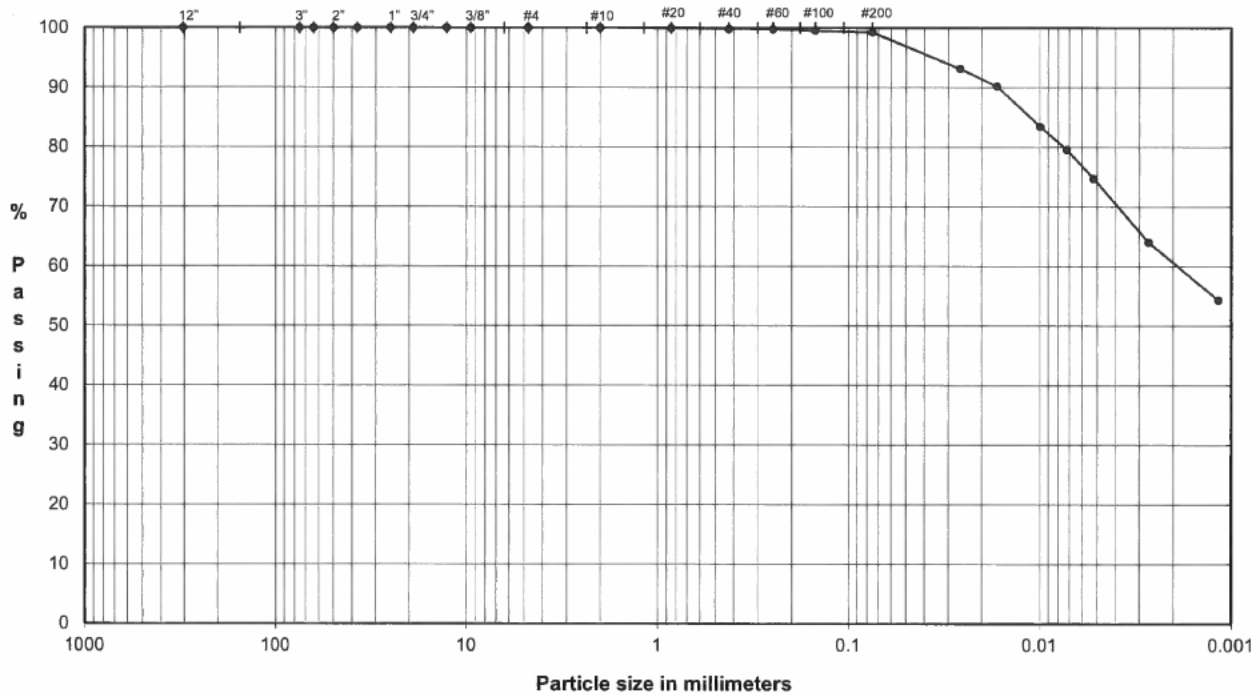

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES


U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	100.0	
#20	0.85	99.9	
#40	0.43	99.8	
#60	0.25	99.7	
#100	0.15	99.5	
#200	0.075	99.2	

(mm)	% Finer		
0.026	93.1		
0.017	90.2		
0.010	83.4		
0.0072	79.5		
0.0052	74.7		
0.0027	64.0		
0.0012	54.3		

DESCRIPTION: CLAY, trace fine to medium sand; grayish brown.

USCS: CH

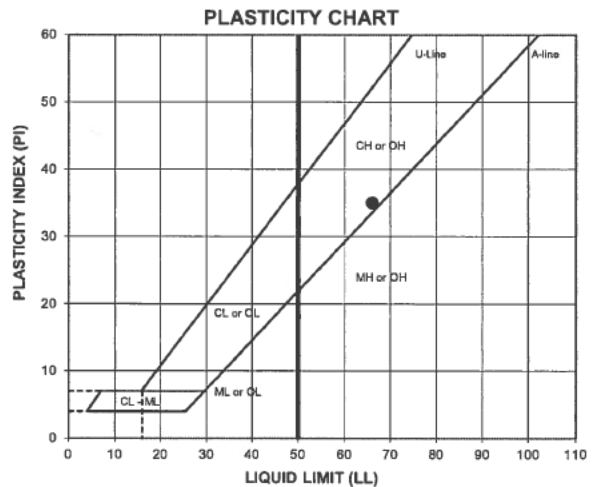

ATTERBERG LIMITS

Method -B (Dry preparation)

M _L	LL	PL	PI	LI
32.9	66	31	35	0.06

LL (oven-dried)
 < 0.75 ORGANIC (OL/OH)


TECH TJ/BA/HH
 DATE 7/30/18
 CHECK *[Signature]*
 REVIEW *[Signature]*
 APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: RP-10
 TYPE: Bag

Depth: 33.0-35.0'

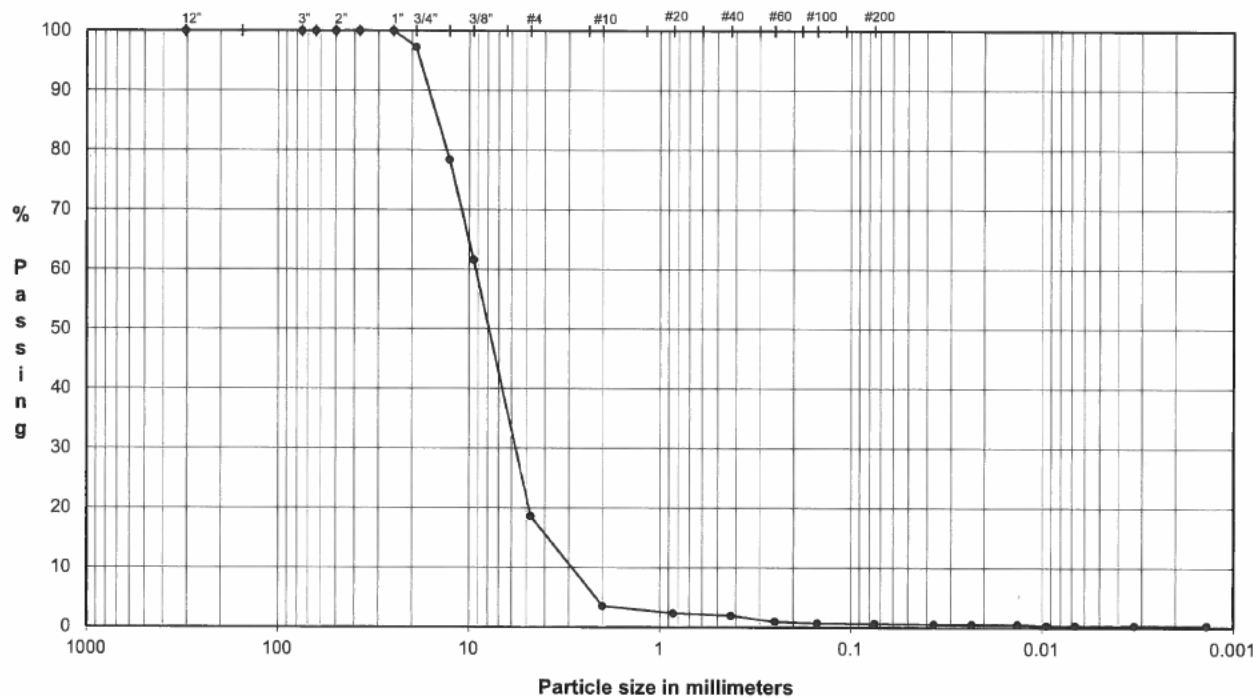

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	97.2	Coarse Gravel
0.50"	12.7	78.4	
0.375"	9.5	61.6	
#4	4.8	18.6	Fine Gravel
#10	2.00	3.5	Coarse Sand
#20	0.85	2.3	
#40	0.43	1.9	Medium Sand
#60	0.25	1.0	
#100	0.15	0.7	
#200	0.075	0.6	Fine Sand


Hydrometer Analysis

(mm)	% Finer	Classification	Percentage
0.037	0.5		
0.023	0.5		
0.013	0.5		
0.0095	0.3	Fines	
0.0067	0.3	Silt or Clay	
0.0033	0.3		
0.0014	0.3		

DESCRIPTION: sandy GRAVEL, fine to coarse, fine to coarse sand, trace fines; reddish brown.

USCS: GP

PLASTICITY CHART

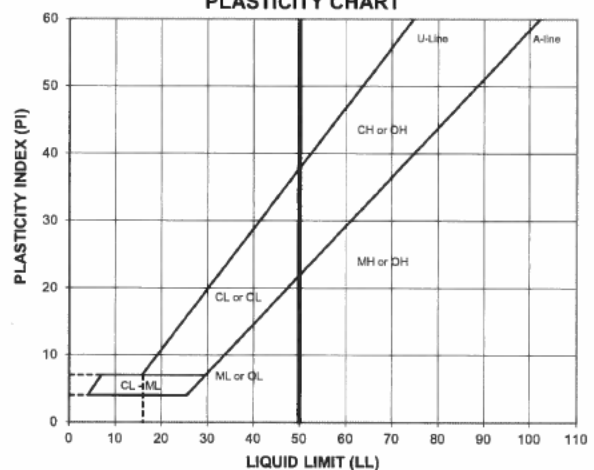

ATTERBERG LIMITS

Method -B (Dry preparation)

LL	LL	PL	PI	LI
6.6	NP	NP	NP	NP

LL (oven-dried)
 < 0.75 = ORGANIC
 (OL/OH)


TECH TJ/HH/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: PZ-1
 TYPE: UD

Depth: 5.0-7.0'

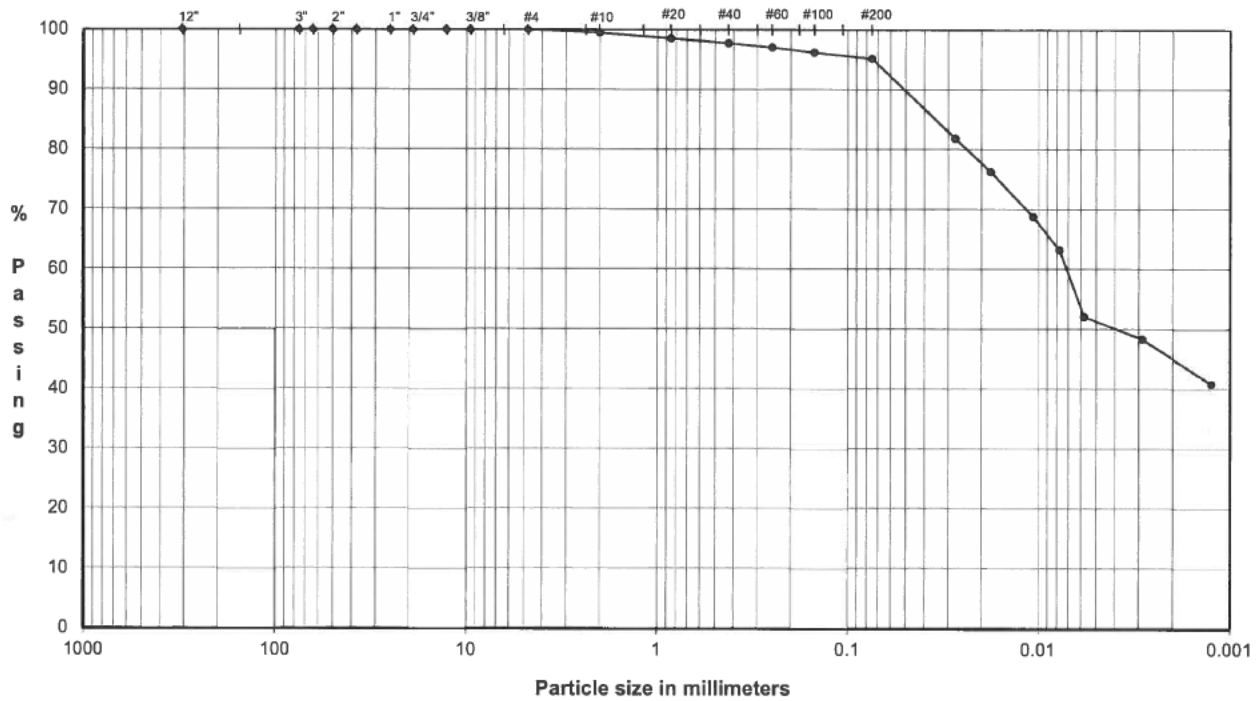

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	99.5	
#20	0.85	98.5	
#40	0.43	97.7	
#60	0.25	97.0	
#100	0.15	96.2	
#200	0.075	95.1	

Hydrometer Analysis

(mm)	% Finer		
0.027	81.8		
0.018	76.2		
0.011	68.8		
0.0078	63.2		
0.0058	52.0		
0.0029	48.3		
0.0012	40.9		

DESCRIPTION: SILTY CLAY, trace fine to coarse sand; brown.

USCS: CL

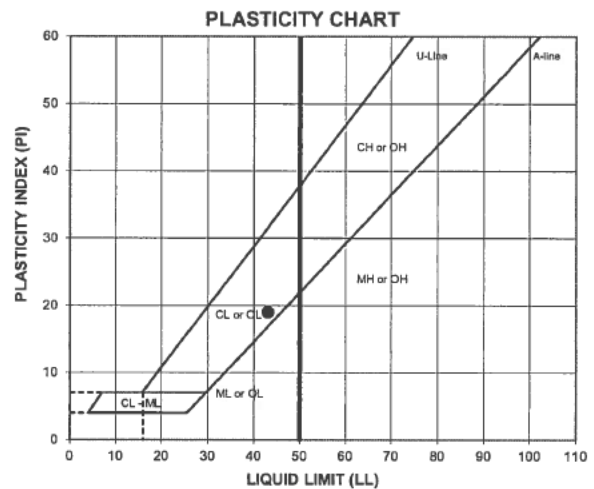
 ATTERBERG LIMITS
 Method -B (Dry preparation)

M _L	LL	PL	PI	LI
22.8	43	24	19	-0.04

 LL (oven-dried)
 0.75 ORGANIC (OL/OH)

TECH TJ/HEH
 DATE 6/5/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

FLEXIBLE WALL PERMEABILITY
ASTM D 5084
METHOD D, CONSTANT RATE OF FLOW

PROJECT TITLE FTN/ENTERGY INDEPENDENCE/AR
PROJECT NUMBER 18103172
SAMPLE ID PZ-1 5.0-7.0'
SAMPLE TYPE UD

Board # 2
Flow Pump 2
Flow Pump Speed 10
Technician FT

COMMENTS

Sample Data, Initial

Height, inches	3.001	B-Value, f	0.98
Diameter, inches	2.865	Cell Pres.	88.0
Area, cm ²	41.59	Bot. Pres.	80.0
Volume, cm ³	317.03	Top Pres.	80.0
Mass, g	642.10	Tot. B.P.	80.0
Moisture Content, %	22.79	Head, max.	132.24
Dry Density, pcf	102.92	Head, min.	132.24
Spec. Gravity (assumed)	2.750	Max. Grad.	17.34
Volume Solids, cm ³	190.16	Min. Grad.	17.34
Volume Voids, cm ³	126.88		
Void Ratio	0.67		
Saturation, %	93.9%		

Sample Data, Final

Height, inches	3.002
Diameter, inches	2.872
Area, cm ²	41.80
Volume, cm ³	318.69
Mass, g	649.74
Moisture Content, %	24.25
Dry Density, pcf	102.39
Volume Solids, cm ³	190.16
Volume Voids, cm ³	128.54
Void Ratio	0.68
Saturation, %	98.7%

WATER CONTENTS

Wt Soil & Tare, i g
Wt Soil & Tare, f g
Wt Tare g
Wt Moisture Lost g
Wt Dry Soil g
Water Content %

Sample Initial

642.10
522.93
0.00
119.17
522.93
22.79%

Sample Final

732.03
605.24
82.40
126.79
522.84
24.25%

DESCRIPTION

SILTY CLAY, trace fine to coarse sand; brown.

Flow Pump Rate 2.25E-05 cm³/sec

USCS CL

TIME FUNCTIONS, SECONDS								dP	Reading	Head	Gradient	Permeability
DATE	DAY	HOUR	MIN	TEMP	dt	dt,acc	dt	dt,acc				
				(°C)	(min)	(min)	(sec)	(sec)	(psi)	(cm)		(cm/sec)
06/06/18	43257	13	0	20.8	0	0	0	0	1.88	132.24	17.34	3.0E-08
06/06/18	43257	13	5	20.8	5	5	300	300	1.88	132.24	17.34	3.0E-08
06/06/18	43257	13	10	20.8	5	10	300	600	1.88	132.24	17.34	3.0E-08
06/06/18	43257	13	15	20.8	5	15	300	900	1.88	132.24	17.34	3.0E-08 *
06/06/18	43257	13	20	20.8	5	20	300	1200	1.88	132.24	17.34	3.0E-08 *
06/06/18	43257	13	25	20.8	5	25	300	1500	1.88	132.24	17.34	3.0E-08 *
06/06/18	43257	13	30	20.8	5	30	300	1800	1.88	132.24	17.34	3.0E-08 *

*TRANSCRIBED FROM ORIGINAL DATA SHEETS

PERMEABILITY REPORTED AS ** 3.0E-08 cm/sec **


DATE 6/6/18
CHECK
REVIEW
APPROVE

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENERGY INDEPENDENCE/AR
 SAMPLE ID: PZ-1
 TYPE: UD

Depth: 10.0-12.0'

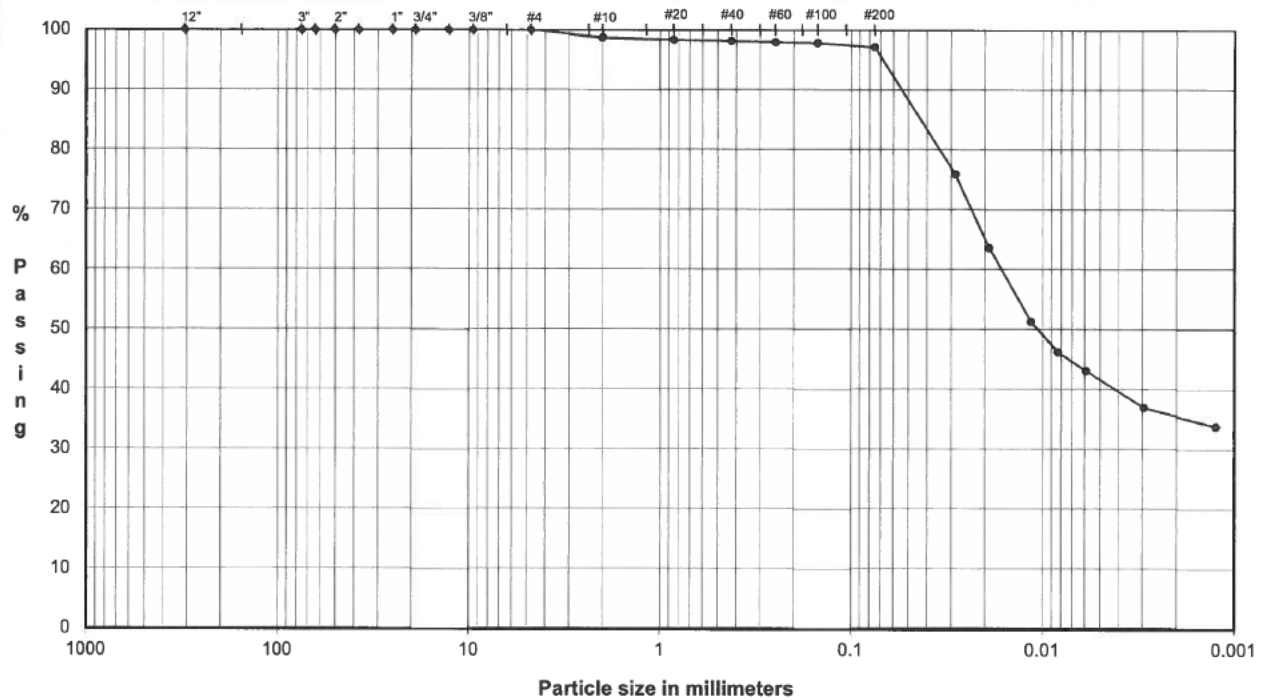

COBBLES	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	
#10	2.00	98.7	1.3
#20	0.85	98.3	
#40	0.43	98.1	
#60	0.25	97.9	
#100	0.15	97.7	
#200	0.075	97.1	1.0

Hydrometer Analysis

(mm)	% Finer	Classification	Percentage
0.028	75.9		
0.019	63.6		
0.011	51.3		
0.0083	46.1		
0.0059	43.1		
0.0030	36.9		
0.0012	33.8		

DESCRIPTION: SILTY CLAY, trace fine to coarse sand; dark olive and grayish brown.

USCS: CL

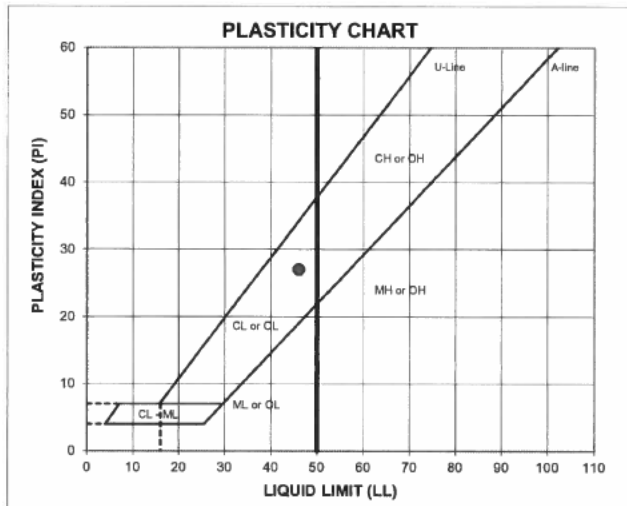

ATTERBERG LIMITS
 Method -B (Dry preparation)

LL	PL	PI	LI
30.9	46	19	27

LL (oven-dried)
 0.75 - ORGANIC (LO/OH)

TECH TB/HH
 DATE 6/18/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

Boring or Test Pit: **PZ-1**
 Sample: **UD**
 Depth: **10.0-12.0** ft
 Point No.: **1**

Initial
 Length = **6.005** in
 Diameter = **2.859** in
 Wet Mass = 2.733 lb
 Area = 6.420 in²
 Volume = 38.551 in³
 Specific Gravity = **2.72** (ASTM D854)
 Dry Mass of Solids = 2.153 lb
 Moisture Content = **26.9%**
 Wet Unit Weight = 122.5 pcf
 Dry Unit Weight = 96.5 pcf
 Void Ratio = 0.75
 Percent Saturation = 97%

After Consolidation
 Length = **5.981** in
 Diameter = 2.887 in
 Area = 6.546 in² (Method B)
 Volume = 39.149 in³
 Moisture Content = **28.7%**
 Wet Unit Weight = 122.4 pcf
 Dry Unit Weight = 95.0 pcf
 Void Ratio = 0.78
 Percent Saturation = 100%

B Parameter = **0.98**
 Shear Rate = 0.090% /min.
 t_{50} = **1.46** min.
 Strain at Failure = 3.5%

Cell Pressure = **80.0** psi
 Back Pressure = **70.0** psi
 Confining Pressure = 10.0 psi

Boring or Test Pit: **PZ-1**
 Sample: **UD**
 Depth: **10.0-12.0** ft
 Point No.: **2**

Initial
 Length = **6.006** in
 Diameter = **2.865** in
 Wet Mass = 2.617 lb
 Area = 6.447 in²
 Volume = 38.719 in³
 Specific Gravity = **2.72** (ASTM D854)
 Dry Mass of Solids = 1.964 lb
 Moisture Content = **33.3%**
 Wet Unit Weight = 116.8 pcf
 Dry Unit Weight = 87.7 pcf
 Void Ratio = 0.93
 Percent Saturation = 97%

After Consolidation
 Length = **5.958** in
 Diameter = 2.873 in
 Area = 6.482 in² (Method B)
 Volume = 38.622 in³
 Moisture Content = **34.1%**
 Wet Unit Weight = 117.8 pcf
 Dry Unit Weight = 87.9 pcf
 Void Ratio = 0.93
 Percent Saturation = 100%

B Parameter = **0.98**
 Shear Rate = 0.090% /min.
 t_{50} = **3.03** min.
 Strain at Failure = 2.2%

Cell Pressure = **90.0** psi
 Back Pressure = **70.0** psi
 Confining Pressure = 20.0 psi

Boring or Test Pit: **PZ-1**
 Sample: **UD**
 Depth: **10.0-12.0** ft
 Point No.: **3**

Initial
 Length = **6.009** in
 Diameter = **2.869** in
 Wet Mass = 2.653 lb
 Area = 6.465 in²
 Volume = 38.847 in³
 Specific Gravity = **2.72** (ASTM D854)
 Dry Mass of Solids = 2.003 lb
 Moisture Content = **32.5%**
 Wet Unit Weight = 118.0 pcf
 Dry Unit Weight = 89.1 pcf
 Void Ratio = 0.90
 Percent Saturation = 98%

After Consolidation
 Length = **5.950** in
 Diameter = 2.869 in
 Area = 6.463 in² (Method B)
 Volume = 38.453 in³
 Moisture Content = **32.4%**
 Wet Unit Weight = 119.2 pcf
 Dry Unit Weight = 90.0 pcf
 Void Ratio = 0.88
 Percent Saturation = 100%

B Parameter = **0.99**
 Shear Rate = 0.051% /min.
 t_{50} = **7.07** min.
 Strain at Failure = 3.1%

Cell Pressure = **100.0** psi
 Back Pressure = **70.0** psi
 Confining Pressure = 30.0 psi

Notes: Sample description: **(CL) SILTY CLAY, trace fine to coarse sand; dark olive and grayish brown.**
 Atterberg limits: LL = **46** PL = **19** PI = **24** (ASTM D4318)
 Percent finer: 3/4 in. = **100%** No. 4 = **100%** No. 200 = **97%** (ASTM D422, refer to separate report for gradation curve)
 Specimen type: ☒ Intact ☐ Reconstituted
 Moisture from: ☐ Cuttings ☒ Entire specimen
 Saturation method: ☒ Wet ☐ Dry
 Failure criterion: ☒ $(\sigma'_1/\sigma'_3)_{max}$ ☐ $(\sigma'_1 - \sigma'_3)_{max}$ % strain
 Membrane effect: ☒ Corrected ☐ Not Corrected

Golder Associates Inc.
Atlanta, Georgia

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SAMPLE AND TEST DATA

Job Short Title:

FTN/ENERGY INDEPENDENCE/AR

Sample:

PZ-1 UD 10.0-12.0'

Technician:

FT/PWM

Check:

Reviewed:

[Signature]

Approved:

Start Date:



6/25/2018

Job Number:



18103172

Figure:

1

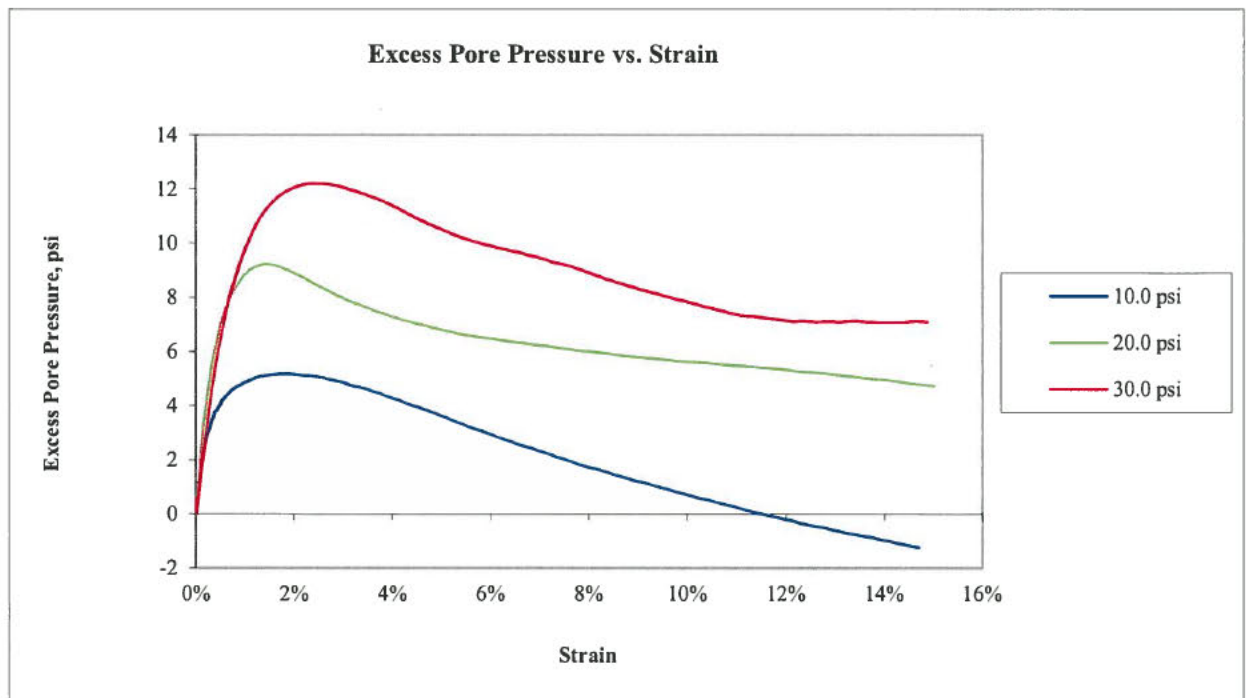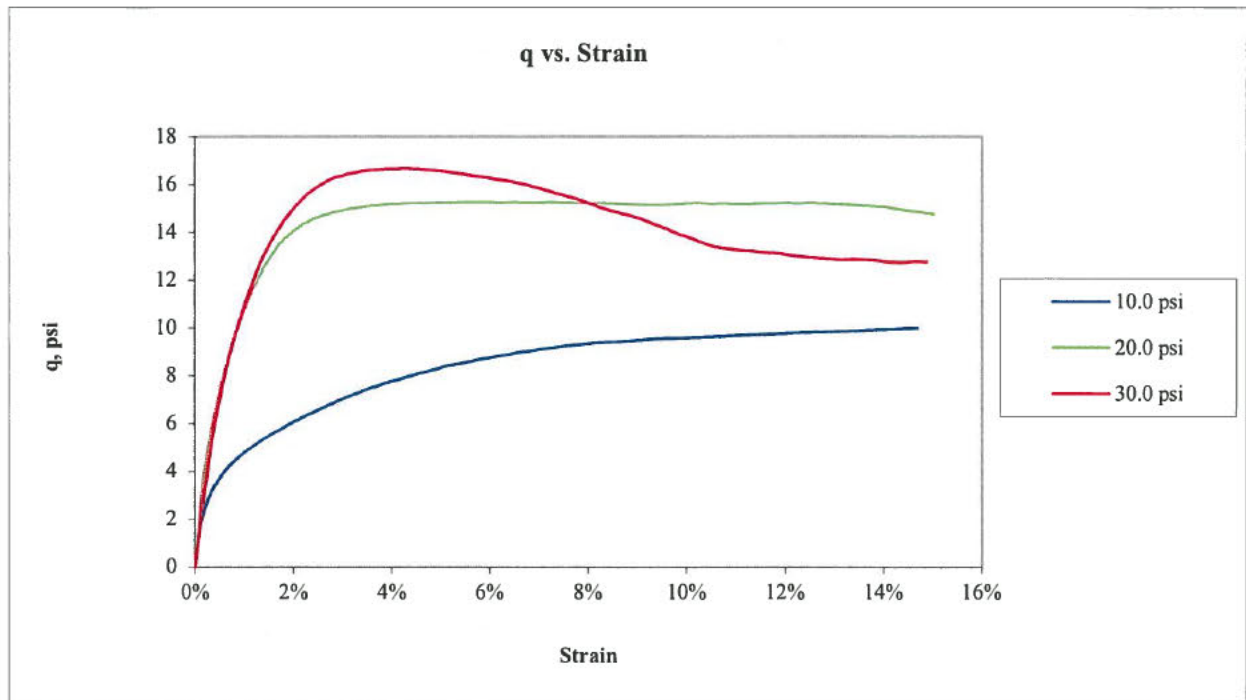


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS			
Job Short Title: FTN/ENERGY INDEPENDENCE/AR					
Sample: PZ-1 UD 10.0-12.0'					
Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/25/2018	Job Number: 18103172	Figure: 2	

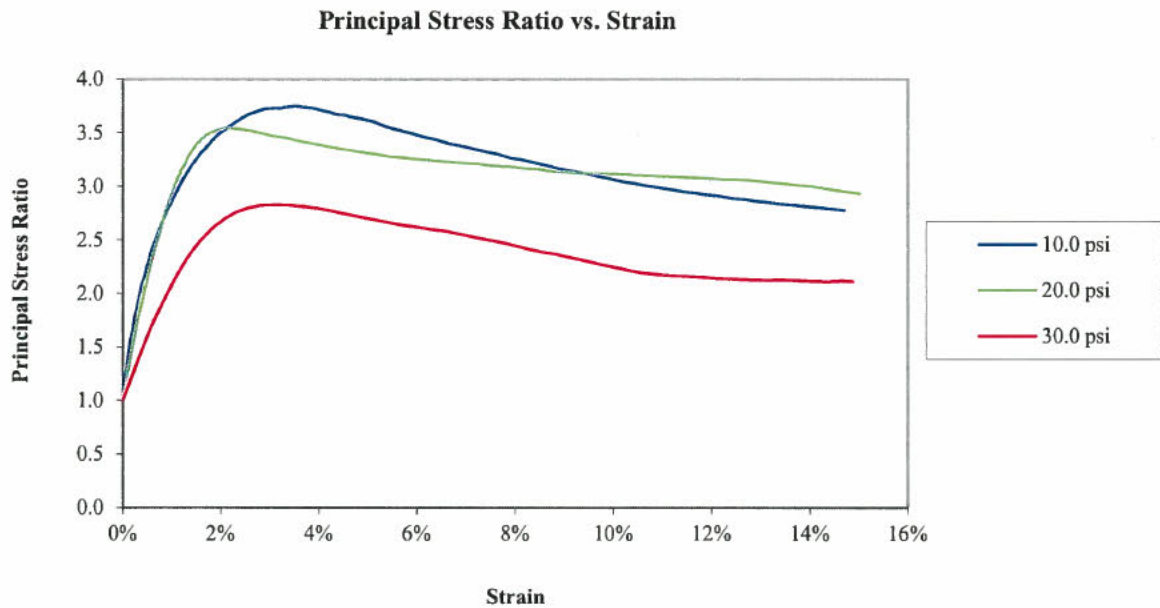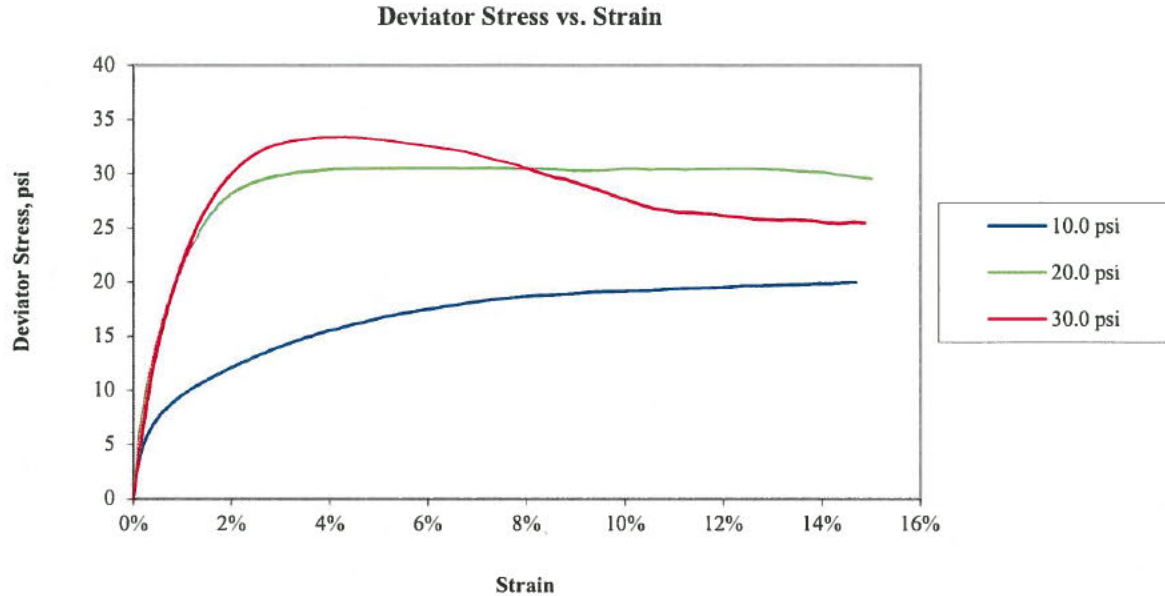

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT DEVIATOR STRESS AND PRINCIPAL STRESS RATIO PLOT				
Job Short Title: FTN/ENERGY INDEPENDENCE/AR						
Sample: PZ-1 UD 10.0-12.0'		Technician: FT/PWM Check: 	Reviewed: Approved:	Start Date: 6/25/2018	Job Number: 18103172	Figure: 3

Stress Path (p'-q) Plot

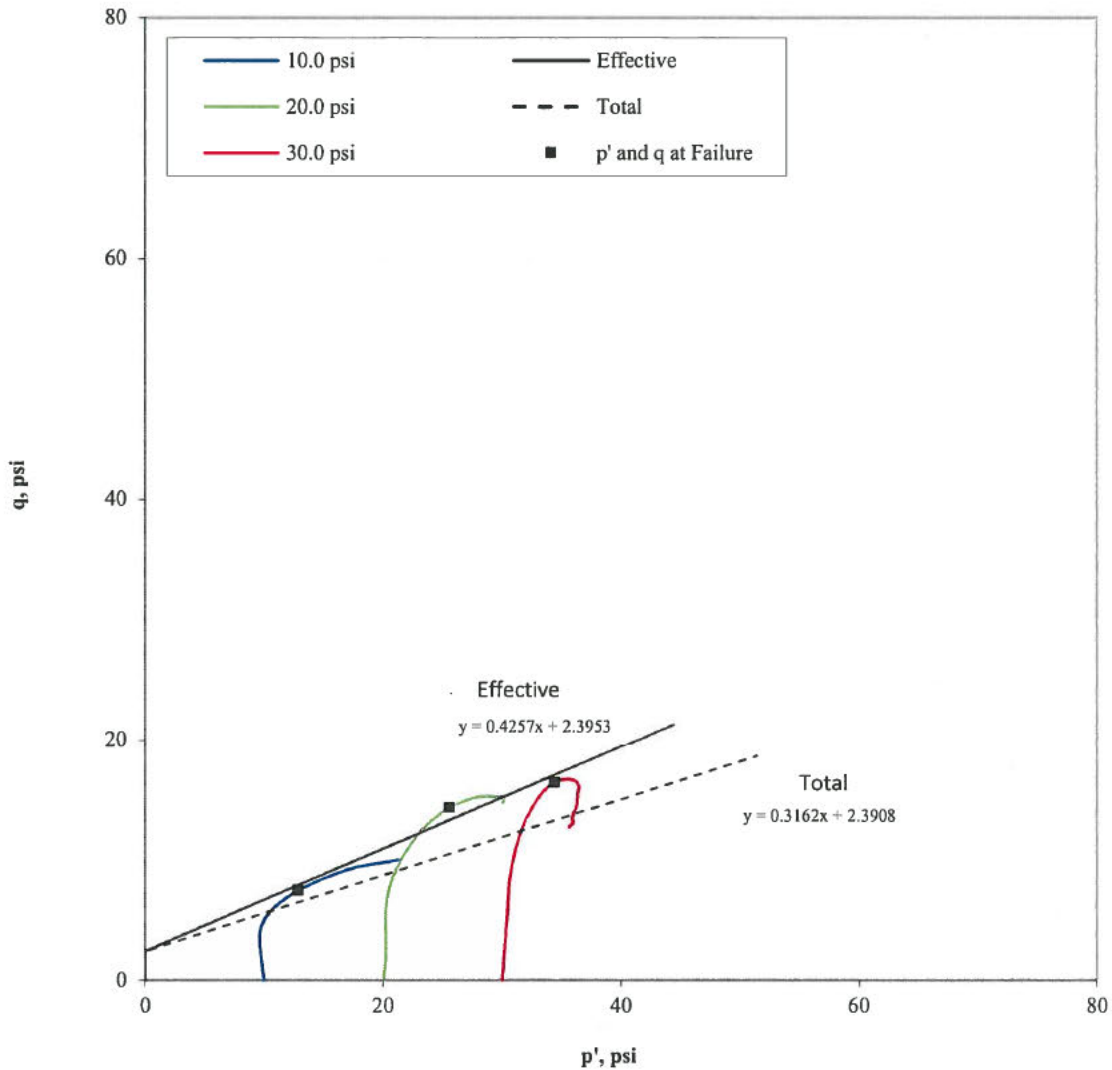


Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
10.0	17.5	12.9	7.5
20.0	34.3	25.6	14.3
30.0	46.4	34.4	16.4

Effective		
α'	23.1	degree
a'	2.4	psi
Total		
α	17.5	degree
a	2.4	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT STRESS PATH PLOT			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: PZ-1 UD 10.0-12.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/25/2018	Job Number: 18103172
				Figure: 4	

Mohr's Circle Diagram

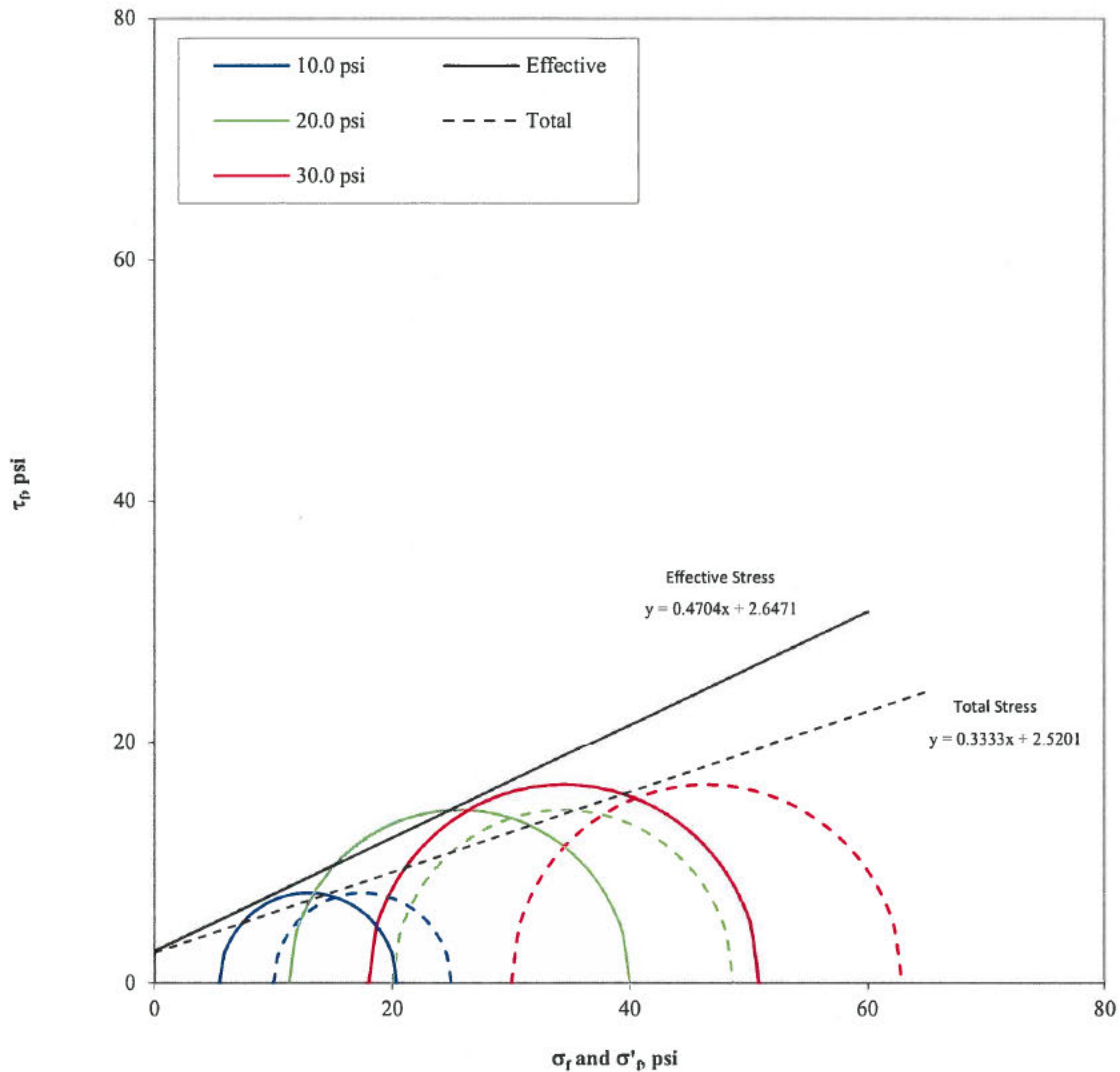

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
10.0	20.3	5.4	24.9	10.0
20.0	40.0	11.3	48.7	20.0
30.0	50.9	18.0	62.9	30.0

Effective

$\phi' = 25.2$ degree
 $c' = 2.6$ psi

Total

$\phi = 18.4$ degree
 $c = 2.5$ psi


Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT MOHR'S CIRCLE DIAGRAM				
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR						
Sample: PZ-1 UD 10.0-12.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/25/2018	Job Number: 18103172	Figure: 5

10.0 psi



20.0 psi

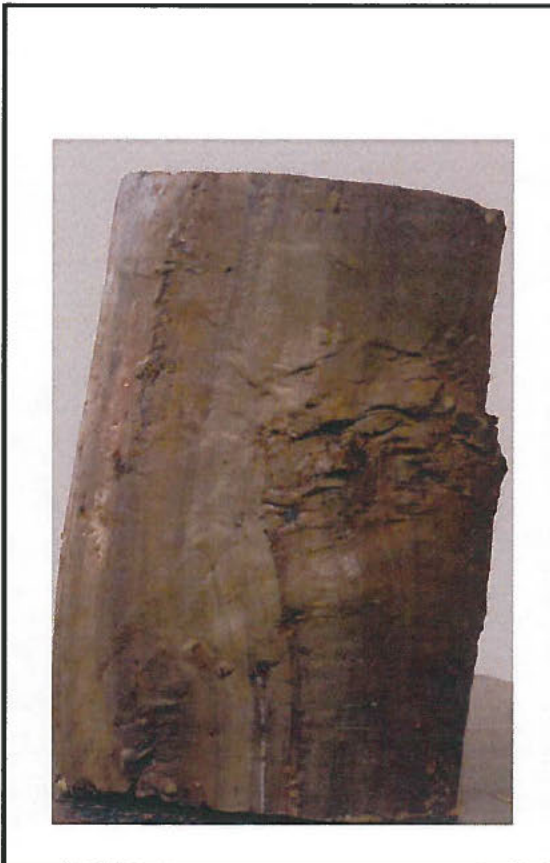

30.0 psi



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:

FTN/ENTERGY INDEPENDENCE/AR

Sample:

PZ-1 UD 10.0-12.0'

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SPECIMENS PHOTOGRAPH -

10.0

20.0

30.0

psi

Technician:

FT/PWM

Check:

Reviewed:

SR

Approved:

Start Date:

6/25/2018

Job Number:

18103172

Figure:

6

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS


ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR

SAMPLE ID: PZ-1

Depth: 15.0-17.0'

TYPE: UD

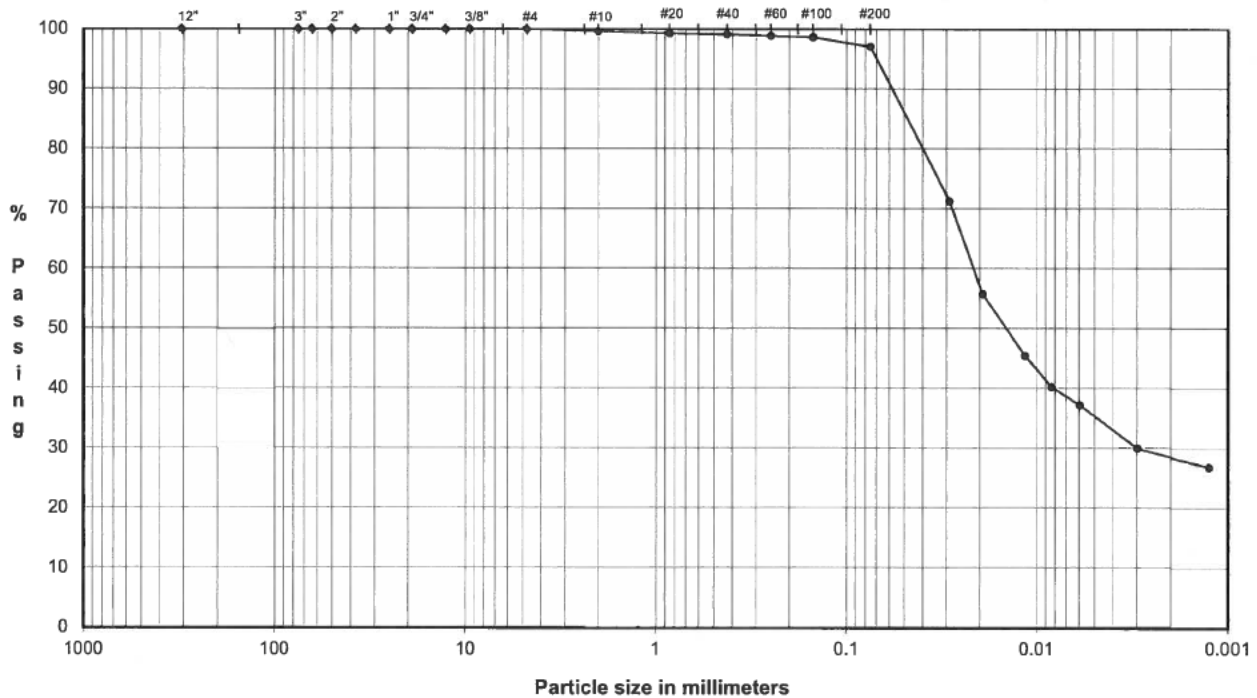

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers


Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	Cobbles
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	100.0	
1.0"	25.0	100.0	
0.75"	19.0	100.0	Coarse Gravel
0.50"	12.7	100.0	
0.375"	9.5	100.0	
#4	4.8	100.0	Fine Gravel
#10	2.00	99.6	Coarse Sand
#20	0.85	99.2	
#40	0.43	99.1	Medium Sand
#60	0.25	98.8	
#100	0.15	98.6	
#200	0.075	97.0	Fine Sand

Hydrometer Analysis

(mm)	% Finer		
0.029	71.2		
0.019	55.7		
0.012	45.4	Fines	
0.0083	40.2	Silt or Clay	97.0
0.0060	37.1		
0.0030	29.9		
0.0013	26.8		

DESCRIPTION: SILTY CLAY, trace fine to coarse sand; yellowish gray.

USCS: CL

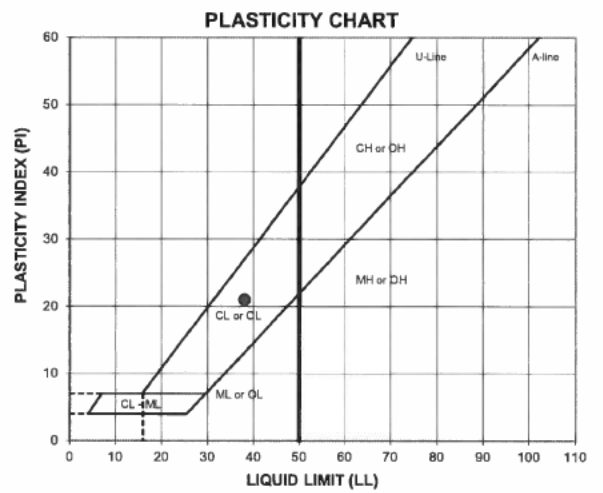ATTERBERG LIMITS
Method -B (Dry preparation)

M _c	LL	PL	PI	LI
28.9	38	17	21	0.56

LL (oven-dried)
< 0.75 = ORGANIC (LO/OH)

TECH TB/HH
DATE 6/28/18
CHECK *[Signature]*
REVIEW *[Signature]*
APPROVE

Boring or Test Pit: **PZ-1**
Sample: **UD**
Depth: **15.0-17.0 ft**
Point No.: **1**

Initial
Length = **6.052** in
Diameter = **2.835** in
Wet Mass = 2.738 lb
Area = 6.312 in²
Volume = 38.203 in³
Specific Gravity = **2.78 (ASTM D854)**
Dry Mass of Solids = 2.168 lb
Moisture Content = **26.3%**
Wet Unit Weight = 123.8 pcf
Dry Unit Weight = 98.1 pcf
Void Ratio = 0.76
Percent Saturation = 96%

After Consolidation
Length = **6.000** in
Diameter = 2.833 in
Area = 6.305 in² (Method B)
Volume = 37.830 in³
Moisture Content = **26.9%**
Wet Unit Weight = 125.7 pcf
Dry Unit Weight = 99.0 pcf
Void Ratio = 0.75
Percent Saturation = 100%

B Parameter = **0.99**
Shear Rate = 0.030% /min.
 t_{50} = **8.41** min.
Strain at Failure = 2.6%

Cell Pressure = **94.0** psi
Back Pressure = **80.0** psi
Confining Pressure = 14.0 psi

Boring or Test Pit: **PZ-1**
Sample: **UD**
Depth: **15.0-17.0 ft**
Point No.: **2**

Initial
Length = **6.088** in
Diameter = **2.765** in
Wet Mass = 2.599 lb
Area = 6.005 in²
Volume = 36.556 in³
Specific Gravity = **2.78 (ASTM D854)**
Dry Mass of Solids = 2.010 lb
Moisture Content = **29.3%**
Wet Unit Weight = 122.9 pcf
Dry Unit Weight = 95.0 pcf
Void Ratio = 0.82
Percent Saturation = 99%

After Consolidation
Length = **5.997** in
Diameter = 2.764 in
Area = 6.002 in² (Method B)
Volume = 35.993 in³
Moisture Content = **28.5%**
Wet Unit Weight = 124.0 pcf
Dry Unit Weight = 96.5 pcf
Void Ratio = 0.79
Percent Saturation = 100%

B Parameter = **1.00**
Shear Rate = 0.091% /min.
 t_{50} = **0.23** min.
Strain at Failure = 6.7%

Cell Pressure = **108.0** psi
Back Pressure = **80.0** psi
Confining Pressure = 28.0 psi

Boring or Test Pit: **PZ-1**
Sample: **UD**
Depth: **15.0-17.0 ft**
Point No.: **3**

Initial
Length = **6.055** in
Diameter = **2.808** in
Wet Mass = 2.632 lb
Area = 6.193 in²
Volume = 37.497 in³
Specific Gravity = **2.78 (ASTM D854)**
Dry Mass of Solids = 2.007 lb
Moisture Content = **31.1%**
Wet Unit Weight = 121.3 pcf
Dry Unit Weight = 92.5 pcf
Void Ratio = 0.87
Percent Saturation = 99%

After Consolidation
Length = **5.963** in
Diameter = 2.782 in
Area = 6.081 in² (Method B)
Volume = 36.259 in³
Moisture Content = **29.1%**
Wet Unit Weight = 123.5 pcf
Dry Unit Weight = 95.7 pcf
Void Ratio = 0.81
Percent Saturation = 100%

B Parameter = **0.98**
Shear Rate = 0.091% /min.
 t_{50} = **0.15** min.
Strain at Failure = 5.8%

Cell Pressure = **122.0** psi
Back Pressure = **80.0** psi
Confining Pressure = 42.0 psi

Notes: Sample description: **(CL) SILTY CLAY, trace fine to coarse sand; yellowish gray.**
Atterberg limits: **LL = 38** **PL = 17** **PI = 21** (ASTM D4318)
Percent finer: **3/4 in. = 100%** **No. 4 = 100%** **No. 200 = 97%** (ASTM D422, refer to separate report for gradation curve)
Specimen type: ☒ Intact ☐ Reconstituted
Moisture from: ☐ Cuttings ☒ Entire specimen
Saturation method: ☒ Wet ☐ Dry
Failure criterion: ☒ $(\sigma'_1/\sigma'_3)_{max}$ ☐ $(\sigma'_1/\sigma'_3)_{max}$ % strain
Membrane effect: ☒ Corrected ☐ Not Corrected


Golder Associates Inc.
Atlanta, Georgia

Job Short Title:
FTN/ENERGY INDEPENDENCE/AR

Sample:
PZ-1 UD 15.0-17.0'

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
SAMPLE AND TEST DATA

Technician:
FT/PWM
Check: 



Reviewed:

Approved:



Start Date:
6/29/2018

Job Number:
18103172

Figure:
1

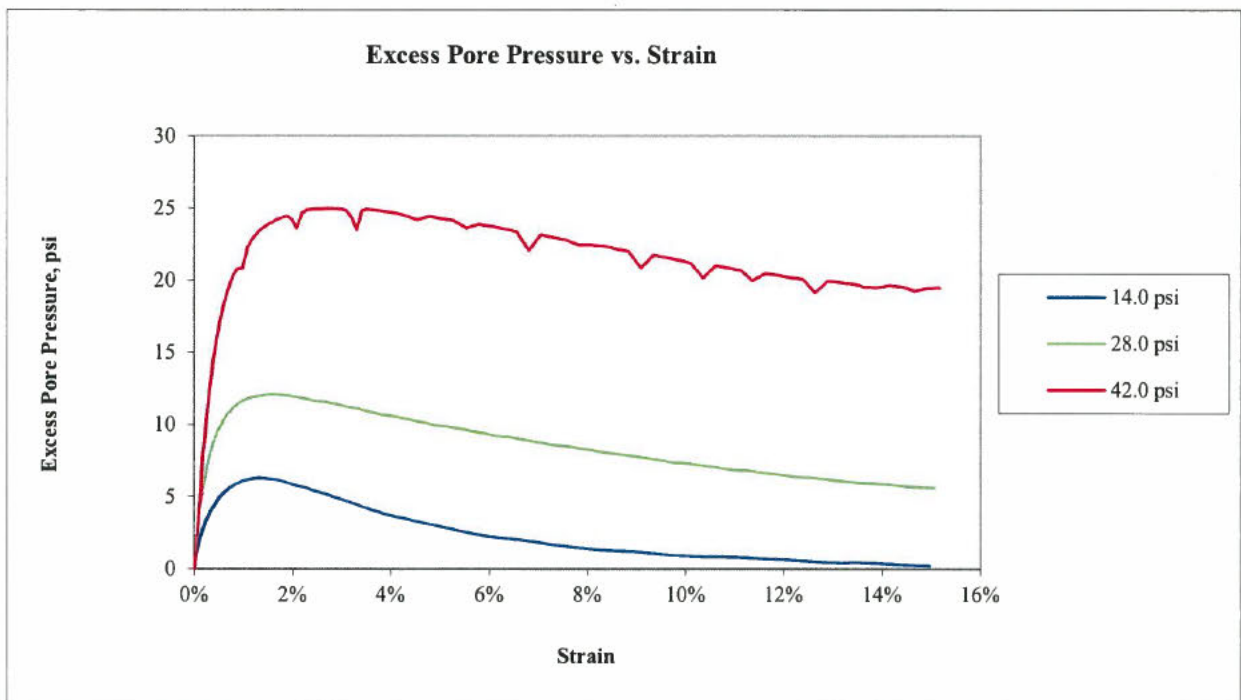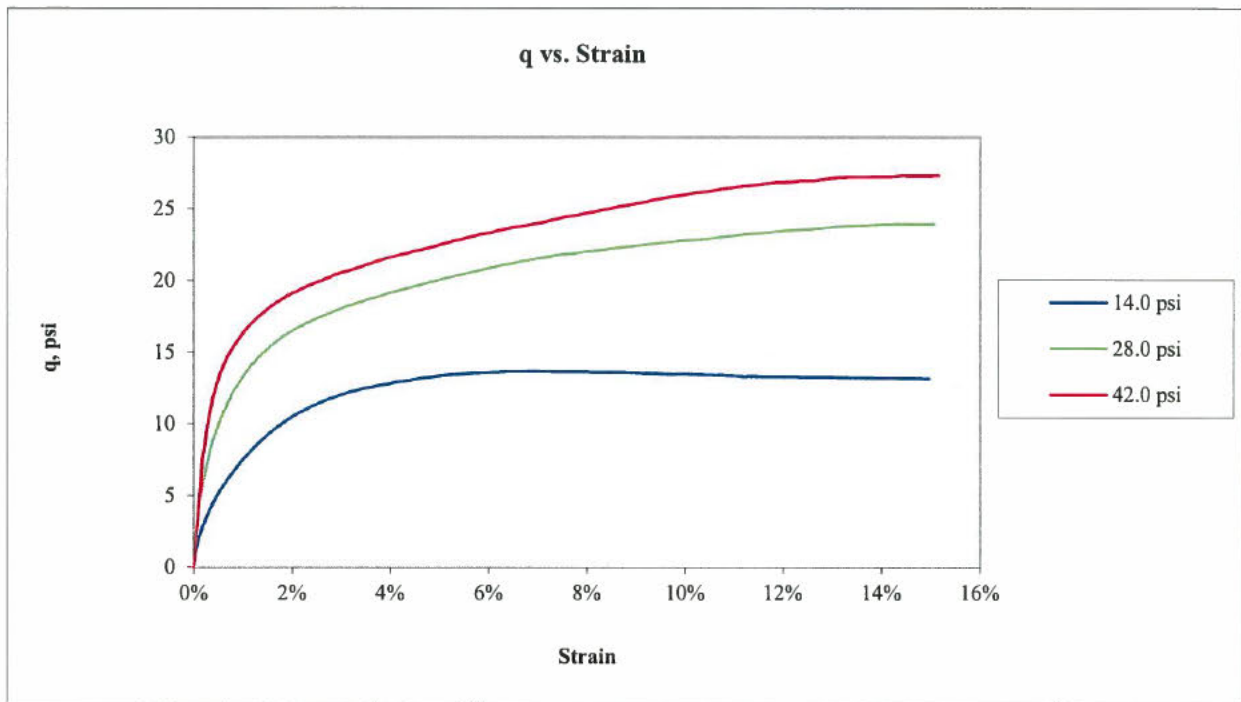


Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT q AND EXCESS PORE PRESSURE PLOTS			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: PZ-1 UD 15.0-17.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/29/2018	Job Number: 18103172
					Figure: 2

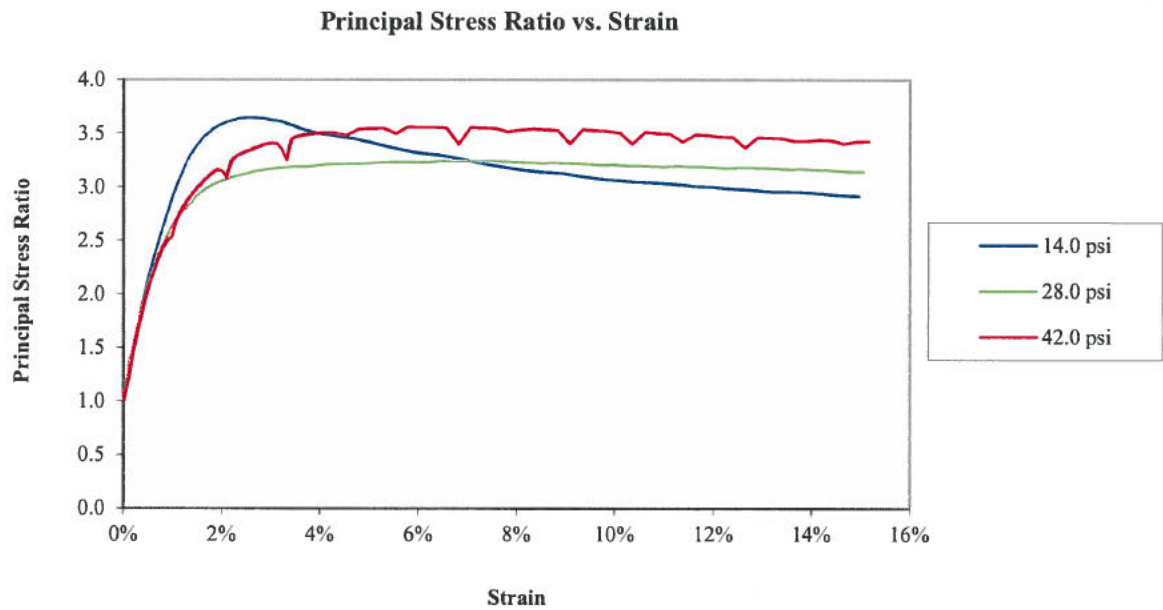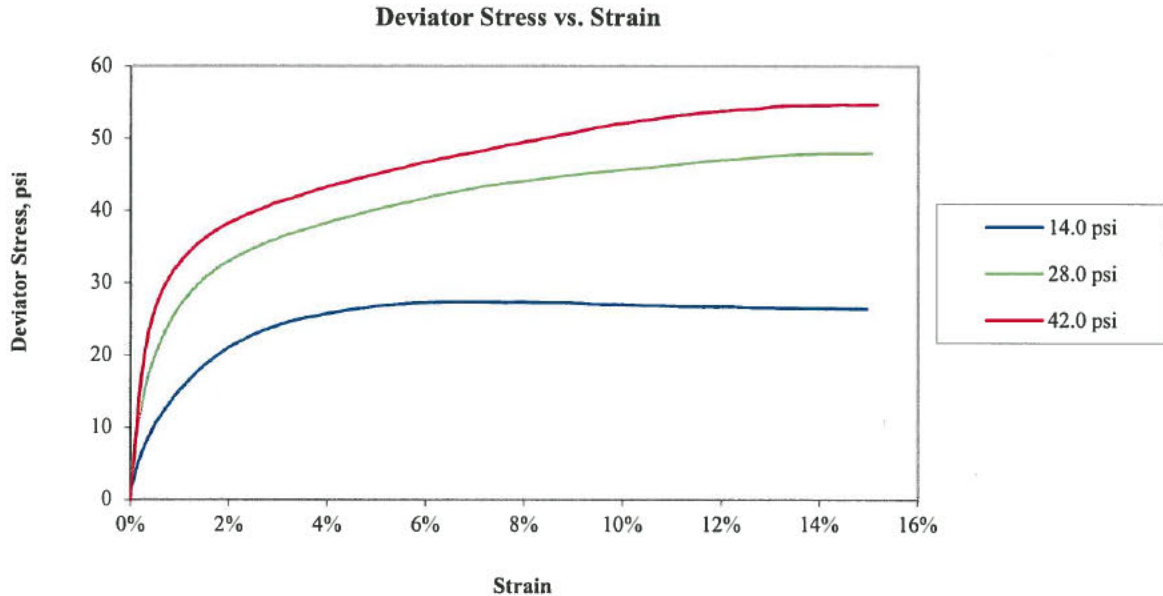

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT DEVIATOR STRESS AND PRINCIPAL STRESS RATIO PLOT													
Job Short Title: FTN/ENERGY INDEPENDENCE/AR		<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 15%; padding: 5px;">Technician: FT/PWM</td> <td style="width: 15%; padding: 5px;">Reviewed: <i>SL</i></td> <td style="width: 15%; padding: 5px;">Start Date:</td> <td style="width: 15%; padding: 5px;">Job Number:</td> <td style="width: 10%; padding: 5px;">Figure:</td> </tr> <tr> <td style="padding: 5px;">Check: <i>[Signature]</i></td> <td style="padding: 5px;">Approved:</td> <td style="padding: 5px;">6/29/2018</td> <td style="padding: 5px;">18103172</td> <td style="padding: 5px;">3</td> </tr> </table>				Technician: FT/PWM	Reviewed: <i>SL</i>	Start Date:	Job Number:	Figure:	Check: <i>[Signature]</i>	Approved:	6/29/2018	18103172	3
Technician: FT/PWM	Reviewed: <i>SL</i>					Start Date:	Job Number:	Figure:							
Check: <i>[Signature]</i>	Approved:	6/29/2018	18103172	3											
Sample: PZ-1 UD 15.0-17.0'															

Stress Path (p'-q) Plot

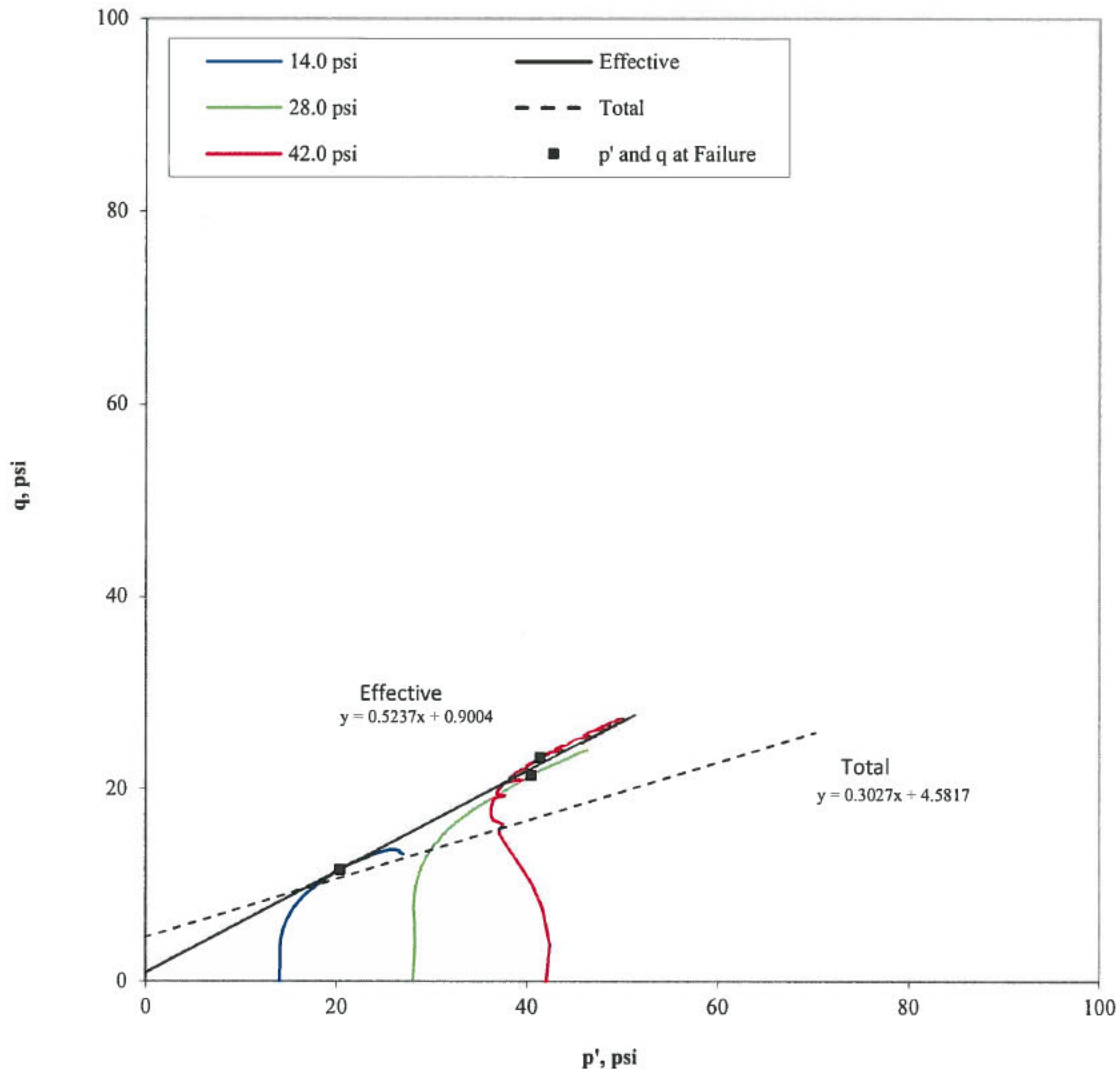


Confining Pressure (psi)	p at failure (psi)	p' at failure (psi)	q at failure (psi)
14.0	25.6	20.4	11.6
28.0	49.4	40.4	21.4
42.0	65.2	41.3	23.2

Effective		
α'	27.6	degree
a'	0.9	psi
Total		
α	16.8	degree
a	4.6	psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc. Atlanta, Georgia		Title: ASTM D4767 CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT STRESS PATH PLOT			
Job Short Title: FTN/ENTERGY INDEPENDENCE/AR					
Sample: PZ-1 UD 15.0-17.0'		Technician: FT/PWM Check: <i>[Signature]</i>	Reviewed: <i>[Signature]</i> Approved:	Start Date: 6/29/2018	Job Number: 18103172
				Figure: 4	

Mohr's Circle Diagram

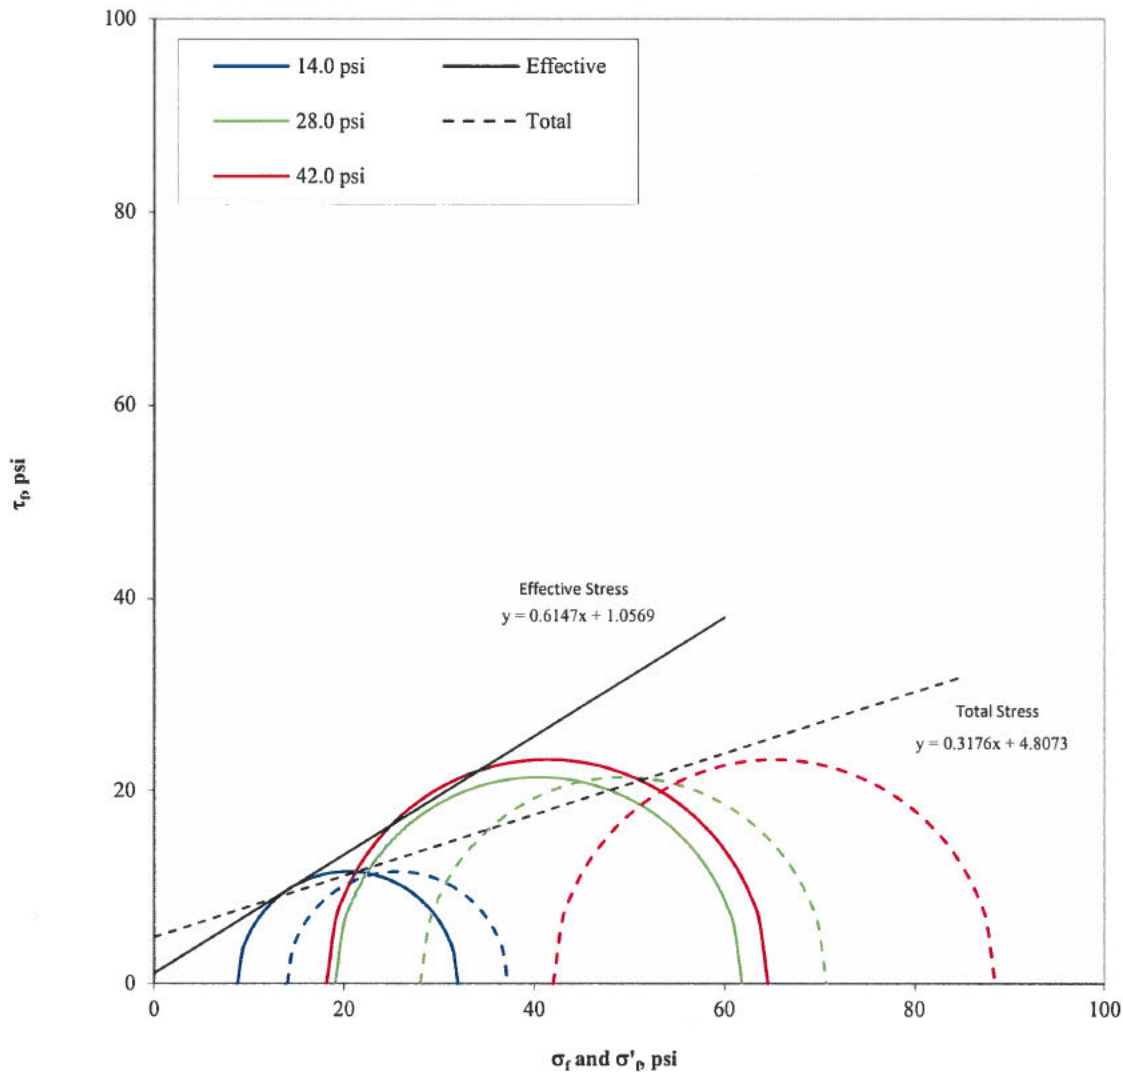

Confining Pressure (psi)	σ'_1 at failure (psi)	σ'_3 at failure (psi)	σ_1 at failure (psi)	σ_3 at failure (psi)
14.0	31.9	8.8	37.2	14.0
28.0	61.8	19.1	70.8	28.0
42.0	64.6	18.1	88.4	42.0

Effective

$\phi' = 31.6$ degree

$c' = 1.1$ psi

Total

$\phi = 17.6$ degree

$c = 4.8$ psi

Note: The laboratory testing relates only to the sample tested. GAI neither accepts responsibility for nor makes claims to the final use and purpose of the material.

Golder Associates Inc.
Atlanta, Georgia

Job Short Title:
FTN/ENERGY INDEPENDENCE/AR

Sample:

PZ-1 UD 15.0-17.0'

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT
MOHR'S CIRCLE DIAGRAM

Technician:
FT/PWM
Check:

Reviewed:
SK
Approved:

Start Date:

6/29/2018

Job Number:

18103172

Figure:

5

14.0 psi



28.0 psi



42.0 psi



Golder Associates Inc.
Atlanta, Georgia

Job Short Title:

FTN/ENTERGY INDEPENDENCE/AR

Sample:

PZ-1 UD 15.0-17.0'

Title:

ASTM D4767
CONSOLIDATED UNDRAINED TRIAXIAL COMPRESSION TEST REPORT

SPECIMENS PHOTOGRAPH - 14.0 28.0 42.0 psi

Technician:

FT/PWM

Check:

lwm

Reviewed:

[Signature]

Approved:

Start Date:

6/29/2018

Job Number:

18103172

Figure:


6

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS

ASTM D421, D422, D4318

PROJECT NAME: FTN/ENTERGY INDEPENDENCE/AR
 SAMPLE ID: PZ-1
 TYPE: Bag


Depth: 45.0-47.0'

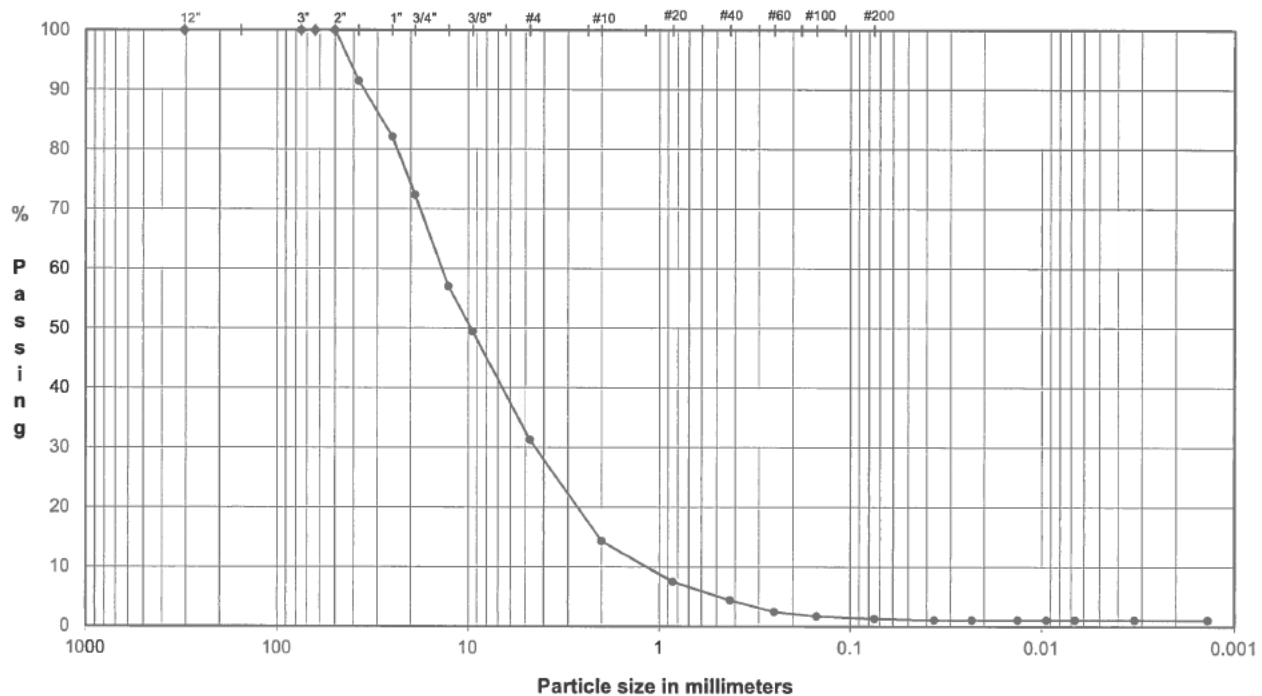

	Coarse	Fine	Coarse	Medium	Fine	Silt or Clay
COBBLES	GRAVEL		SAND			FINES

U.S. Standard Sieves Sizes and Numbers

Particle Size (mm)	% Passing	Classification	Percentage
12.0"	304.8	100.0	
3.0"	75.0	100.0	
2.5"	63.5	100.0	
2.0"	50.0	100.0	
1.5"	37.5	91.5	
1.0"	25.0	82.2	
0.75"	19.0	72.3	Coarse Gravel
0.50"	12.7	57.0	
0.375"	9.5	49.4	
#4	4.8	31.3	Fine Gravel
#10	2.00	14.3	Coarse Sand
#20	0.85	7.5	
#40	0.43	4.4	Medium Sand
#60	0.25	2.4	
#100	0.15	1.7	
#200	0.075	1.3	Fine Sand

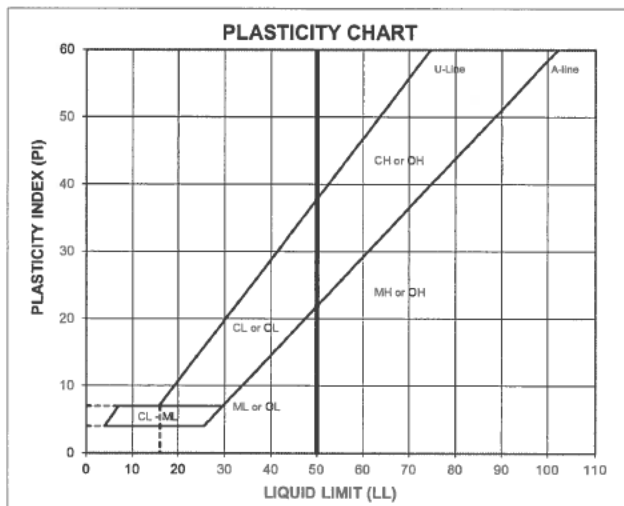

Hydrometer Analysis

(mm)	% Finer	Classification	Percentage
0.037	1.1		
0.023	1.1		
0.013	1.1		
0.0095	1.1		
0.0067	1.1		
0.0033	1.1		
0.0014	1.1		

DESCRIPTION: sandy GRAVEL, fine to coarse, fine to coarse sand, trace fines; yellowish brown.

USCS: GW

 ATTERBERG LIMITS
 Method -B (Dry preparation)

M _c	LL	FL	PI	LI
7.6	NP	NP	NP	NP

LL (oven-dried)
 < 0.75 = ORGANIC (LO/OH)

TECH TJ/HH/BA
 DATE 7/30/18
 CHECK [Signature]
 REVIEW [Signature]
 APPROVE [Signature]

NOTE: Insufficient sample received to perform in accordance with ASTM Standards